


OIL ANALYSIS REPORT

PG 46 [277840] **SULLAIR 003-64443 - SWD**

Component Compressor

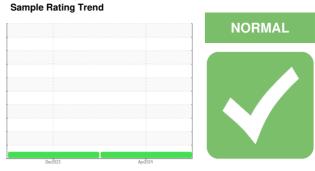

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0000904	UFD0000456	
Sample Date		Client Info		22 Apr 2024	21 Dec 2023	
Machine Age	hrs	Client Info		0	0	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	NORMAL	
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>25	0	0	
Lead	ppm	ASTM D5185m	>25	0	0	
Copper	ppm	ASTM D5185m	>50	0	<1	
Tin	ppm	ASTM D5185m	>15	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m		0	0	
Calcium	ppm	ASTM D5185m		0	0	
Phosphorus	ppm	ASTM D5185m		397	408	
Zinc	ppm	ASTM D5185m		0	0	
Sulfur	ppm	ASTM D5185m		235	122	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	2	
Sodium	ppm	ASTM D5185m		0	0	
Potassium	ppm	ASTM D5185m	>20	0	0	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.36	0.24	




OIL ANALYSIS REPORT

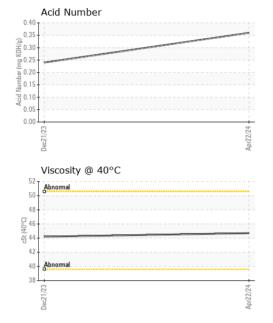


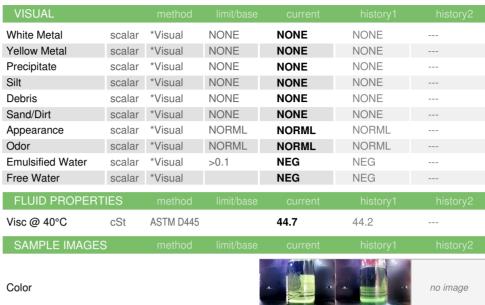



GRAPHS

Bottom













Certificate 12367

Laboratory Sample No.

Lab Number : 06197805 Unique Number : 11059928

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UFD0000904

Received **Tested**

: 04 Jun 2024 Diagnosed

: 04 Jun 2024 - Wes Davis

: 03 Jun 2024

Contact: ED DIENER ed.diener@fluidairedynamics.com T: (847)678-8388

FLUID-AIRE DYNAMICS

225 SPRING LAKE DR

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCFLUSCH [WUSCAR] 06197805 (Generated: 06/04/2024 13:35:17) Rev: 1

ITASCA, IL

US 60143

no image