


# **OIL ANALYSIS REPORT**

# **KAESER S-460 [9695] KAESER 1673 - WINNEBAGO IND**

Component Compressor



### DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI0924296		
Sample Date		Client Info		23 May 2024		
Machine Age	hrs	Client Info		13622		
Oil Age	hrs	Client Info		8355		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	15		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	1		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	18		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		18345		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		7		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.31




## **OIL ANALYSIS REPORT**

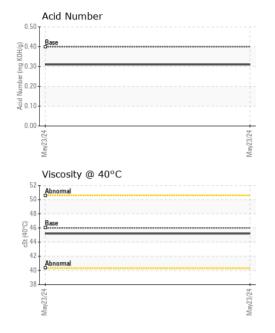






### **GRAPHS**

**Bottom** 









no image

no image





Certificate 12367

Laboratory Sample No.

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UDI0924296 Lab Number : 06197841 Unique Number : 11059964

Received **Tested** 

: 03 Jun 2024 : 04 Jun 2024 Diagnosed : 04 Jun 2024 - Wes Davis

**DELTA INDUSTRIES - CEDAR RAPIDS** 

6540 4TH ST SW UNIT A CEDAR RAPIDS, IA US 52404

Contact: MICHAEL FERRIS wearcheck@deltaind.net

T: (319)862-2500 F: (319)862-2501

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)