


OIL ANALYSIS REPORT

PNEUTECH INGERSOLL RAND 2 - ALLEN HARIM

Component Compressor

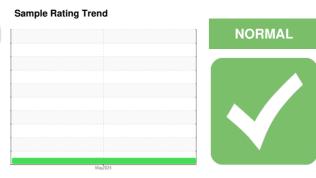

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) COMPRESSOR OIL (PAG) ISO 46. Please confirm.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0001654		
Sample Date		Client Info		24 May 2024		
Machine Age	hrs	Client Info		6761		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.8	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	0		
Barium	ppm	ASTM D5185m	525	735		
Molybdenum	ppm	ASTM D5185m	10	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	5	3		
Calcium	ppm	ASTM D5185m	10	1		
Phosphorus	ppm	ASTM D5185m	250	0		
Zinc	ppm	ASTM D5185m	100	0		
Sulfur	ppm	ASTM D5185m	400	2		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		27		
Potassium	ppm	ASTM D5185m	>20	5		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.26		




OIL ANALYSIS REPORT

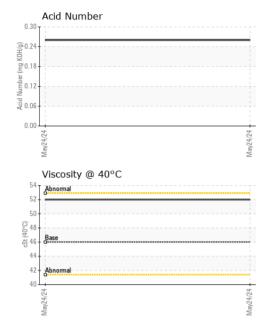



VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.8	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	52.0		

O/ IIVII EE IIVI/ IGEO			
Color		no image	no image
Bottom		no image	no image
CDADUS			













Certificate 12367

Sample No. : UFD0001654 Lab Number : 06197845

Test Package : IND 2

Unique Number : 11059968

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : 03 Jun 2024 Received Tested : 04 Jun 2024

Diagnosed : 04 Jun 2024 - Wes Davis

FLUID-AIRE DYNAMICS 36 MOUNTAIN VIEW RD MORGANTOWN, PA US 19543

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: