




OIL ANALYSIS REPORT



Machine Id
Grand Blanc CAT 4 GBLM04BE
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)

Sample Rating Trend

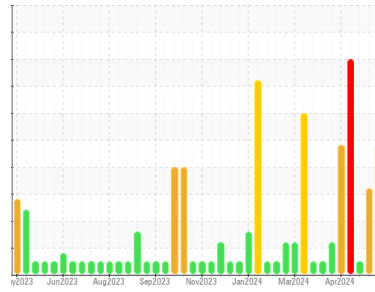

DEGRADATION



DIAGNOSIS

▲ Recommendation

We recommend that you drain the oil and perform a filter service on this component if not already done. We recommend an early resample to monitor this condition. (Customer Sample Comment: 600hr Oil Sample)

Wear

All component wear rates are normal.

▲ Contamination

Elemental level of silicon (Si) above normal.

▲ Fluid Condition

The BN level is low. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0905706	WC0905714	WC0905721
Sample Date	Client Info		29 May 2024	22 May 2024	13 May 2024
Machine Age	hrs	Client Info	70076	69889	69698
Oil Age	hrs	Client Info	609	0	231
Oil Changed	Client Info		Not Chngd	N/A	Changed
Sample Status			SEVERE	SEVERE	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>.11	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	4	4	4
Chromium	ppm	ASTM D5185m >4	0	0	0
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >6	3	3	1
Lead	ppm	ASTM D5185m >9	2	3	<1
Copper	ppm	ASTM D5185m >6	1	<1	<1
Tin	ppm	ASTM D5185m >4	3	2	1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	71	57	35
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	3	3	2
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	23	19	15
Calcium	ppm	ASTM D5185m	1830	1874	1872
Phosphorus	ppm	ASTM D5185m	359	345	312
Zinc	ppm	ASTM D5185m	464	454	392
Sulfur	ppm	ASTM D5185m	4480	4619	3937

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >181	▲ 194	151	122
Sodium	ppm	ASTM D5185m >21	<1	1	<1
Potassium	ppm	ASTM D5185m >20	0	<1	0

INFRA-RED






	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0.1	0
Nitration	Abs/cm	*ASTM D7624	5.8	5.6	5.7
Sulfation	Abs/.1mm	*ASTM D7415	25.0	23.0	21.8

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	16.1	14.6	13.3
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	2.15	1.81	1.61
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	▲ 2.41	▲ 2.46	3.01











OIL ANALYSIS REPORT

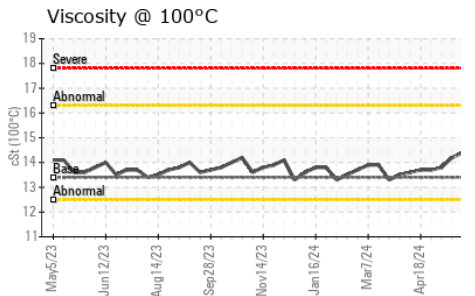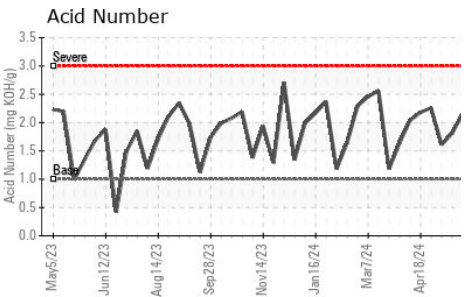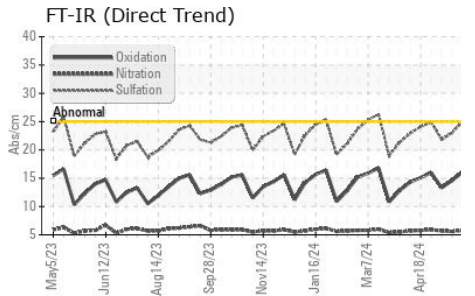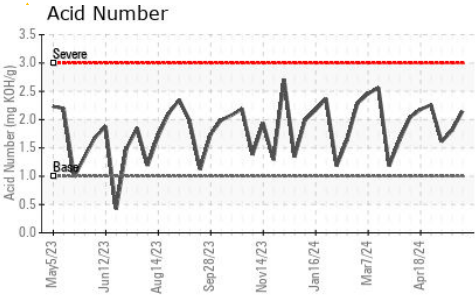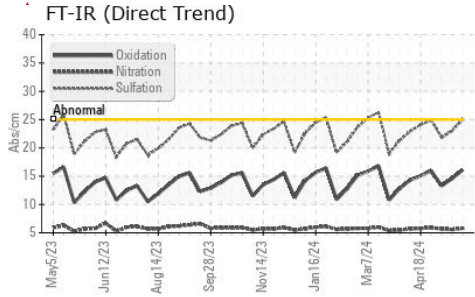

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.11	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	14.4	14.2

GRAPHS

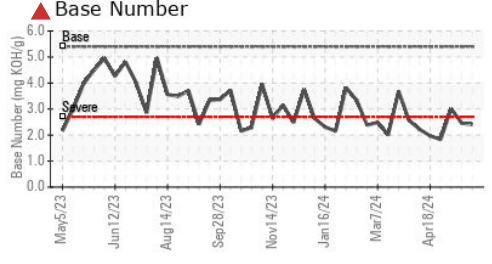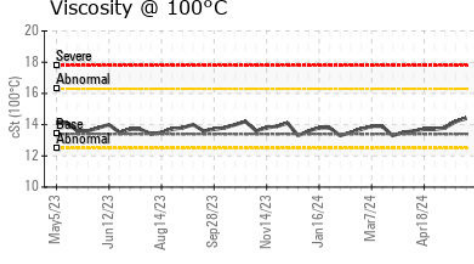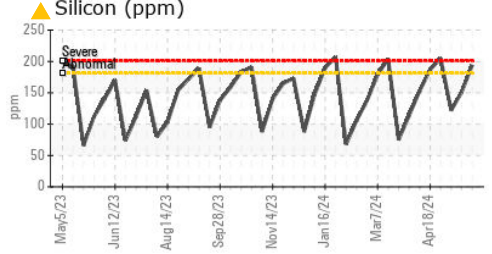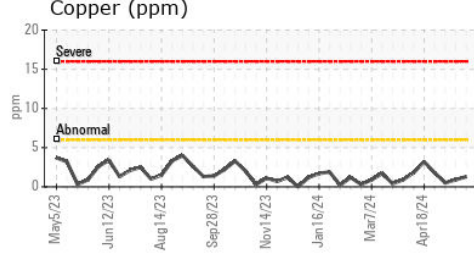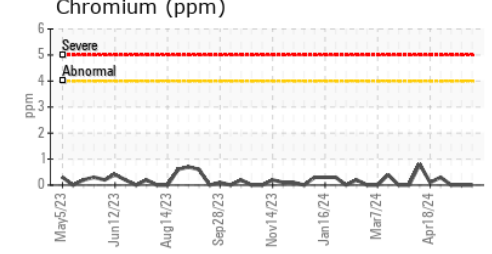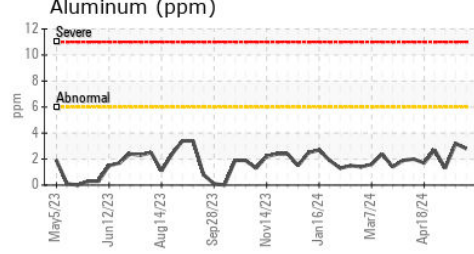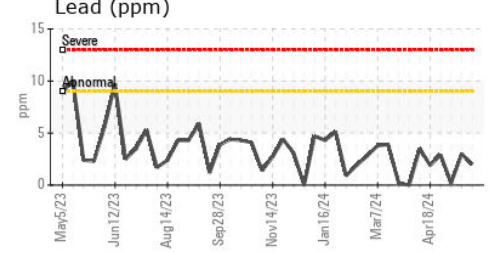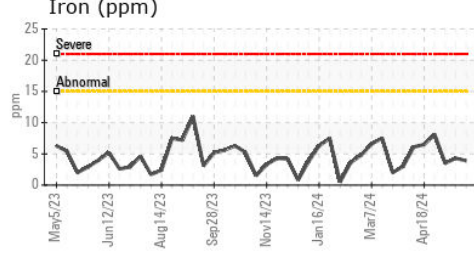

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0905706 **Received** : 03 Jun 2024
Lab Number : 06197880 **Tested** : 04 Jun 2024
Unique Number : 11060003 **Diagnosed** : 04 Jun 2024 - Don Baldrige
Test Package : MOB 2

EDL NA Recips-Grand Blanc
 Grand Blanc Powerstation, 2361 West Grand Blanc Road
 Grand Blanc, MI
 US 48439
 Contact: Tony Saint Marie
 tony.saintmarie@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)