




OIL ANALYSIS REPORT

Sample Rating Trend

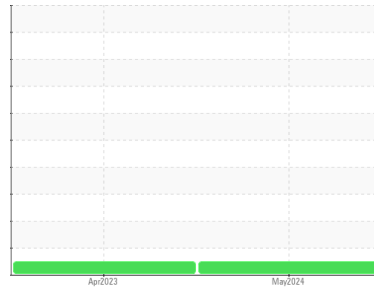

NORMAL



Area

04

Machine Id

[04] BASELINE - FG 46 REF

Component

New (Unused) Oil

Fluid

HIGH PERFORMANCE LUBRICANTS FG ISO 46 (1 GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample. (Customer Sample Comment: Batch#22L0701)

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			HPL0004907	HPL0003352	---
Sample Date	Client Info			28 May 2024	11 Apr 2023	---
Machine Age	hrs	Client Info		0	0	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			N/A	N/A	---
Sample Status				NORMAL	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method			NEG	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m		0	0	---
Chromium	ppm	ASTM D5185m		0	0	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m		0	0	---
Lead	ppm	ASTM D5185m		<1	0	---
Copper	ppm	ASTM D5185m		0	0	---
Tin	ppm	ASTM D5185m		0	0	---
Vanadium	ppm	ASTM D5185m		<1	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	<1	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m		<1	<1	---
Calcium	ppm	ASTM D5185m	1	0	<1	---
Phosphorus	ppm	ASTM D5185m	635	379	323	---
Zinc	ppm	ASTM D5185m		2	<1	---
Sulfur	ppm	ASTM D5185m	2225	2510	1666	---






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m		<1	<1	---
Sodium	ppm	ASTM D5185m		0	0	---
Potassium	ppm	ASTM D5185m	>20	2	<1	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	203	387	---
Particles >6µm		ASTM D7647	>1300	77	52	---
Particles >14µm		ASTM D7647	>160	12	6	---
Particles >21µm		ASTM D7647	>40	3	2	---
Particles >38µm		ASTM D7647	>10	0	0	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	15/13/11	16/13/10	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.1	1.12	1.02	---




OIL ANALYSIS REPORT

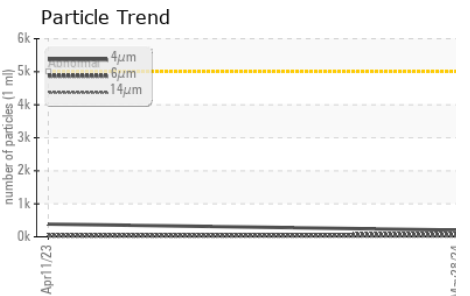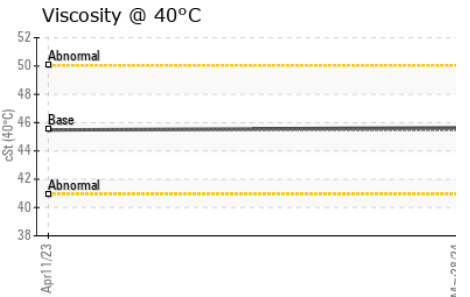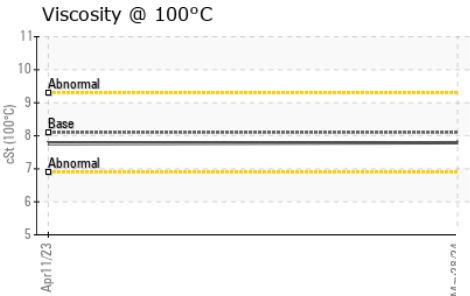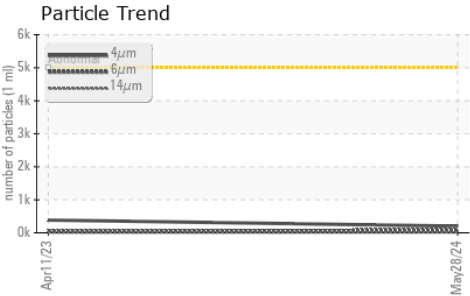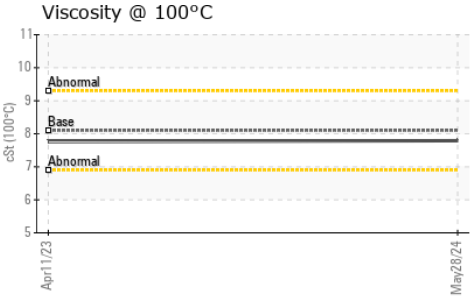






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	NEG	NEG	---
Free Water	scalar	*Visual	NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.5	45.64	45.48
Visc @ 100°C	cSt	ASTM D445	8.1	7.79	7.76
Viscosity Index (VI)	Scale	ASTM D2270	151	140	139

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

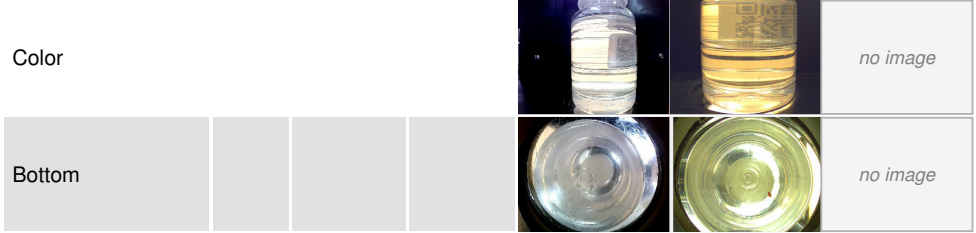

GRAPHS

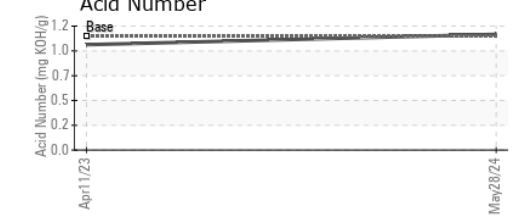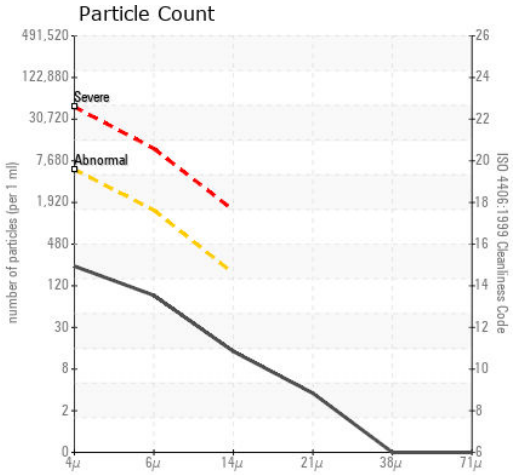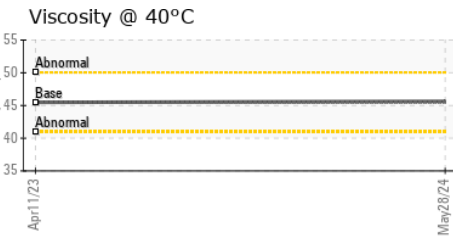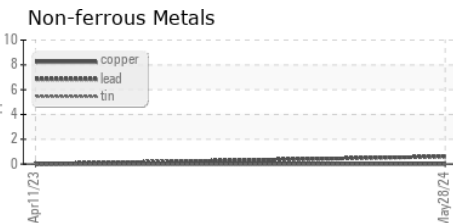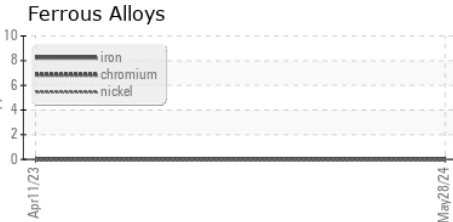

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : HPL0004907 **Received** : 03 Jun 2024
Lab Number : **06198103** **Tested** : 05 Jun 2024
Unique Number : 11060226 **Diagnosed** : 05 Jun 2024 - Jonathan Hester
Test Package : MOB 2 (Additional Tests: FT-IR, ICP-NewOil, KV100, PrtCount, VI)

KENSING
 2525 S KENSINGTON RD
 KANKAKEE, IL
 US 60901
 Contact: TIM HUBERT
 timothy.hubert@kensingolutions.com
 T: (815)939-8918
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)