


OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER 7105981

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jui	2021	Jan 2022 May 207	24	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017977	KCP48540	KCP42397
Sample Date		Client Info		24 May 2024	27 Jan 2022	22 Jun 2021
Machine Age	hrs	Client Info		38211	18373	13917
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				ATTENTION	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	<1
Aluminum	ppm	ASTM D5185m	>10	1	3	0
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	9	3	26
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	10
Barium	ppm	ASTM D5185m	90	0	3	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	6	60	5
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		2	7	6
Zinc	ppm	ASTM D5185m		5	0	16
Sulfur	ppm	ASTM D5185m		22160	18433	13968
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	0
Sodium	ppm	ASTM D5185m		0	7	1
Potassium	ppm	ASTM D5185m	>20	1	2	0
Water	%	ASTM D6304	>0.05	0.007	0.015	<u></u>
ppm Water	ppm	ASTM D6304	>500	76	157.5	△ 614.6
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		3789	4074	
Particles >6µm		ASTM D7647	>1300	1003	859	
Particles >14μm		ASTM D7647	>80	85	57	
Particles >21µm		ASTM D7647	>20	<u>25</u>	19	
Particles >38µm		ASTM D7647	>4	1	2	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/14	17/13	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

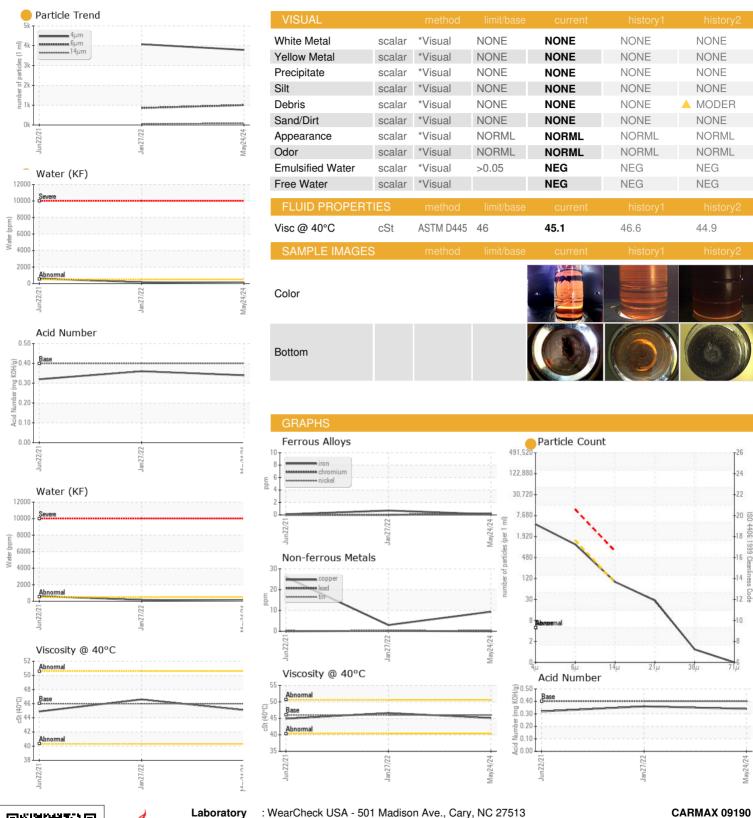





Certificate 12367

Laboratory

Sample No.

Lab Number

: KCPA017977 : 06198185 Unique Number : 11060308

Received **Tested**

: 03 Jun 2024 Diagnosed Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 05 Jun 2024

: 05 Jun 2024 - Don Baldridge

4400 INTERSTATE 35 AUSTIN, TX US 78745

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) T:

F: