




# OIL ANALYSIS REPORT

Sample Rating Trend

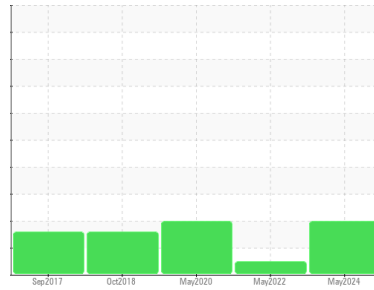

ISO



Machine Id  
**KAESER AIRTOWER 7.5C 5961242 (S/N 1661)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KCPA012969</b>	KCP50915	KCP24079
Sample Date	Client Info	<b>23 May 2024</b>	26 May 2022	08 May 2020
Machine Age	hrs	<b>3428</b>	2813	1932
Oil Age	hrs	<b>3428</b>	900	300
Oil Changed	Client Info	<b>N/A</b>	Changed	Changed
Sample Status		<b>ABNORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	<1
Chromium	ppm	ASTM D5185m >10	<1	0
Nickel	ppm	ASTM D5185m >3	<1	0
Titanium	ppm	ASTM D5185m >3	<1	0
Silver	ppm	ASTM D5185m >2	0	0
Aluminum	ppm	ASTM D5185m >10	1	<1
Lead	ppm	ASTM D5185m >10	<1	0
Copper	ppm	ASTM D5185m >50	12	15
Tin	ppm	ASTM D5185m >10	<1	0
Antimony	ppm	ASTM D5185m	---	---
Vanadium	ppm	ASTM D5185m	0	0
Cadmium	ppm	ASTM D5185m	<1	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	2
Barium	ppm	ASTM D5185m 90	0	<1
Molybdenum	ppm	ASTM D5185m	0	0
Manganese	ppm	ASTM D5185m	0	0
Magnesium	ppm	ASTM D5185m 90	18	12
Calcium	ppm	ASTM D5185m 2	0	0
Phosphorus	ppm	ASTM D5185m	2	0
Zinc	ppm	ASTM D5185m	29	49
Sulfur	ppm	ASTM D5185m	24214	18432

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	2
Sodium	ppm	ASTM D5185m	4	5
Potassium	ppm	ASTM D5185m >20	1	0
Water	%	ASTM D6304 >0.05	0.023	0.012
ppm Water	ppm	ASTM D6304 >500	231	123.9






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>62122</b>	933	13470
Particles >6µm	ASTM D7647 >1300	▲ <b>16608</b>	224	▲ 3194
Particles >14µm	ASTM D7647 >80	▲ <b>1093</b>	21	● 103
Particles >21µm	ASTM D7647 >20	▲ <b>230</b>	9	● 31
Particles >38µm	ASTM D7647 >4	▲ <b>10</b>	1	▲ 13
Particles >71µm	ASTM D7647 >3	▲ <b>1</b>	0	▲ 12
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ <b>23/21/17</b>	17/15/12	▲ 19/14

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.76	0.35


# OIL ANALYSIS REPORT

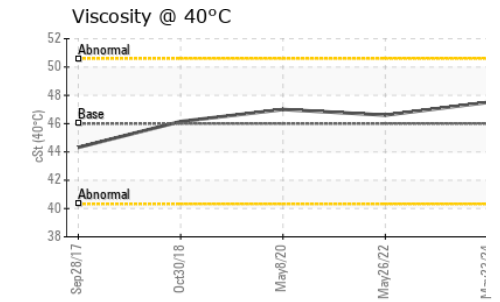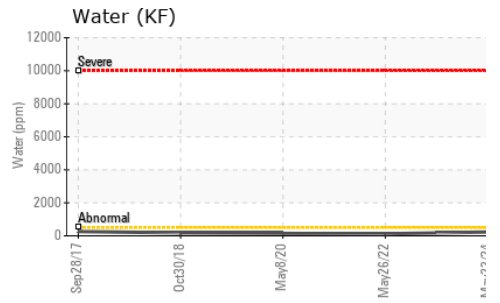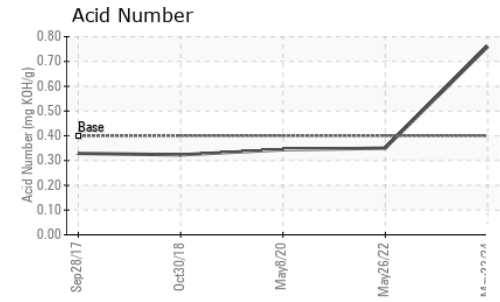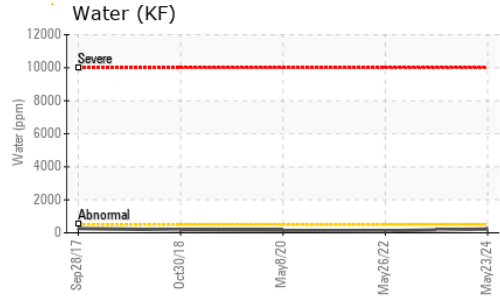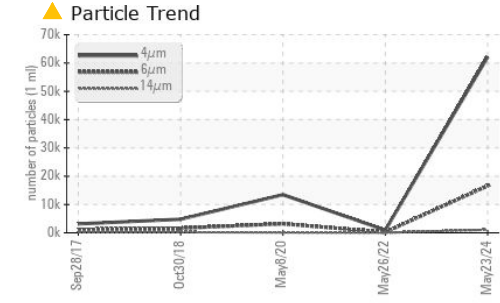






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	47.5	46.6	47.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

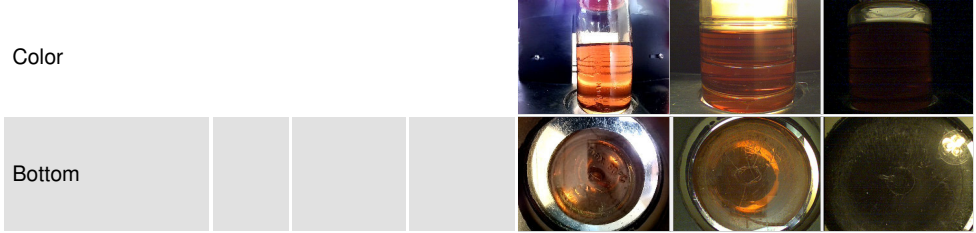

## GRAPHS

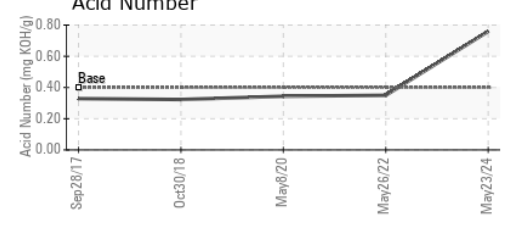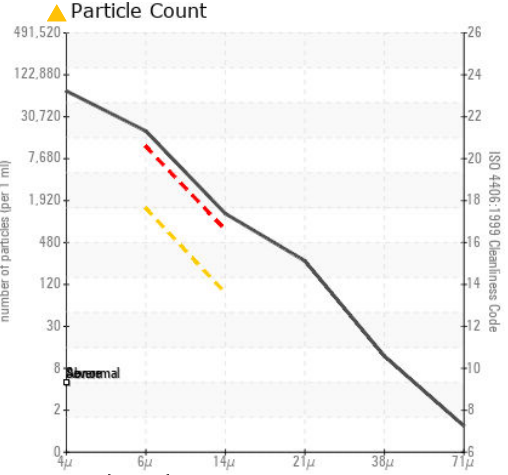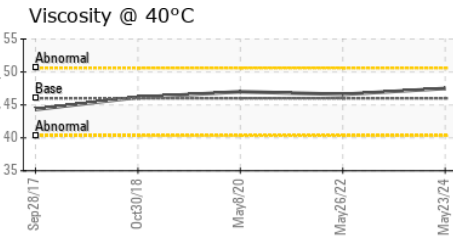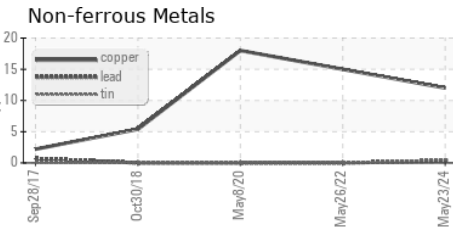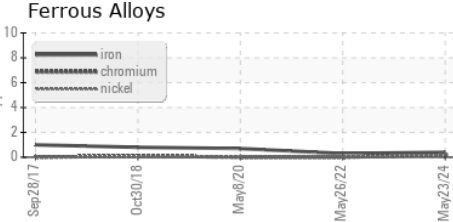

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA012969  
**Lab Number** : 06198194  
**Unique Number** : 11060317  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
**Received** : 03 Jun 2024  
**Tested** : 05 Jun 2024  
**Diagnosed** : 05 Jun 2024 - Don Baldrige

**YOUNGS PLANT FARM**  
 863 AIRPORT RD  
 AUBURN, AL  
 US 36830  
 Contact: STUART  
 stuart@youngsplantfarm.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)