




# OIL ANALYSIS REPORT

Sample Rating Trend

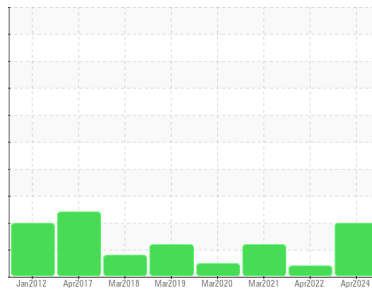

**WATER**



Machine Id  
**KAESER SK15 3217933 (S/N 1093)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

Oil and filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We recommend an early resample in 500 hours to monitor this condition.

**Wear**

All component wear rates are normal.

**Contamination**

High concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

**SAMPLE INFORMATION**

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KCPA015544</b>	KCP44344	KCP37216
Sample Date	Client Info	<b>02 Apr 2024</b>	13 Apr 2022	30 Mar 2021
Machine Age	hrs	<b>49436</b>	43656	40556
Oil Age	hrs	<b>0</b>	3000	0
Oil Changed	Client Info	<b>Changed</b>	Changed	Changed
Sample Status		<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

**WEAR METALS**

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<1	0	<1
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	0	0	<1
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >10	1	0	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	13	10	10
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	2
Cadmium	ppm	ASTM D5185m	<1	0	0

**ADDITIVES**

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	<1	<1
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 90	12	11	15
Calcium	ppm	ASTM D5185m 2	0	0	0
Phosphorus	ppm	ASTM D5185m	<1	13	0
Zinc	ppm	ASTM D5185m	54	34	51
Sulfur	ppm	ASTM D5185m	21554	15355	16971

**CONTAMINANTS**

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	0
Sodium	ppm	ASTM D5185m	1	4	5
Potassium	ppm	ASTM D5185m >20	2	0	0
Water	%	ASTM D6304 >0.05	▲ 0.083	0.044	0.013
ppm Water	ppm	ASTM D6304 >500	▲ 830	449.1	132.2




**FLUID CLEANLINESS**

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	---	---	27746
Particles >6µm	ASTM D7647 >1300	---	---	▲ 9492
Particles >14µm	ASTM D7647 >80	---	---	▲ 827
Particles >21µm	ASTM D7647 >20	---	---	▲ 158
Particles >38µm	ASTM D7647 >4	---	---	2
Particles >71µm	ASTM D7647 >3	---	---	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	---	---	▲ 20/17

**FLUID DEGRADATION**

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.33	0.34	0.351


# OIL ANALYSIS REPORT

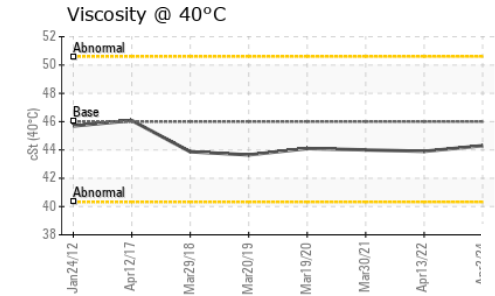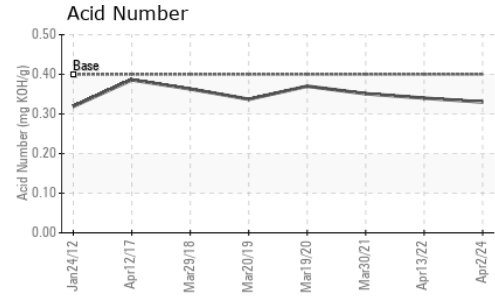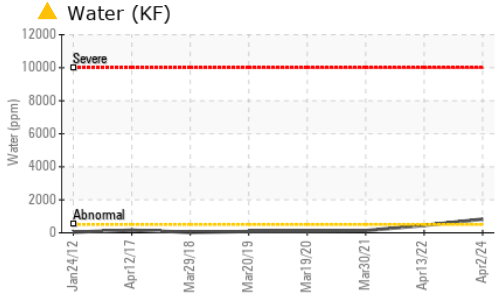





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	▲ HEAVY	▲ MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.3	43.9	44.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

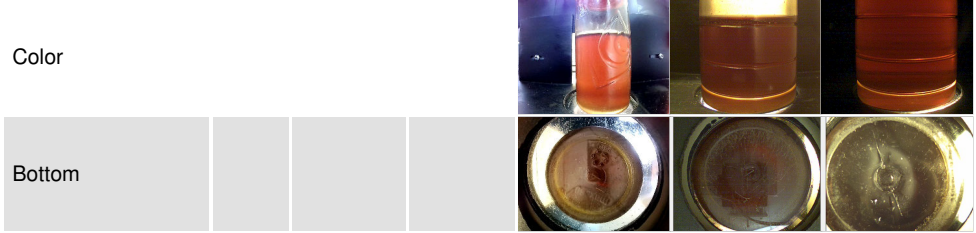

## GRAPHS

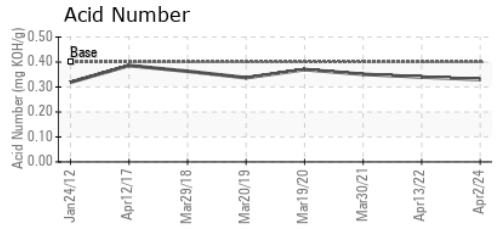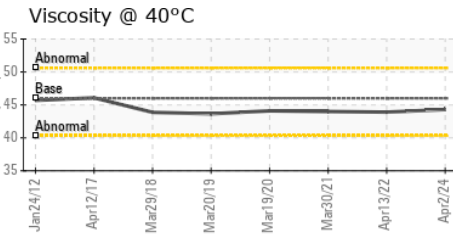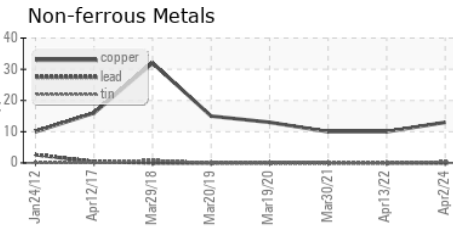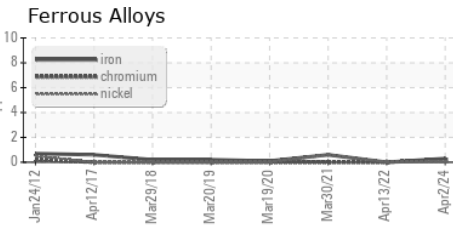

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA015544 **Received** : 03 Jun 2024  
**Lab Number** : 06198203 **Tested** : 05 Jun 2024  
**Unique Number** : 11060326 **Diagnosed** : 05 Jun 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**LEGACY TECHNOLOGIES**  
 6700 W 47TH TER  
 SHAWNEE, KS  
 US 66203  
 Contact: D. BELL  
 dbell@legacytechnologies.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)