




# OIL ANALYSIS REPORT

Sample Rating Trend

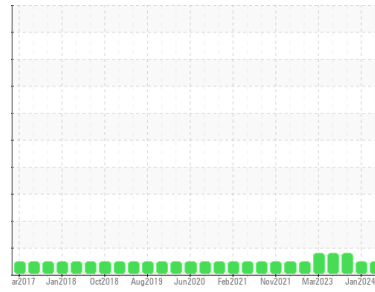

**NORMAL**



Machine Id  
**GARDNER DENVER 4 SLA (S/N 5038557)**  
 Component  
**Air Compressor**  
 Fluid  
**USPI MAX FG AIR 46 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USPM36408</b>	USPM30917	USPM31927
Sample Date	Client Info	<b>29 May 2024</b>	29 Jan 2024	05 Dec 2023
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	<b>&lt;1</b>	0	0
Chromium	ppm ASTM D5185m >4	<b>&lt;1</b>	0	0
Nickel	ppm ASTM D5185m >4	<b>&lt;1</b>	<1	0
Titanium	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >10	<b>1</b>	<1	0
Lead	ppm ASTM D5185m >20	<b>&lt;1</b>	2	0
Copper	ppm ASTM D5185m >40	<b>&lt;1</b>	4	4
Tin	ppm ASTM D5185m >5	<b>&lt;1</b>	<1	0
Vanadium	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm ASTM D5185m	<b>&lt;1</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m 0	<b>&lt;1</b>	<1	0
Manganese	ppm ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm ASTM D5185m 0	<b>&lt;1</b>	1	<1
Calcium	ppm ASTM D5185m 0	<b>0</b>	0	0
Phosphorus	ppm ASTM D5185m 0	<b>0</b>	0	<1
Zinc	ppm ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm ASTM D5185m 0	<b>0</b>	31	0

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<b>&lt;1</b>	<1	0
Sodium	ppm ASTM D5185m	<b>&lt;1</b>	2	2
Potassium	ppm ASTM D5185m >20	<b>1</b>	4	2
Water	% ASTM D6304 >0.6	<b>0.002</b>	0.007	0.009
ppm Water	ppm ASTM D6304 >6000	<b>24</b>	75	93

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>373</b>	95	---
Particles >6µm	ASTM D7647 >2500	<b>85</b>	53	---
Particles >14µm	ASTM D7647 >320	<b>5</b>	10	---
Particles >21µm	ASTM D7647 >80	<b>1</b>	4	---
Particles >38µm	ASTM D7647 >20	<b>0</b>	0	---
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c) >20/18/15	<b>16/14/10</b>	14/13/10	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.16	<b>0.15</b>	0.44	0.41




# OIL ANALYSIS REPORT

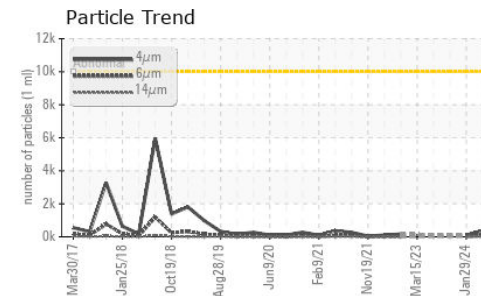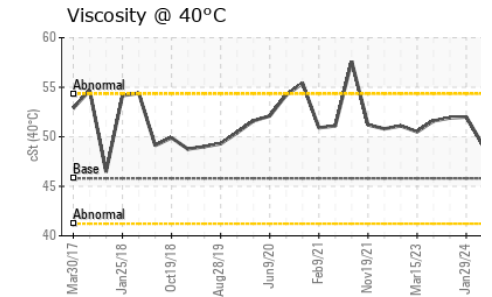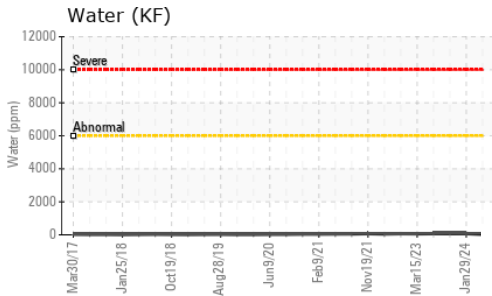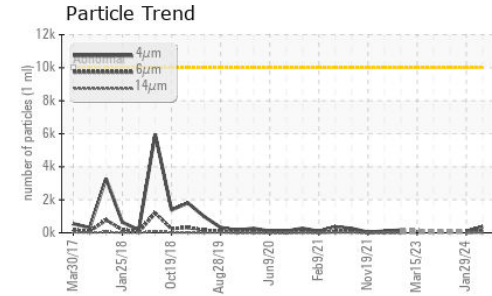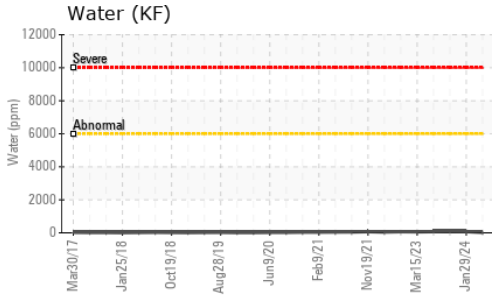






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	▲ MODER
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.8	49.2	52.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

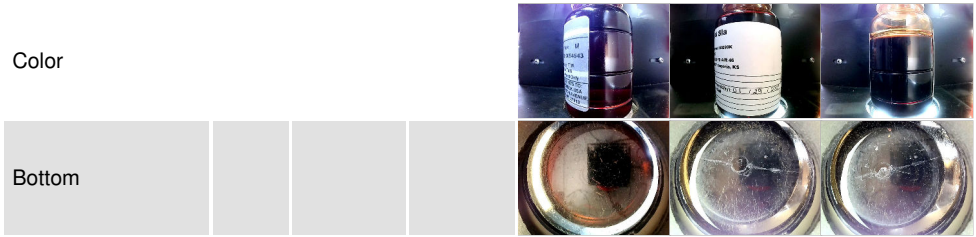

## GRAPHS

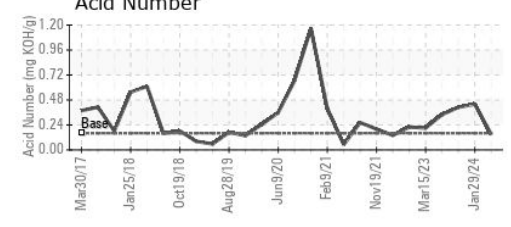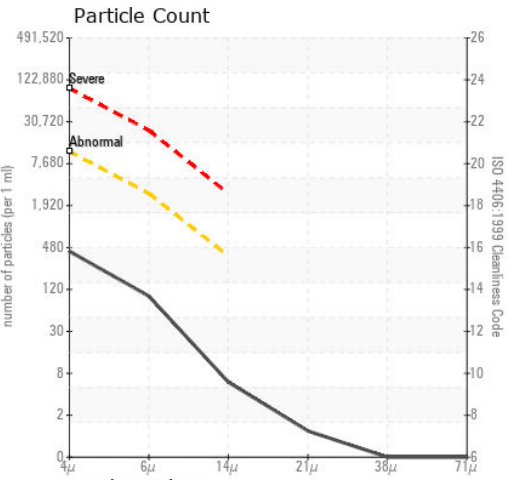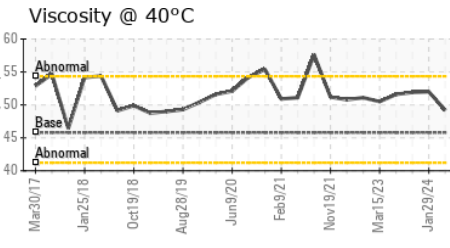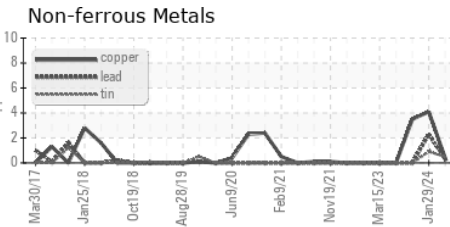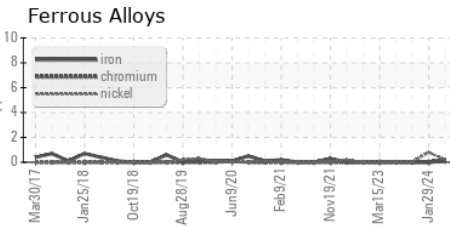

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USPM36408  
 Lab Number : 06198214  
 Unique Number : 11060337  
 Test Package : IND 2

Received : 03 Jun 2024  
 Tested : 06 Jun 2024  
 Diagnosed : 06 Jun 2024 - Doug Bogart

TYSON-Emporia-USP  
 2101 West Sixth  
 Emporia, KS  
 US 66801  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (620)343-3640

F: (620)340-1253