




OIL ANALYSIS REPORT

Sample Rating Trend

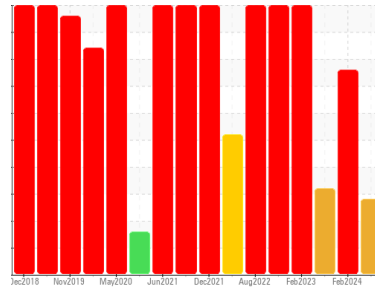

WATER



Machine Id
HOWE HOWE PO (S/N 7415)
 Component
Refrigeration Compressor
 Fluid
USPI ALT-68 SC (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

Contamination

Appearance is hazy. Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	USP0012645	USP0007510	USP248764
Sample Date	Client Info	02 Jun 2024	28 Feb 2024	13 Apr 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	SEVERE	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >8	<1	▲ 320	▲ 49
Chromium ppm	ASTM D5185m >2	<1	<1	0
Nickel ppm	ASTM D5185m	<1	<1	0
Titanium ppm	ASTM D5185m	<1	0	0
Silver ppm	ASTM D5185m >2	0	0	0
Aluminum ppm	ASTM D5185m >3	1	<1	<1
Lead ppm	ASTM D5185m >2	<1	<1	0
Copper ppm	ASTM D5185m >8	<1	11	<1
Tin ppm	ASTM D5185m >4	<1	7	<1
Vanadium ppm	ASTM D5185m	<1	0	0
Cadmium ppm	ASTM D5185m	<1	<1	0

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m	0	0	0
Barium ppm	ASTM D5185m	0	0	0
Molybdenum ppm	ASTM D5185m	<1	0	0
Manganese ppm	ASTM D5185m	0	0	<1
Magnesium ppm	ASTM D5185m	<1	<1	<1
Calcium ppm	ASTM D5185m	0	0	0
Phosphorus ppm	ASTM D5185m	0	0	0
Zinc ppm	ASTM D5185m	0	2	0
Sulfur ppm	ASTM D5185m 50	0	0	0

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >15	<1	5	1
Sodium ppm	ASTM D5185m	3	<1	0
Potassium ppm	ASTM D5185m >20	2	<1	0
Water %	ASTM D6304 >0.01	▲ 0.113	0.009	0.012
ppm Water	ASTM D6304 >100	▲ 1138	96	121.0

FLUID CLEANLINESS




method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	---	559389	236375
Particles >6µm	ASTM D7647 >2500	---	▲ 478921	▲ 196566
Particles >14µm	ASTM D7647 >320	---	▲ 107729	▲ 32025
Particles >21µm	ASTM D7647 >80	---	▲ 4797	▲ 1152
Particles >38µm	ASTM D7647 >20	---	0	0
Particles >71µm	ASTM D7647 >4	---	0	0
Oil Cleanliness	ISO 4406 (c) >--/18/15	---	▲ 26/26/24	▲ 25/25/22

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D974 0.005	0.014	0.041	0.015




OIL ANALYSIS REPORT

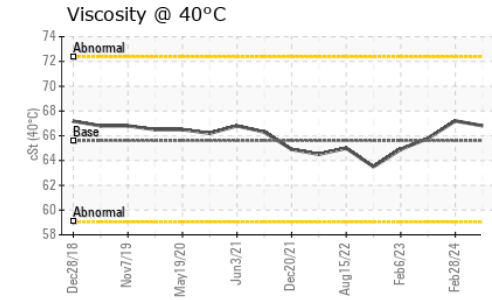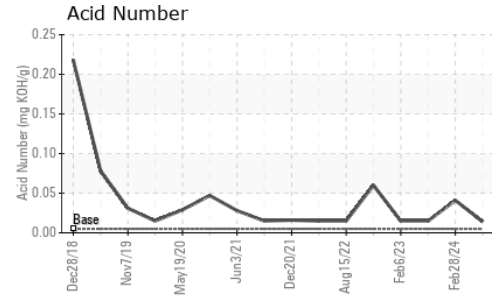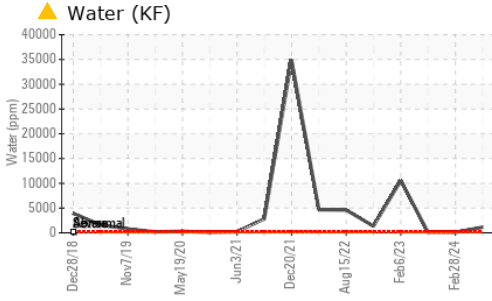





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	▲ MODER	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	● HAZY	NORML	● HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.6	66.8	67.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

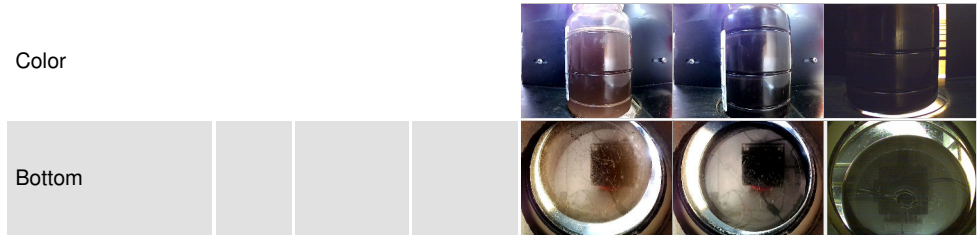

GRAPHS

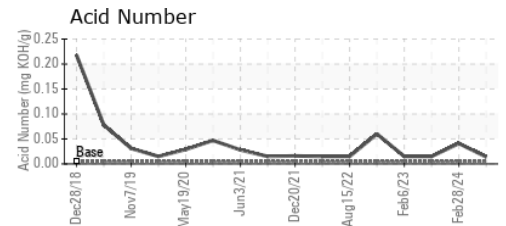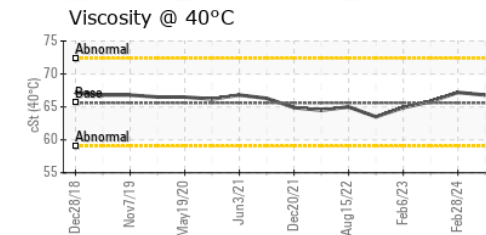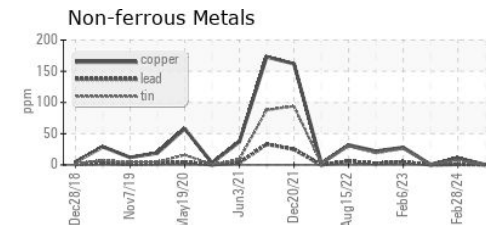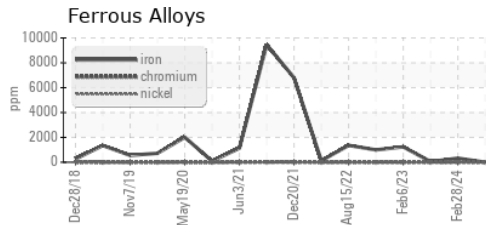

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : USP0012645
 Lab Number : 06198269
 Unique Number : 11060392
 Test Package : IND 2

Received : 03 Jun 2024
 Tested : 06 Jun 2024
 Diagnosed : 06 Jun 2024 - Doug Bogart

TYSON CM - FOREST - USP
 FOREST, MS
 US
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: