

### **OIL ANALYSIS REPORT**

#### NORMAL

Machine Id

# MYCOM TYSDAR 9 (S/N 559-35)

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

<b>11</b>															
- T															
nni i															
						1.1									
				Li.											
				1		111									
									111						
av/20	23 Ma	Jan20	2021	Mar	Jan2020	2018	Dec	Jun2017	2016	Janž	2014	Sep	2013	5 Se	5


SAMPLE INFORM	NATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0012650	USP0007687	USP0000138
Sample Date		Client Info		28 May 2024	20 Feb 2024	01 Sep 2023
Machine Age	hrs	Client Info		41166	38841	34713
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<1	0	<1
Chromium	ppm	ASTM D5185m	>2	<1	0	0
Nickel	ppm	ASTM D5185m		<1	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	1	1	0
Lead	ppm	ASTM D5185m	>2	<1	<1	0
Copper	ppm	ASTM D5185m	>8	<1	<1	0
Tin	ppm	ASTM D5185m	>4	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		0	<1	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	1
Zinc	ppm	ASTM D5185m		<1	0	0
Sulfur	ppm	ASTM D5185m	50	0	4	4
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	1	1	1
Sodium	ppm	ASTM D5185m		0	0	1
Potassium	ppm	ASTM D5185m	>20	<1	1	1
Water	%	ASTM D6304	>0.01	0.006	0.004	0.003
ppm Water	ppm	ASTM D6304	>100	64	49	35.2
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	866	1282	1615
Particles >6µm		ASTM D7647	>2500	244	382	608
Particles >14µm		ASTM D7647	>320	18	9	34
Particles >21µm		ASTM D7647	>80	5	2	5
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	17/15/11	17/16/10	18/16/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.015	0.01


Contact/Location: SERVICE MANAGER - TYSDAR Page 1 of 2





## **OIL ANALYSIS REPORT**

scalar










Sen





NONE


\*Visual

NONE

NONE

NONE

Bottom

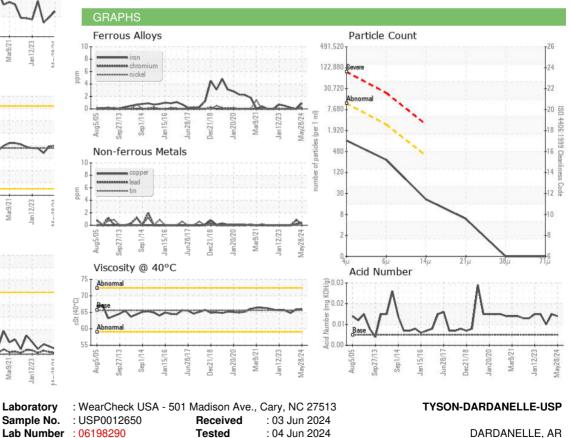

: 06 Jun 2024 - Doug Bogart



Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

Unique Number : 11060413

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnosed

Report Id: TYSDAR [WUSCAR] 06198290 (Generated: 06/07/2024 22:23:56) Rev: 1

Contact/Location: SERVICE MANAGER - TYSDAR

Contact: SERVICE MANAGER

US

T:

F: