




# OIL ANALYSIS REPORT

Sample Rating Trend

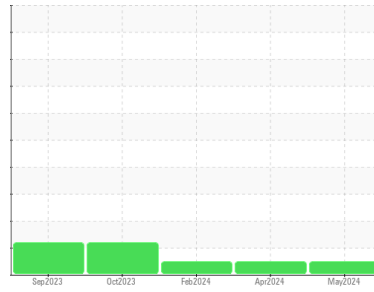

**NORMAL**



Machine Id

**YVONNE S**

Component

**Port Genset**

Fluid

**CHEVRON DELO 400 MULTIGRADE 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0922390</b>	WC0759609	WC0759612
Sample Date	Client Info		<b>10 May 2024</b>	01 Apr 2024	23 Feb 2024
Machine Age	hrs	Client Info	<b>3177</b>	2736	2308
Oil Age	hrs	Client Info	<b>500</b>	500	500
Oil Changed	Client Info		<b>Changed</b>	Changed	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>5</b>	8	10
Chromium	ppm	ASTM D5185m >4	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m >2	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m	<b>6</b>	7	3
Silver	ppm	ASTM D5185m >5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >12	<b>2</b>	2	3
Lead	ppm	ASTM D5185m >17	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185m >70	<b>5</b>	10	41
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 151	<b>149</b>	206	232
Barium	ppm	ASTM D5185m 0.4	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 250	<b>70</b>	79	89
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m 0	<b>567</b>	578	453
Calcium	ppm	ASTM D5185m 2046	<b>1713</b>	1906	2051
Phosphorus	ppm	ASTM D5185m 1043	<b>704</b>	825	733
Zinc	ppm	ASTM D5185m 943	<b>830</b>	922	921
Sulfur	ppm	ASTM D5185m 5012	<b>3231</b>	3300	2769

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>7</b>	8	10
Sodium	ppm	ASTM D5185m	<b>2</b>	<1	2
Potassium	ppm	ASTM D5185m >20	<b>2</b>	3	2

## INFRA-RED




	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0.2</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	<b>9.5</b>	9.0	9.4
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>20.8</b>	20.3	21.7

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>16.5</b>	15.6	17.3
Base Number (BN)	mg KOH/g	ASTM D2896 12.5	<b>6.8</b>	7.1	6.6







# OIL ANALYSIS REPORT

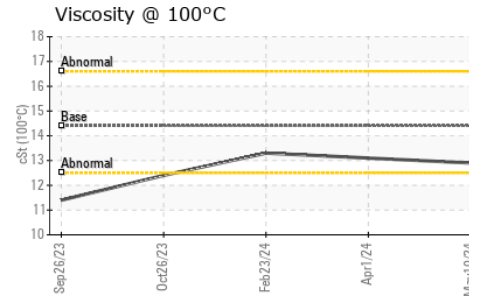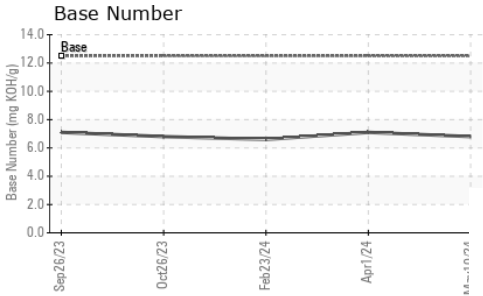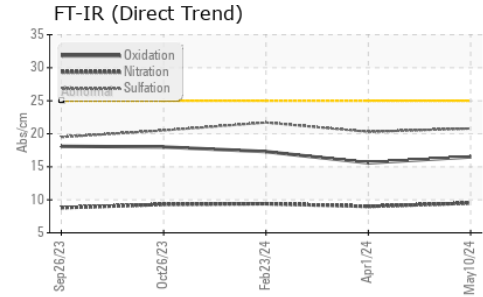

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	<b>12.9</b>	13.1	13.3

## GRAPHS

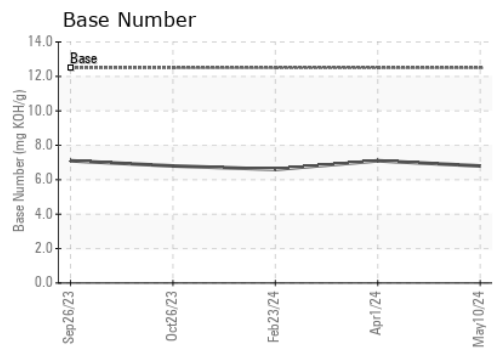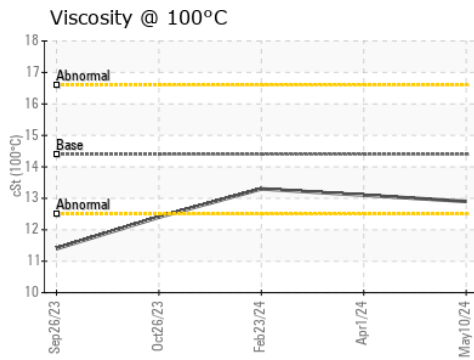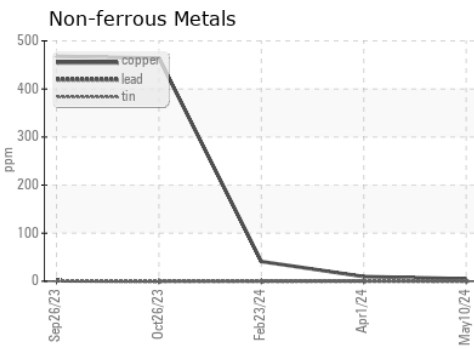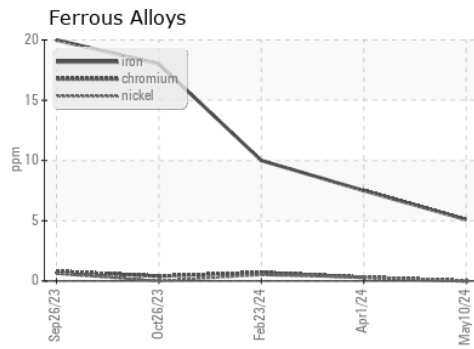

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0922390      **Received** : 03 Jun 2024  
**Lab Number** : **06198619**      **Tested** : 04 Jun 2024  
**Unique Number** : 11060742      **Diagnosed** : 04 Jun 2024 - Wes Davis  
**Test Package** : FLEET

**ASSOCIATED TERMINALS - CRANE**  
 CONVENT, LA  
 US 70723  
 Contact: GREG JOSEY  
 gjosey@associatedterminals.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)      F: (225)562-3515