


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 

Machine Id

# KAESER 7404958 (S/N 1573)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Apr2022 Apr2023 Мэг2024				
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017892	KCP52581	KCP44970
Sample Date		Client Info		29 May 2024	27 Apr 2023	04 Apr 2022
Machine Age	hrs	Client Info		10720	7186	3444
Oil Age	hrs	Client Info		0	3000	3000
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	3	0	<1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	10	9	10
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	2	0	17
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	0	2	9
Zinc	ppm	ASTM D5185m	0	0	0	8
Sulfur	ppm	ASTM D5185m	23500	22265	24475	15927
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		0	0	4
Potassium	ppm	ASTM D5185m	>20	2	<1	0
Water	%	ASTM D6304	>0.05	0.009	0.003	0.012
ppm Water	ppm	ASTM D6304	>500	98	37.0	127.4
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3608	3917	
Particles >6µm		ASTM D7647	>1300	849	1571	
Particles >14µm		ASTM D7647	>80	78	<b>127</b>	
Particles >21µm		ASTM D7647	>20	28	<b>44</b>	
Particles >38μm		ASTM D7647	>4	3	3	
Particles >71µm		ASTM D7647	>3	1	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13	19/18/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.40	0.42	0.35



## **OIL ANALYSIS REPORT**

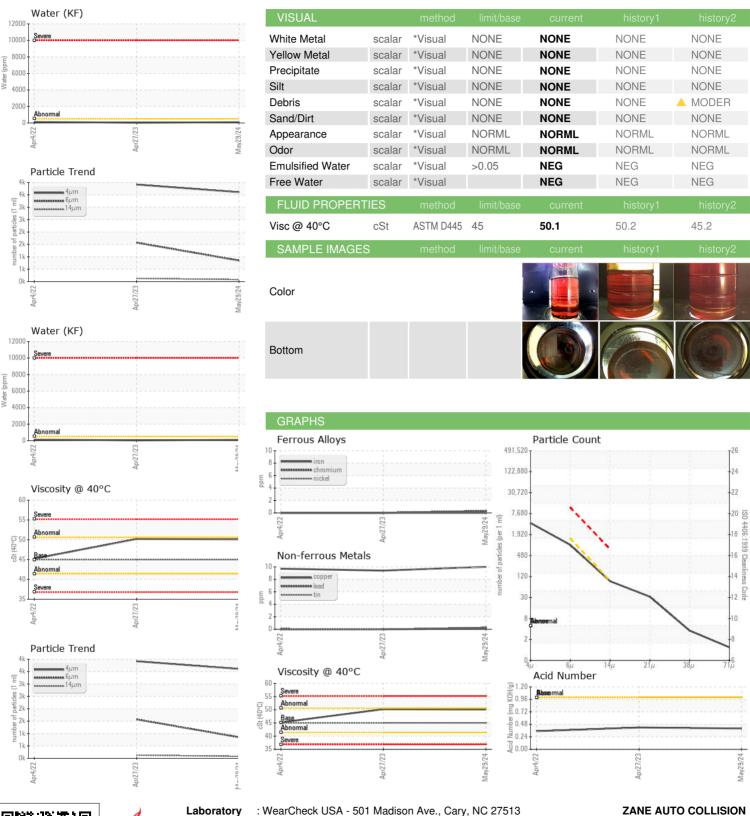





Certificate 12367

Laboratory

Sample No. Lab Number

: 06199127

: KCPA017892 Unique Number : 11061250

Received : 04 Jun 2024 **Tested** : 05 Jun 2024 : 06 Jun 2024 - Don Baldridge

Diagnosed Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.  $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

zaneauto@gmail.com Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: ZANNEW [WUSCAR] 06199127 (Generated: 06/06/2024 11:24:38) Rev: 1

Contact/Location: ZANE AUTO ? - ZANNEW

7777 ENTERPRISE DR

Contact: ZANE AUTO

NEWARK, CA

US 94568

T:

F: