

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER DS 140 1142052 (S/N 142205)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Ap	2020	May2021 May20	24	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017831	KCP33434	KCP26829
Sample Date		Client Info		28 May 2024	06 May 2021	02 Apr 2020
Machine Age	hrs	Client Info		125429	120039	113841
Oil Age	hrs	Client Info		0	0	400
Oil Changed		Client Info		Not Changd	Changed	Not Changd
Sample Status				ATTENTION	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	2
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	3	<1	<1
Lead	ppm	ASTM D5185m	>10	<1	0	<1
Copper	ppm	ASTM D5185m	>50	2	<1	7
Tin	ppm	ASTM D5185m	>10	<1	<1	<1
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	10	<1
Barium	ppm	ASTM D5185m	90	0	24	38
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	3	36	33
Calcium	ppm	ASTM D5185m	2	0	0	2
Phosphorus	ppm	ASTM D5185m		0	0	4
Zinc	ppm	ASTM D5185m		0	0	7
Sulfur	ppm	ASTM D5185m		19645	15020	21103
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	1
Sodium	ppm	ASTM D5185m		0	4	<1
Potassium	ppm	ASTM D5185m	>20	2	0	0
Water	%	ASTM D6304	>0.05	0.008	0.023	△ 0.243
ppm Water	ppm	ASTM D6304	>500	81	231.0	<u>^</u> 2430
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		11587	10089	
Particles >6µm		ASTM D7647	>1300	<u>2466</u>	<u>▲</u> 3641	
Particles >14μm		ASTM D7647	>80	134	▲ 463	
Particles >21µm		ASTM D7647	>20	9 34	<u>▲</u> 151	
Particles >38µm		ASTM D7647	>4	0	<u>^</u> 7	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	2 1/18/14	<u>19/16</u>	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

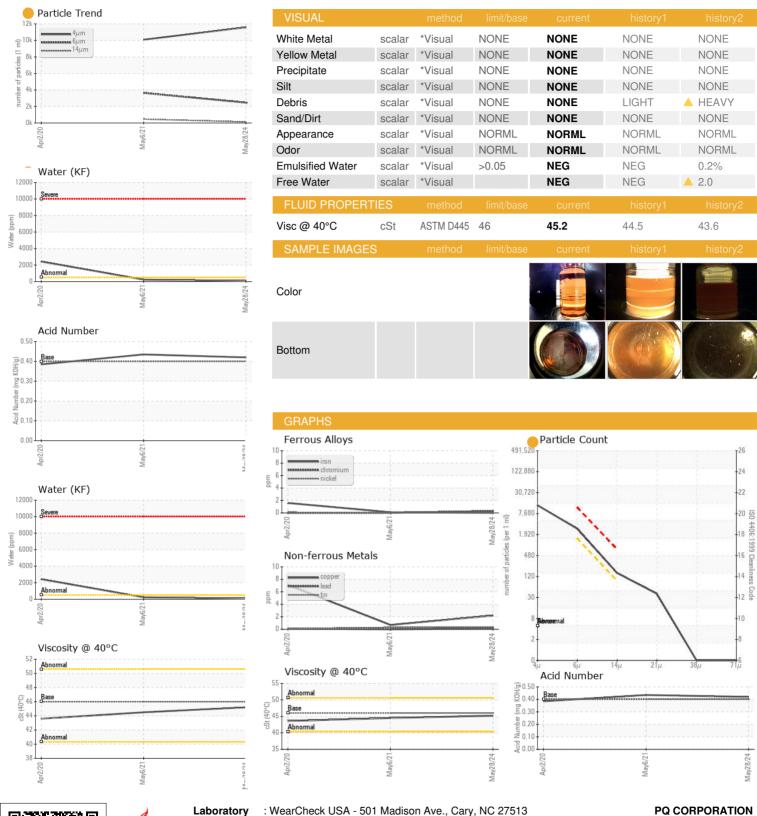





Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA017831 : 06199131 Unique Number : 11061254

Received **Tested** Diagnosed

: 06 Jun 2024 - Don Baldridge Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

1201 FRONT ST CHESTER, PA US 19013

Contact: CLIFF WILBERT

CLIFF.WILBERT@PQCORP.COM T:

Contact/Location: CLIFF WILBERT - PQCCHE

: 04 Jun 2024

: 05 Jun 2024

F: