

OIL ANALYSIS REPORT

Sample Rating Trend ISO

Machine Id

8284890 (S/N NOT GIVEN)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018054		
Sample Date		Client Info		30 May 2024		
Machine Age	hrs	Client Info		3991		
Oil Age	hrs	Client Info		3991		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		mothod	limit/base	ou want	hiotomul	history
WEAR METALS		method	iimit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	3		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	9		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVEO	• •		11 11 11		111	1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	13		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	50		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	13		
Sulfur	ppm	ASTM D5185m	23500	21203		
CONTAMINANTS		method	limit/base	current	history1	history2
			IIIIIIIIIIIIIII	Current	HISTOLAL	HISTOLYZ
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		11		
Potassium	ppm	ASTM D5185m	>20	21		
Water	%	ASTM D6304	>0.05	0.013		
ppm Water	ppm	ASTM D6304	>500	133		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	1000	10678		
Particles >6µm		ASTM D7647	>1300	<u>^</u> 2930		
Particles >14µm		ASTM D7647	>80	▲ 99		
Particles >21µm		ASTM D7647	>20	16		
Particles >38µm		ASTM D7647	>4	3		
Particles >71μm		ASTM D7647	>3	2		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/19/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.33		
ACIO INUITIDEI (AIN)	iliy NOD/ÿ	79 LINI D0043	1.0	0.33		



OIL ANALYSIS REPORT

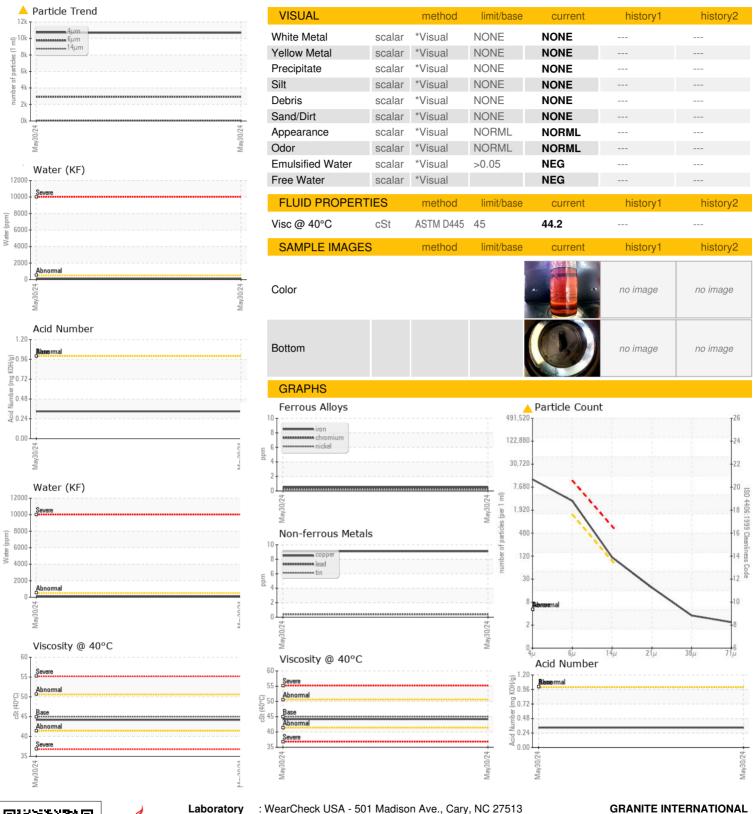





Certificate 12367

Laboratory Sample No.

Lab Number : 06199138

: KCPA018054 Unique Number : 11061261

Received : 04 Jun 2024 **Tested** : 05 Jun 2024 Diagnosed

Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 06 Jun 2024 - Don Baldridge

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - GRACIC

CICERO, NY

US 13039

T:

F:

8141 BREWERTON RD