




# OIL ANALYSIS REPORT

## Sample Rating Trend

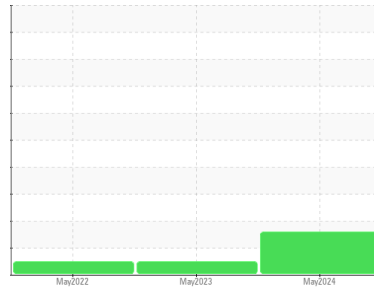

ISO



Machine Id  
**5704965 (S/N 2800)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

### DIAGNOSIS

#### ▲ Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### ▲ Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA016690</b>	KCP53638	KCP50941
Sample Date	Client Info			<b>16 May 2024</b>	14 May 2023	31 May 2022
Machine Age	hrs	Client Info		<b>66623</b>	57961	49904
Oil Age	hrs	Client Info		<b>8662</b>	8057	8033
Oil Changed	Client Info			<b>Changed</b>	Changed	Changed
Sample Status				<b>ABNORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m	>10	<b>3</b>	<1	<1
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Copper	ppm	ASTM D5185m	>50	<b>6</b>	6	5
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	90	<b>1</b>	10	0
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	0	5
Zinc	ppm	ASTM D5185m		<b>0</b>	4	0
Sulfur	ppm	ASTM D5185m		<b>19153</b>	19811	13866

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>0</b>	1	0
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	<1	<1
Water	%	ASTM D6304	>0.05	<b>0.00</b>	0.003	0.002
ppm Water	ppm	ASTM D6304	>500	<b>0</b>	33.7	18.2

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>18639</b>	284	1175
Particles >6µm		ASTM D7647	>1300	▲ <b>4122</b>	112	268
Particles >14µm		ASTM D7647	>80	▲ <b>205</b>	11	31
Particles >21µm		ASTM D7647	>20	▲ <b>62</b>	4	13
Particles >38µm		ASTM D7647	>4	<b>4</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>1</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ <b>21/19/15</b>	15/14/11	17/15/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.36</b>	0.33	0.34


# OIL ANALYSIS REPORT

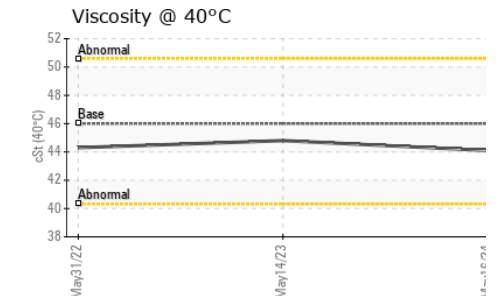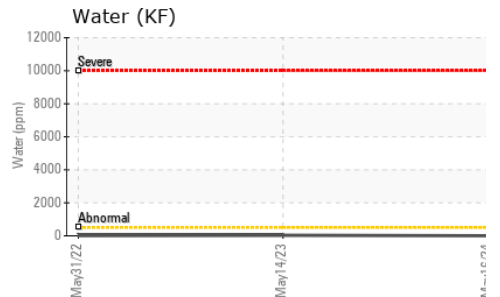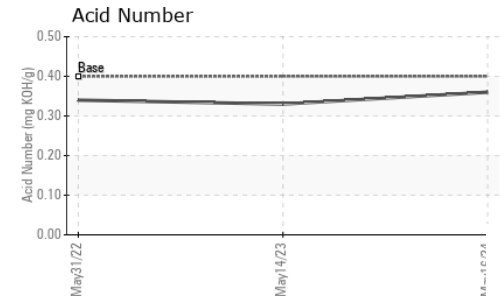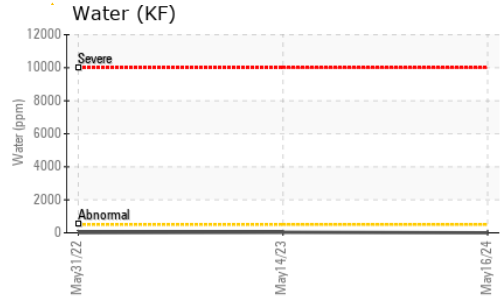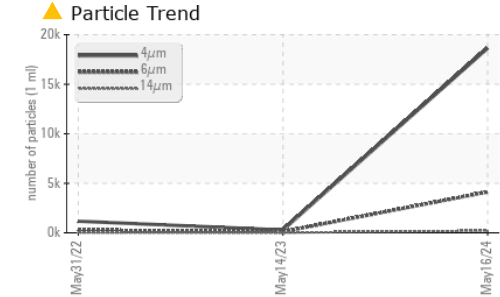





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.1	44.8	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

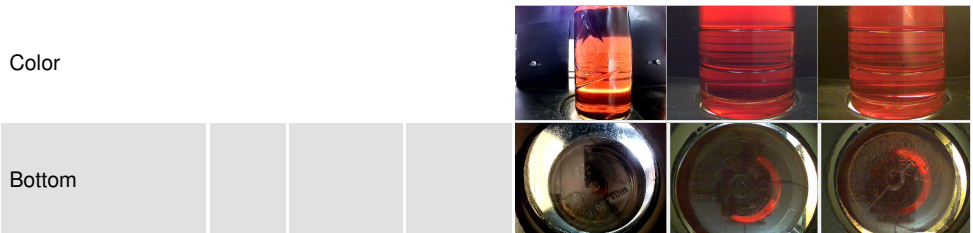

## GRAPHS

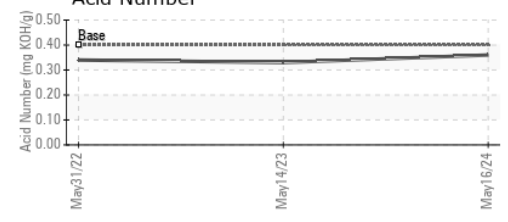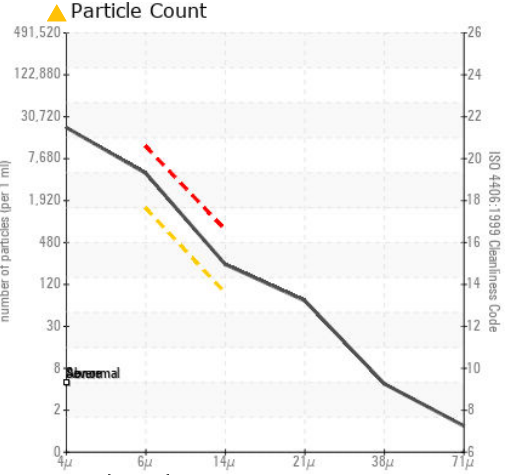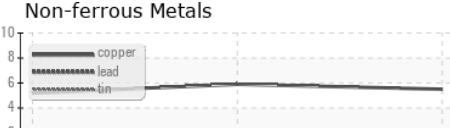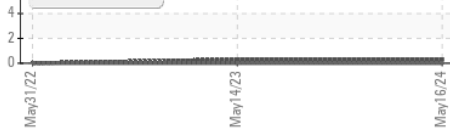

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA016690 **Received** : 04 Jun 2024  
**Lab Number** : 06199142 **Tested** : 05 Jun 2024  
**Unique Number** : 11061265 **Diagnosed** : 06 Jun 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**LIQUIBOX**  
 78 2ND AVE S  
 LESTER PRAIRIE, MN  
 US 55354  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)