

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

8361348 (S/N 1912) Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA014636		
Sample Date		Client Info		20 May 2024		
Machine Age	hrs	Client Info		1547		
Oil Age	hrs	Client Info		1547		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
					History	HISTOTYZ
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm		>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m		3		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	3		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	16		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m	_	0		
Zinc	ppm	ASTM D5185m		46		
Sulfur	ppm	ASTM D5185m		21796		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		44		
Potassium	ppm	ASTM D5185m	>20	8		
Water	%	ASTM D6304	>0.05	0.020		
ppm Water	ppm	ASTM D6304	>500	206		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		20088		
Particles >6µm		ASTM D7647	>1300	A 7895		
Particles >14μm		ASTM D7647	>80	450		
Particles >21µm		ASTM D7647	>20	<u>^</u> 61		
Particles >38µm		ASTM D7647	>4	4		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/20/16</u>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.15		



OIL ANALYSIS REPORT

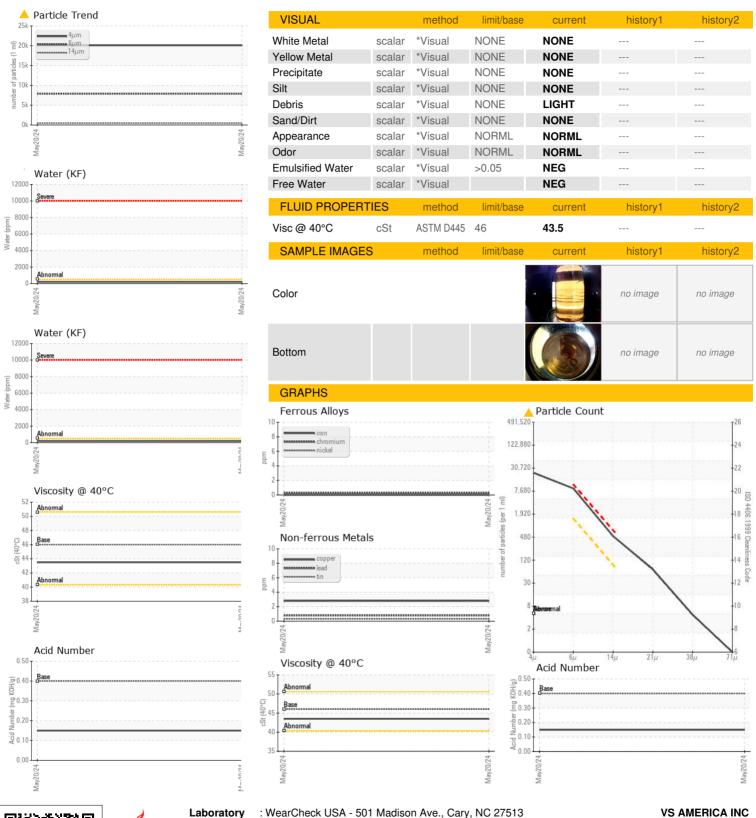





Laboratory Lab Number

Sample No.

: KCPA014636 : 06199145 Unique Number : 11061268

Received : 04 Jun 2024 **Tested** : 05 Jun 2024 Diagnosed

: 06 Jun 2024 - Don Baldridge

8810 AIR PARK WEST DR CHARLOTTE, NC

US 28214 Contact: Service Manager

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - VSACHA

T:

F: