

# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# KAESER AIRTOWER 7.5C 6400357 (S/N 1826)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Mar2020	May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017787	KCP25485	
Sample Date		Client Info		15 May 2024	20 Mar 2020	
Machine Age	hrs	Client Info		3466	1500	
Oil Age	hrs	Client Info		635	1500	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
ron	ppm	ASTM D5185m	>50	0	3	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	<1	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	3	<1	
Lead	ppm	ASTM D5185m	>10	<1	<1	
Copper	ppm	ASTM D5185m	>50	1	2	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES	Please	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	
Barium		ASTM D5185m	90	16	9	
Molybdenum	ppm	ASTM D5185m	0	0	0	
,	ppm	ASTM D5185m	U	0	<1	
Manganese	ppm		100	57		
Magnesium	ppm	ASTM D5185m	100		55	
Calcium	ppm	ASTM D5185m	0	0	1	
Phosphorus 	ppm	ASTM D5185m	0	0	4	
Zinc	ppm	ASTM D5185m	0	4	6	
Sulfur	ppm	ASTM D5185m	23500	21589	13305	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	2	
Sodium	ppm	ASTM D5185m		19	14	
Potassium	ppm	ASTM D5185m	>20	4	2	
Nater	%	ASTM D6304	>0.05	0.027	0.018	
opm Water	ppm	ASTM D6304	>500	279	189.8	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		2732	127806	
Particles >6µm		ASTM D7647	>1300	605	<b>48870</b>	
Particles >14μm		ASTM D7647	>80	43	<u> </u>	
Particles >21µm		ASTM D7647	>20	10	<b>△</b> 350	
Particles >38µm		ASTM D7647	>4	1	<u>^</u> 26	
Particles >71µm		ASTM D7647	>3	0	2	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/16/13	<u>\$\text{\scale}\$ 23/18</u>	

Contact/Location: Service Manager - WESWESOHKC



## **OIL ANALYSIS REPORT**

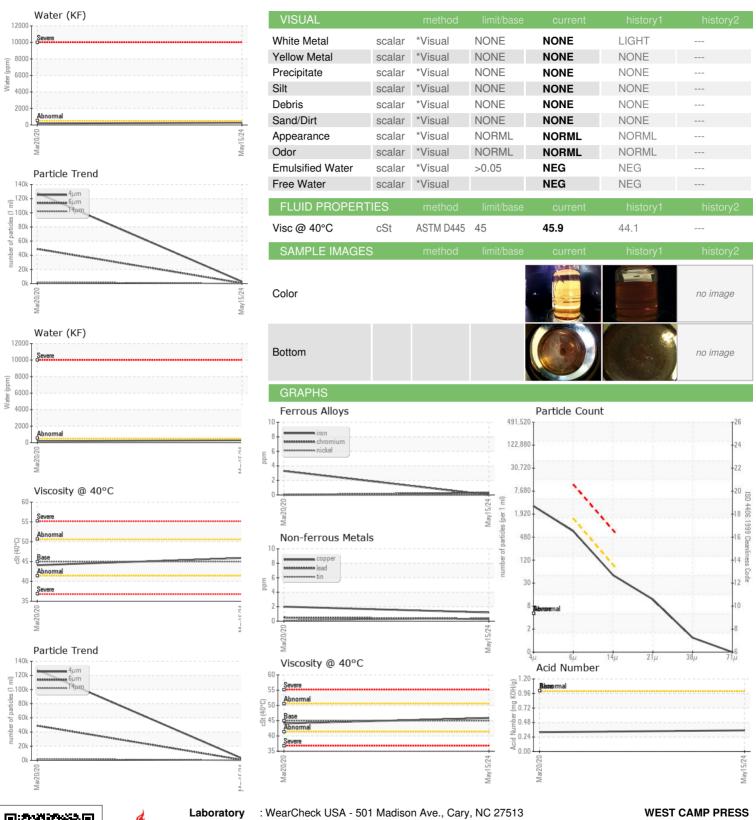





Certificate 12367

Report Id: WESWESOHKC [WUSCAR] 06199146 (Generated: 06/07/2024 07:46:26) Rev: 1

Sample No. Lab Number

: KCPA017787 : 06199146 Unique Number : 11061269

**Tested** Test Package : IND 2 ( Additional Tests: KF, PrtCount )

Received : 04 Jun 2024 : 05 Jun 2024 Diagnosed

: 06 Jun 2024 - Don Baldridge

39 COLLEGEVIEW RD WESTERVILLE, OH US 43081

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: