




OIL ANALYSIS REPORT

Sample Rating Trend

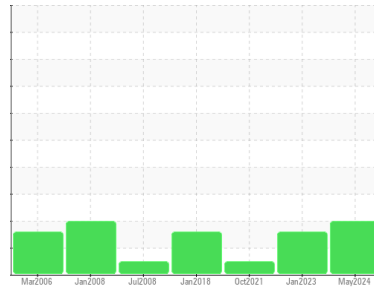

ISO



Machine Id
KAESER SK-26 2261520 (S/N 1054)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA018005	KCP52960	KCP36367
Sample Date	Client Info	24 May 2024	27 Jan 2023	12 Oct 2021
Machine Age	hrs	47136	44054	40965
Oil Age	hrs	0	4000	2298
Oil Changed	Client Info	Not Changed	Changed	Changed
Sample Status		ABNORMAL	ATTENTION	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<1	1	1
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	3	1	0
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	3	5	10
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	1
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 90	37	24	27
Calcium	ppm	ASTM D5185m 2	0	0	<1
Phosphorus	ppm	ASTM D5185m	0	4	4
Zinc	ppm	ASTM D5185m	27	38	19
Sulfur	ppm	ASTM D5185m	20045	20366	16317

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	<1
Sodium	ppm	ASTM D5185m	14	10	6
Potassium	ppm	ASTM D5185m >20	4	<1	5
Water	%	ASTM D6304 >0.05	0.018	0.009	0.014
ppm Water	ppm	ASTM D6304 >500	180	96.6	149.7






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	61806	6399	1394
Particles >6µm	ASTM D7647 >1300	▲ 23124	● 2223	336
Particles >14µm	ASTM D7647 >80	▲ 1631	● 139	27
Particles >21µm	ASTM D7647 >20	▲ 362	● 23	4
Particles >38µm	ASTM D7647 >4	▲ 13	1	0
Particles >71µm	ASTM D7647 >3	2	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 23/22/18	● 20/18/14	16/12

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.35	0.36	0.375

OIL ANALYSIS REPORT

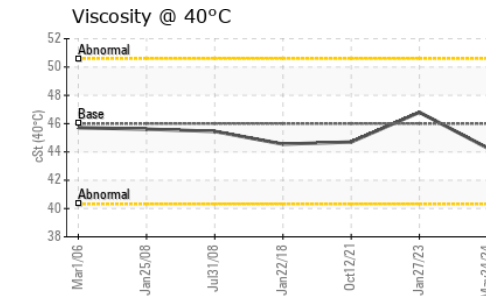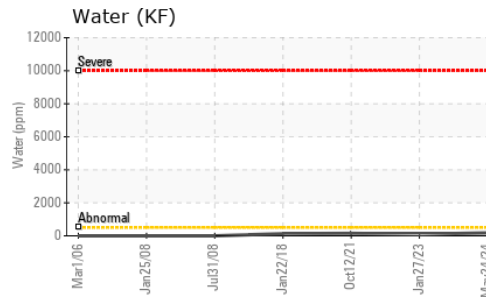
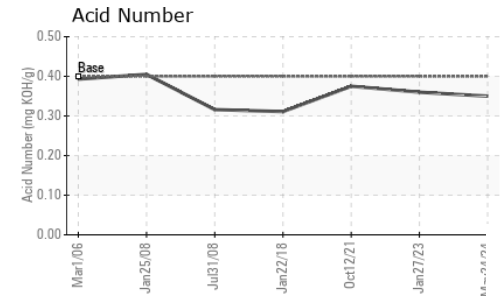
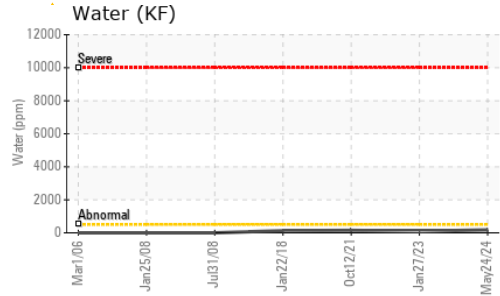
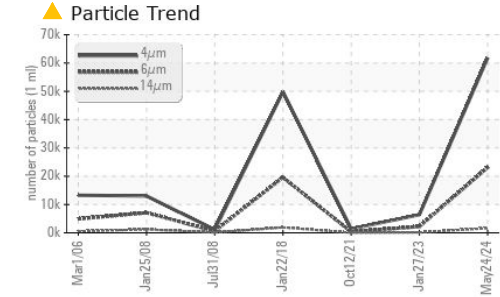


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.27	46.8	44.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

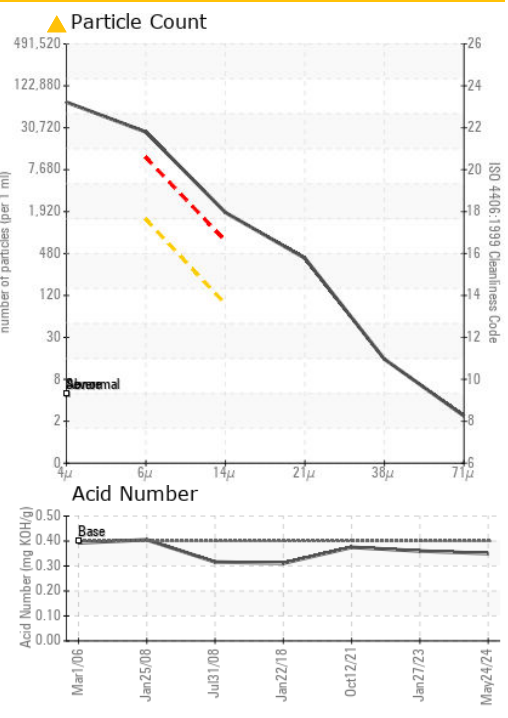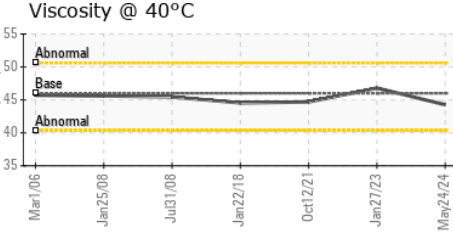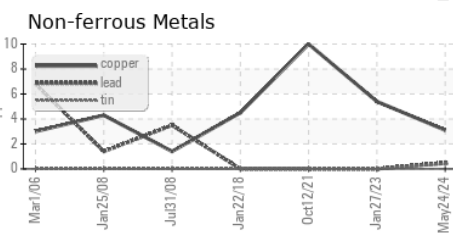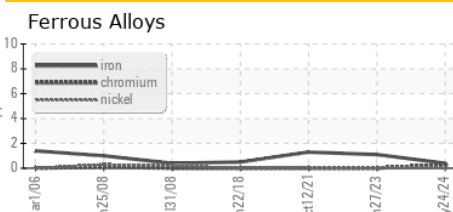

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA018005 **Received** : 04 Jun 2024
Lab Number : 06199147 **Tested** : 07 Jun 2024
Unique Number : 11061270 **Diagnosed** : 08 Jun 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

ALBION ENGINEERING
 1250 N. CHURCH RD.
 MOORESTOWN, NJ
 US 08057
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)