


# **OIL ANALYSIS REPORT**

Sample Rating Trend

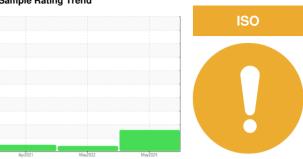

Machine Id

# KAESER SFC 200 7306199 (S/N 1364)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

#### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Ap	r2021	May2022 May20	24	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC111288	KC17302	KC17299
Sample Date		Client Info		08 May 2024	17 May 2022	14 Apr 2021
Machine Age	hrs	Client Info		32308	15149	7106
Oil Age	hrs	Client Info		6000	2388	3448
Oil Changed		Client Info		Changed	N/A	N/A
Sample Status				ATTENTION	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	3	0	0
Lead	ppm	ASTM D5185m	>10	<1	<1	0
Copper	ppm	ASTM D5185m	>50	9	2	2
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	2	7	<1
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		0	49	1
Zinc	ppm	ASTM D5185m		0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	4	1
Sodium	ppm	ASTM D5185m		0	3	<1
Potassium	ppm	ASTM D5185m	>20	2	6	20
Water	%	ASTM D6304	>0.05	0.003	0.009	0.004
ppm Water	ppm	ASTM D6304	>500	38	93.2	42.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		4121		3264
Particles >6µm		ASTM D7647	>1300	1189		672
Particles >14μm		ASTM D7647	>80	<u>130</u>		23
Particles >21µm		ASTM D7647	>20	<u>44</u>		8
Particles >38μm		ASTM D7647	>4	<u> </u>		0
Particles >71µm		ASTM D7647	>3	3		0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>19/17/14</b>		17/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.49	0.44	0.427



## **OIL ANALYSIS REPORT**

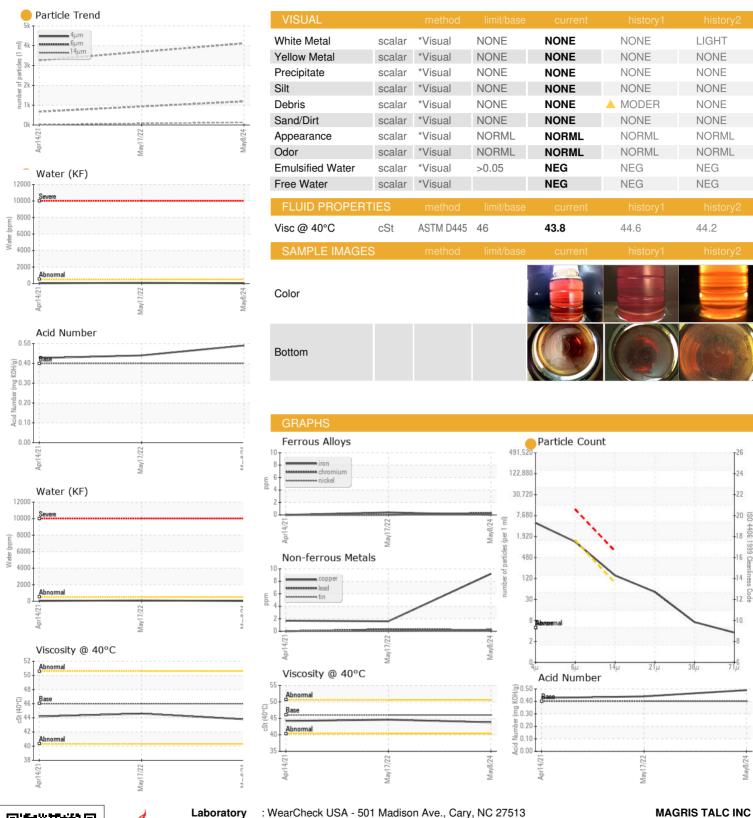





Certificate 12367

Sample No. Lab Number : 06199156 Unique Number : 11061279 Test Package : IND 2

: KC111288

Received : 04 Jun 2024 **Tested** : 05 Jun 2024 Diagnosed

: 06 Jun 2024 - Don Baldridge

797 OLD YELLOWSTONE TR THREE FORKS, MT US 59752

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: MAGTHR [WUSCAR] 06199156 (Generated: 06/07/2024 07:46:45) Rev: 1

Contact/Location: Service Manager - MAGTHR

T:

F: