




# OIL ANALYSIS REPORT

## Sample Rating Trend

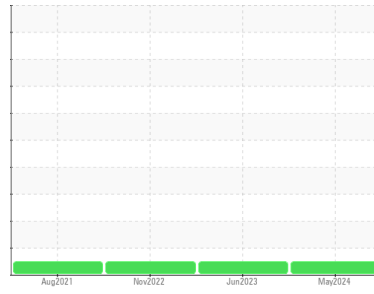

**NORMAL**



Machine Id  
**7382682 (S/N 1561)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA004791</b>	KCPA003909	KCP47958D
Sample Date	Client Info			<b>21 May 2024</b>	06 Jun 2023	09 Nov 2022
Machine Age	hrs	Client Info		<b>10267</b>	7263	5929
Oil Age	hrs	Client Info		<b>0</b>	0	3746
Oil Changed	Client Info			<b>N/A</b>	N/A	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>3</b>	<1	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>11</b>	3	6
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>1</b>	24	4
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>45</b>	76	60
Calcium	ppm	ASTM D5185m	2	<b>0</b>	2	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	4	3
Zinc	ppm	ASTM D5185m		<b>4</b>	28	3
Sulfur	ppm	ASTM D5185m		<b>22002</b>	19468	21180

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	<1
Sodium	ppm	ASTM D5185m		<b>5</b>	8	18
Potassium	ppm	ASTM D5185m	>20	<b>4</b>	3	5
Water	%	ASTM D6304	>0.05	<b>0.017</b>	0.024	0.027
ppm Water	ppm	ASTM D6304	>500	<b>176</b>	241.9	270.9

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>1231</b>	558	346
Particles >6µm		ASTM D7647	>1300	<b>291</b>	269	113
Particles >14µm		ASTM D7647	>80	<b>36</b>	20	10
Particles >21µm		ASTM D7647	>20	<b>17</b>	3	4
Particles >38µm		ASTM D7647	>4	<b>3</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>1</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>17/15/12</b>	16/15/11	16/14/10

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.34</b>	0.35	0.31


# OIL ANALYSIS REPORT

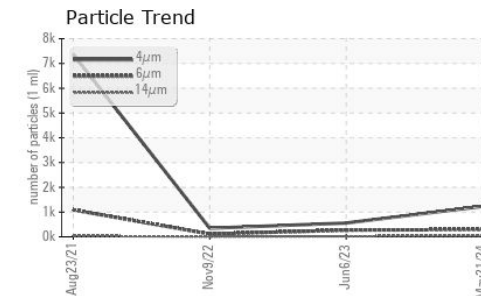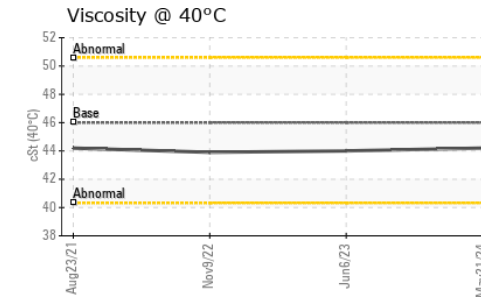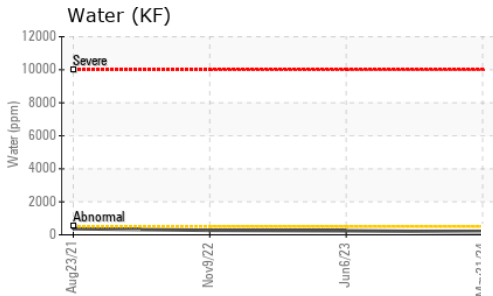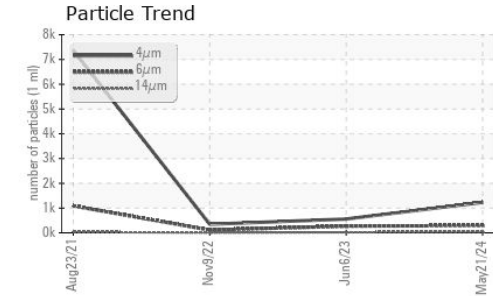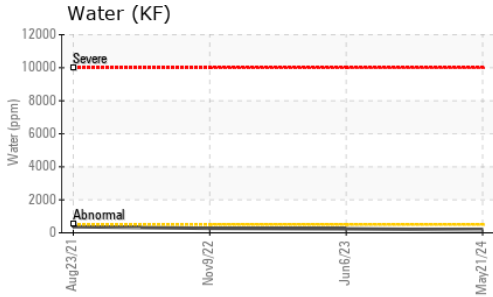






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.2	44.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

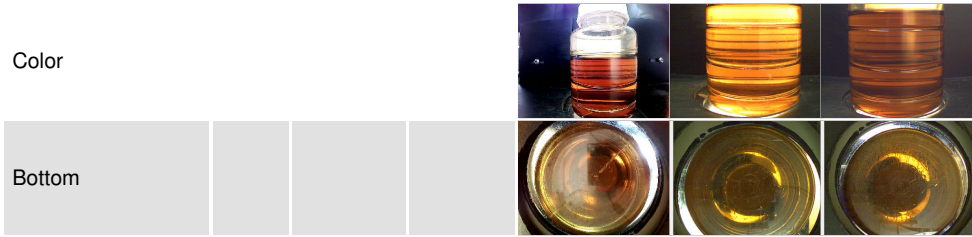

## GRAPHS

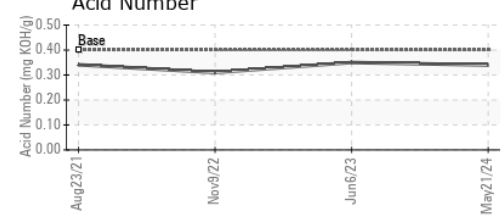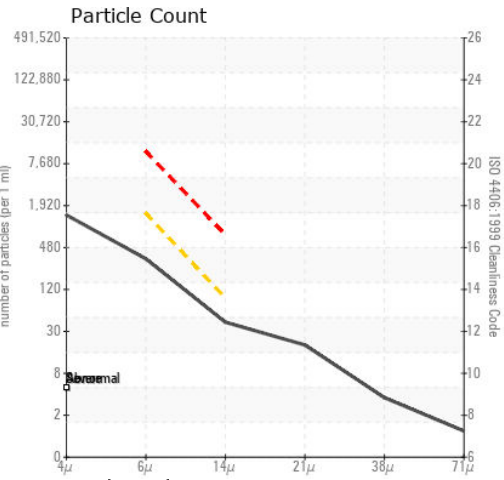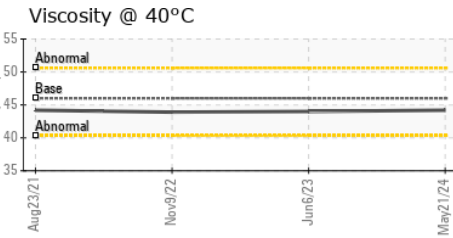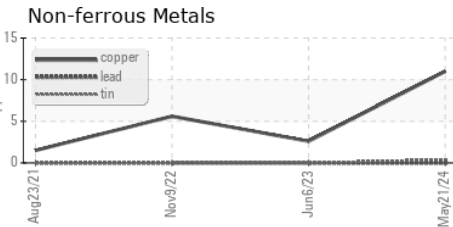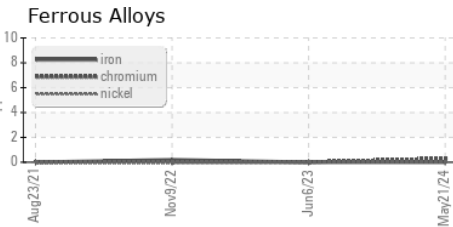

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA004791 **Received** : 04 Jun 2024  
**Lab Number** : 06199163 **Tested** : 05 Jun 2024  
**Unique Number** : 11061286 **Diagnosed** : 06 Jun 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**NGAGE MEDICAL**  
 3082 INDUSTRIAL DR W  
 HERNANDO, MS  
 US 38632  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: