


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

7378455 (S/N 1560)Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Aug202	1 Nov2022	Jun 2023 Ma	ny2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA004739	KCPA003900	KCP47969D
Sample Date		Client Info		21 May 2024	26 Jun 2023	09 Nov 2022
Machine Age	hrs	Client Info		10281	7332	5427
Oil Age	hrs	Client Info		0	0	3489
Oil Changed		Client Info		N/A	N/A	Changed
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	3	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	9	2	5
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	26	7
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	45	81	61
Calcium	ppm	ASTM D5185m	2	0	2	0
Phosphorus	ppm	ASTM D5185m		0	4	2
Zinc	ppm	ASTM D5185m		4	28	4
Sulfur	ppm	ASTM D5185m		20934	19396	20873
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		5	8	21
Potassium	ppm	ASTM D5185m	>20	3	2	4
Water	%	ASTM D6304	>0.05	0.016	0.021	0.027
ppm Water	ppm	ASTM D6304	>500	163	215.3	273.0
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		680	4903	591
Particles >6µm		ASTM D7647	>1300	113	<u>1899</u>	108
Particles >14μm		ASTM D7647	>80	21	<u>▲</u> 182	7
Particles >21µm		ASTM D7647	>20	11	△ 37	2
Particles >38µm		ASTM D7647	>4	2	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/14/12	▲ 19/18/15	16/14/10
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

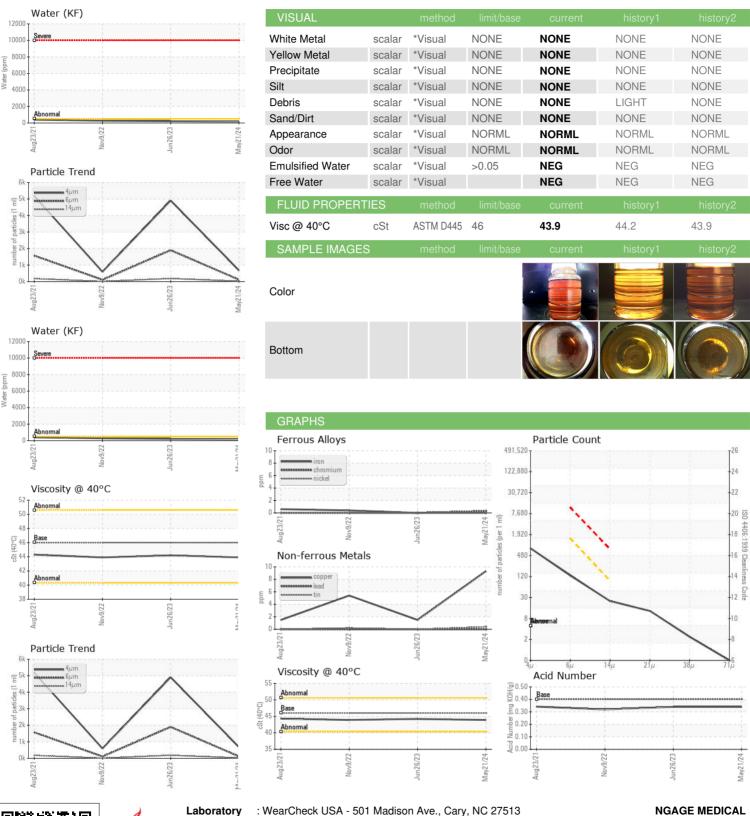





Laboratory Sample No.

Lab Number

: 06199164 Unique Number: 11061287

: KCPA004739

Received **Tested**

Diagnosed

: 05 Jun 2024

: 04 Jun 2024

: 06 Jun 2024 - Don Baldridge

3082 INDUSTRIAL DR W HERNANDO, MS

US 38632 Contact: Service Manager

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) T:

F: