




OIL ANALYSIS REPORT

Sample Rating Trend

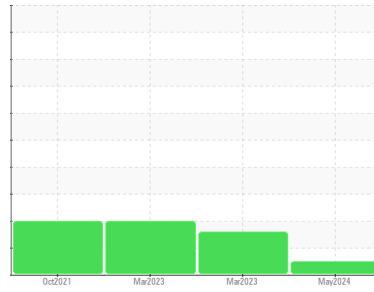

NORMAL



Machine Id
7417325 (S/N 1005)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC06199174	KC100593	KC89664
Sample Date	Client Info			30 May 2024	22 Mar 2023	08 Mar 2023
Machine Age	hrs	Client Info		7992	4003	3946
Oil Age	hrs	Client Info		0	0	5628
Oil Changed	Client Info			N/A	Changed	Not Chngd
Sample Status				NORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	1	1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	3	3	3
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	2	5	5
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Antimony	ppm	ASTM D5185m		---	---	---
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	0	2	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	100	32	28	29
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	0	9	<1
Zinc	ppm	ASTM D5185m	0	28	68	58

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	2
Sodium	ppm	ASTM D5185m		8	8	9
Potassium	ppm	ASTM D5185m	>20	5	6	4
Water	%	ASTM D6304	>0.05	0.010	0.012	0.011
ppm Water	ppm	ASTM D6304	>500	102	128.5	119.9

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2869	44709	48234
Particles >6µm		ASTM D7647	>1300	695	▲ 18431	▲ 23372
Particles >14µm		ASTM D7647	>80	65	▲ 1181	▲ 3561
Particles >21µm		ASTM D7647	>20	23	▲ 123	▲ 821
Particles >38µm		ASTM D7647	>4	4	2	▲ 44
Particles >71µm		ASTM D7647	>3	2	0	1
Oil Cleanliness		ISO 4406 (c)	>--/17/13	19/17/13	▲ 23/21/17	▲ 23/22/19

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.41	0.38	0.40


OIL ANALYSIS REPORT

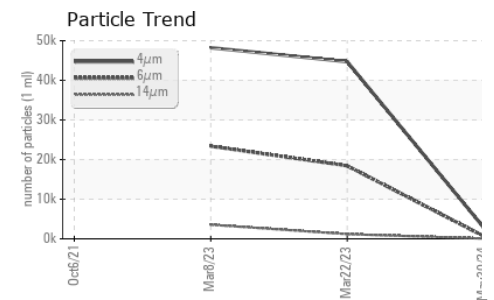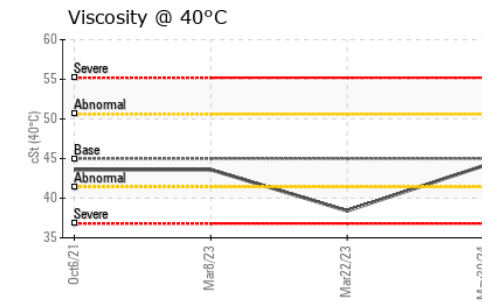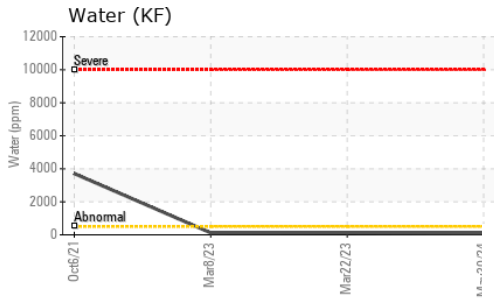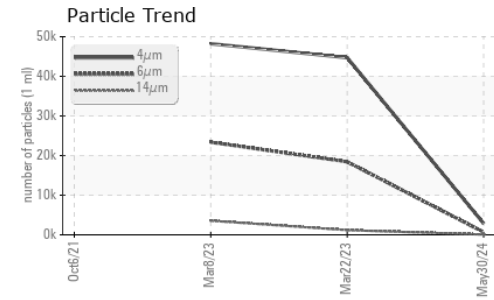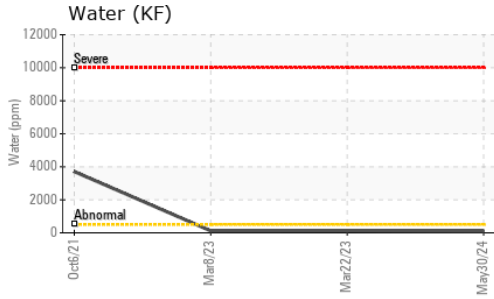






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	44.1	38.4	43.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

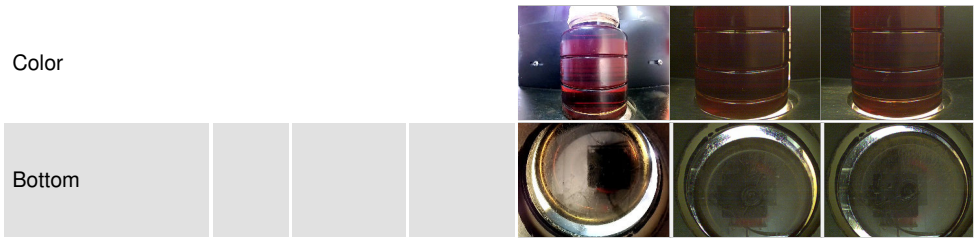

GRAPHS

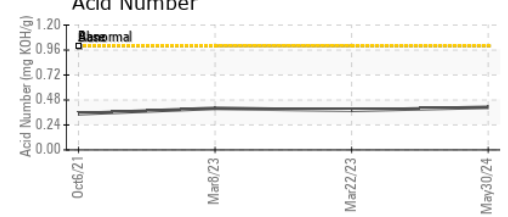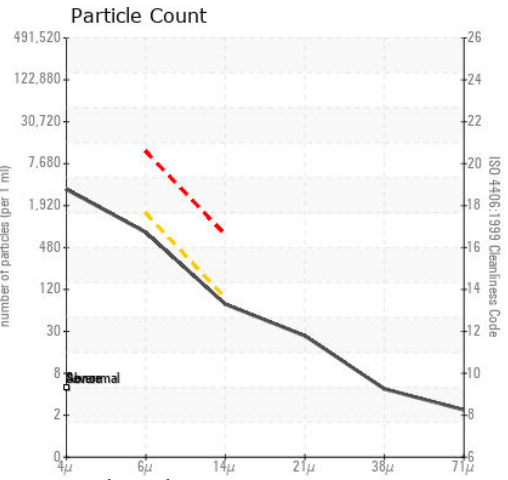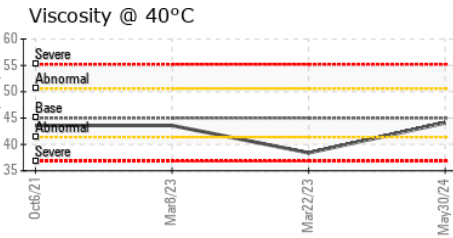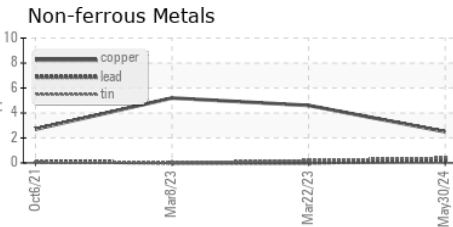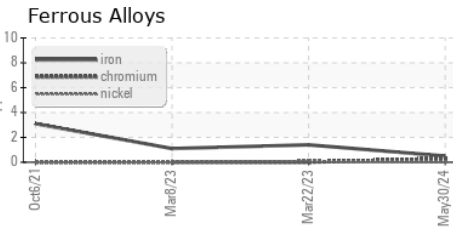

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC06199174
Lab Number : 06199174
Unique Number : 11061297
Test Package : IND 2
Received : 04 Jun 2024
Tested : 05 Jun 2024
Diagnosed : 06 Jun 2024 - Don Baldrige

MCLAUGHLIN SERVICES
 1316 E ALBION ST
 AVILLA, IN
 US 46710
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)