


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

7013039 (S/N 2435)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jun202	1 May2022	May2023 Ma	y2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018076	KCPA001910	KCP50804
Sample Date		Client Info		13 May 2024	30 May 2023	26 May 2022
Machine Age	hrs	Client Info		26692	21813	16476
Oil Age	hrs	Client Info		4879	0	5360
Oil Changed		Client Info		Changed	N/A	Changed
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	3	0	<1
Lead	ppm	ASTM D5185m	>10	<1	0	2
Copper	ppm	ASTM D5185m	>50	2	1	1
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	1
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	63	53	50
Calcium	ppm	ASTM D5185m	2	0	0	<1
Phosphorus	ppm	ASTM D5185m		0	<1	9
Zinc	ppm	ASTM D5185m		8	4	1
Sulfur	ppm	ASTM D5185m		27343	23084	18073
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		25	12	14
Potassium	ppm	ASTM D5185m	>20	4	1	0
Water	%	ASTM D6304	>0.05	0.024	0.015	0.011
ppm Water	ppm	ASTM D6304	>500	247	155.4	110.4
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1193	6004	1309
Particles >6µm		ASTM D7647	>1300	297	<u>^</u> 2672	408
Particles >14µm		ASTM D7647	>80	36	△ 392	27
Particles >21µm		ASTM D7647	>20	17	△ 56	8
Particles >38µm		ASTM D7647	>4	3	2	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/12	2 0/19/16	18/16/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

0.32



OIL ANALYSIS REPORT

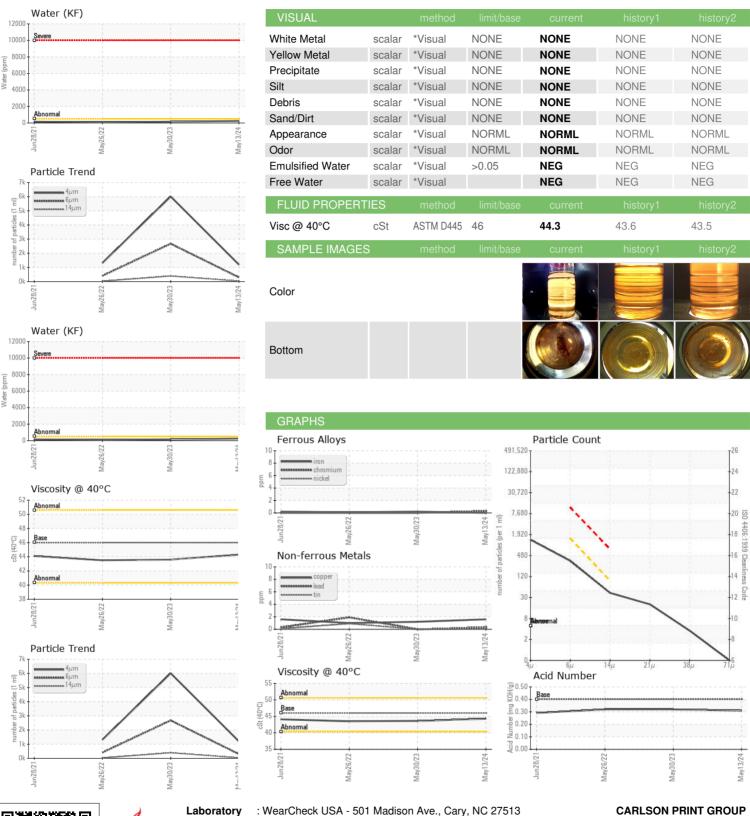





Sample No.

Lab Number

: KCPA018076 : 06199185 Unique Number : 11061308

Received **Tested** Diagnosed

: 04 Jun 2024 : 05 Jun 2024

: 06 Jun 2024 - Don Baldridge

7490 GOLDEN TRIANGLE DR EDEN PRAIRIE, MN US 55344

Contact: Service Manager

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) T:

F: