


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER BSD 60 4435304 (S/N 1084)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Oct016 Nov2017 Oct018 May/2019 Oct021 Oct021 Apr0222 Apr2023 Apr2023 Apr2023 Apr2024							
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2	
Sample Number		Client Info		KCP26740	KCPA003522	KCP52073	
Sample Date		Client Info		01 Apr 2024	30 Aug 2023	18 Apr 2023	
Machine Age	hrs	Client Info		39918	38525	0	
Oil Age	hrs	Client Info		4634	0	0	
Oil Changed		Client Info		Not Changd	N/A	Changed	
Sample Status				NORMAL	ABNORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	0	0	0	
Chromium	ppm	ASTM D5185m	>10	<1	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	0	
Aluminum	ppm	ASTM D5185m	>10	3	0	0	
Lead	ppm	ASTM D5185m	>10	<1	0	0	
Copper	ppm	ASTM D5185m	>50	9	14	10	
Tin	ppm	ASTM D5185m	>10	<1	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	<1	
Cadmium	ppm	ASTM D5185m		0	0	0	
ADDITIVES		method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	0	0	
Barium	ppm	ASTM D5185m	90	0	2	0	
Molybdenum	ppm	ASTM D5185m		0	0	0	
Manganese	ppm	ASTM D5185m		0	0	<1	
Magnesium	ppm	ASTM D5185m	90	2	2	0	
Calcium	ppm	ASTM D5185m	2	0	0	0	
Phosphorus	ppm	ASTM D5185m		0	5	0	
Zinc	ppm	ASTM D5185m		0	<1	0	
Sulfur	ppm	ASTM D5185m		19750	24605	18585	
CONTAMINANTS		method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	0	<1	0	
Sodium	ppm	ASTM D5185m		0	<1	0	
Potassium	ppm	ASTM D5185m	>20	2	0	0	
Water	%	ASTM D6304	>0.05	0.010	0.008	0.007	
ppm Water	ppm	ASTM D6304	>500	108	88.2	70.4	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2	
Particles >4µm		ASTM D7647		512		123	
Particles >6µm		ASTM D7647	>1300	104		43	
Particles >14μm		ASTM D7647	>80	21		6	
Particles >21µm		ASTM D7647	>20	11		2	
Particles >38μm		ASTM D7647	>4	3		0	
Particles >71μm		ASTM D7647	>3	0		0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/14/12		14/13/10	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.41	0.40	0.36	



OIL ANALYSIS REPORT

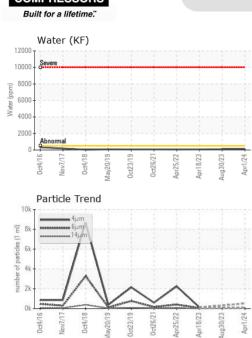


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TES	method	limit/base	current	historv1	historv2


T LOID I TIOI LITTILO		memou			Thistory I	i ilistoi y z
Visc @ 40°C	cSt	ASTM D445	46	44.5	45.3	45.1


SAMPLE IMAGES


Color


Bottom









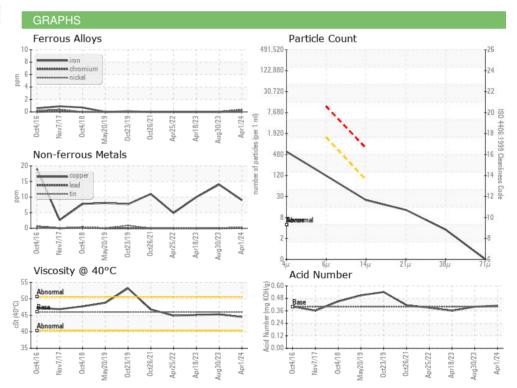





Certificate 12367

Laboratory Sample No.

: KCP26740 Lab Number : 06199186 Unique Number : 11061309

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 04 Jun 2024 **Tested**

: 05 Jun 2024 Diagnosed

: 06 Jun 2024 - Don Baldridge Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CONSTELLIUM AUTOMOTIVE

1 CONSTELLIUM DR NE WHITE, GA

US 30184 Contact: WILLIAM LONGMORE

william.longmore@constellium.com T:

F: