

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER AS 25T 8578597 (S/N 1869)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jan 2024	May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC128374	KC125713	
Sample Date		Client Info		16 May 2024	23 Jan 2024	
Machine Age	hrs	Client Info		7679	3322	
Oil Age	hrs	Client Info		1357	0	
Oil Changed		Client Info		Not Changd	N/A	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	3	<1	
Lead	ppm	ASTM D5185m	>10	<1	0	
Copper	ppm	ASTM D5185m	>50	2	9	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	<1	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	20	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	26	0	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		0	12	
Zinc	ppm	ASTM D5185m		0	0	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		2	<1	
Potassium	ppm	ASTM D5185m	>20	3	3	
Water	%	ASTM D6304	>0.05	0.015	0.005	
ppm Water	ppm	ASTM D6304	>500	151	59	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		2594	5926	
Particles >6µm		ASTM D7647	>1300	727	▲ 3195	
Particles >14µm		ASTM D7647	>80	41	<u> </u>	
Particles >21µm		ASTM D7647	>20	12	11	
Particles >38µm		ASTM D7647	>4	3	1	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13	<u>△</u> 20/19/14	
FLUID DEGRADA	TIO <u>N</u>	method	limit/base	current	history1	history2
A atal Nicosala and (ANI)		4.OTM D00.45	0.4	0.05	0.04	

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.35

0.34



OIL ANALYSIS REPORT

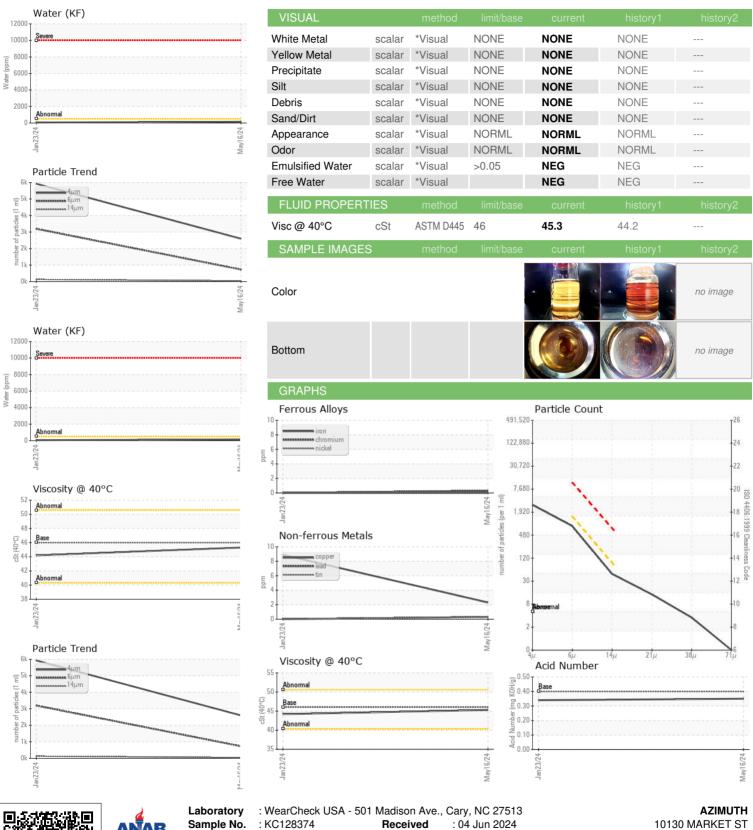



Certificate 12367

Sample No.

: KC128374 Lab Number : 06199187 Unique Number : 11061310

Test Package : IND 2

Received : 04 Jun 2024 **Tested** : 05 Jun 2024 Diagnosed

: 06 Jun 2024 - Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369. st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: AZINAP [WUSCAR] 06199187 (Generated: 06/07/2024 08:00:50) Rev: 1

Contact/Location: ? ? - AZINAP

NAPLES, FL

US 34112

Contact:

T:

F: