




# OIL ANALYSIS REPORT

Sample Rating Trend

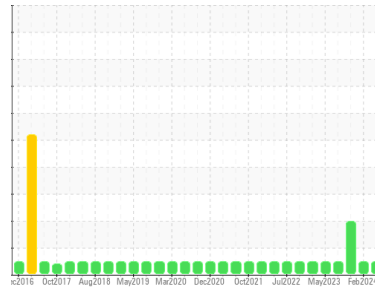

**NORMAL**



Machine Id  
**SHARPLES 7 SOUTH 5400 FLOTATION**  
 Component  
**Bearing**  
 Fluid  
**USPI SBO 68 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM36448</b>	USPM30226	USPM31487
Sample Date	Client Info		<b>03 Jun 2024</b>	27 Feb 2024	28 Nov 2023
Machine Age	yrs	Client Info	<b>0</b>	0	0
Oil Age	yrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>0</b>	7	2
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >20	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >20	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >20	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	4
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>0</b>	1	<1
Calcium	ppm	ASTM D5185m	<b>0</b>	2	1
Phosphorus	ppm	ASTM D5185m	<b>16</b>	28	43
Zinc	ppm	ASTM D5185m	<b>0</b>	3	0
Sulfur	ppm	ASTM D5185m	<b>60</b>	90	23

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	<1	1
Sodium	ppm	ASTM D5185m	<b>1</b>	1	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	1	1
Water	%	ASTM D6304 >2	<b>0.001</b>	0.001	0.052
ppm Water	ppm	ASTM D6304	<b>7</b>	12	520

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>4310</b>	168	---
Particles >6µm	ASTM D7647	>5000	<b>1344</b>	52	---
Particles >14µm	ASTM D7647	>640	<b>165</b>	6	---
Particles >21µm	ASTM D7647	>160	<b>63</b>	2	---
Particles >38µm	ASTM D7647	>40	<b>8</b>	0	---
Particles >71µm	ASTM D7647	>10	<b>1</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>19/18/15</b>	15/13/10	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.087</b>	0.10	0.08




# OIL ANALYSIS REPORT

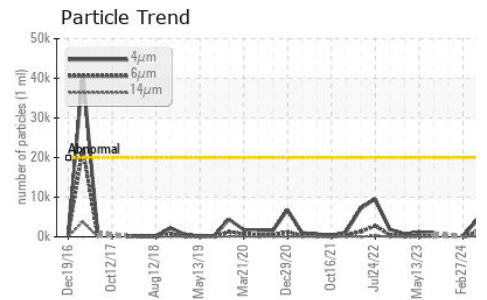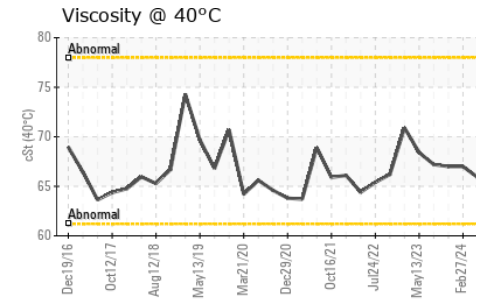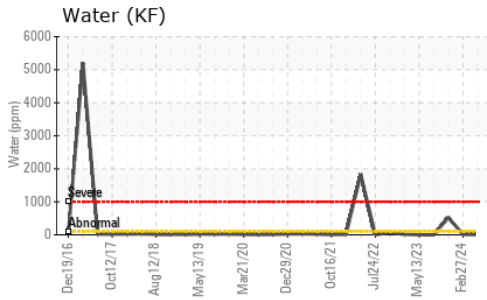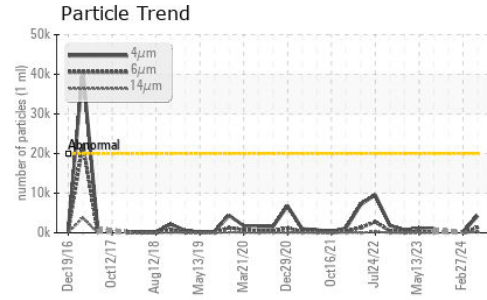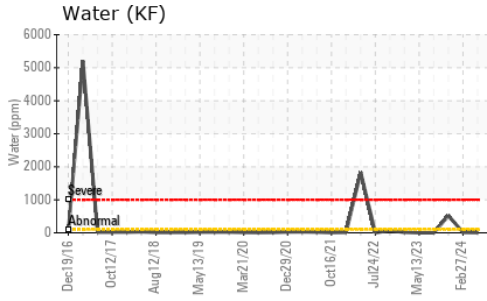






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>2	NEG	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG	▲ 1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>65.9</b>	67.0	67.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

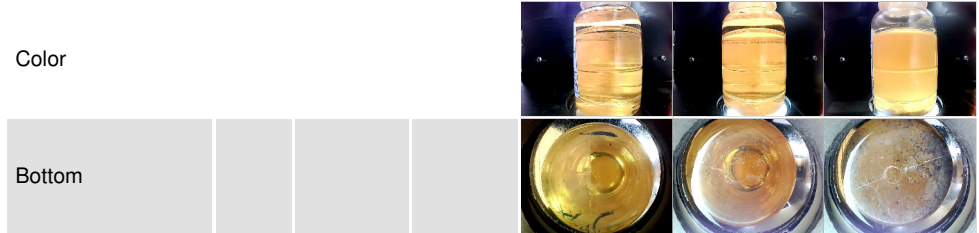

## GRAPHS

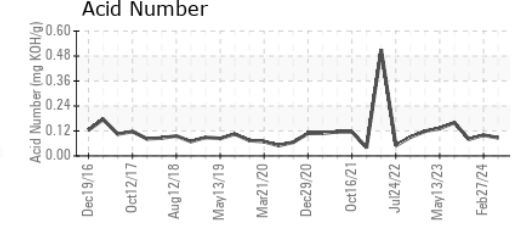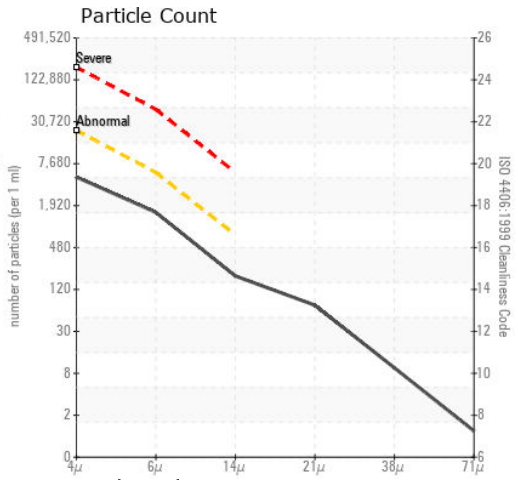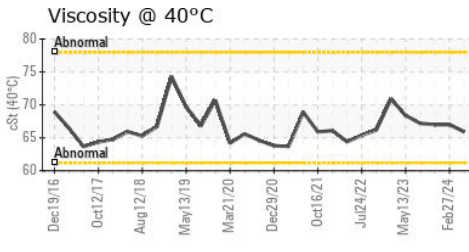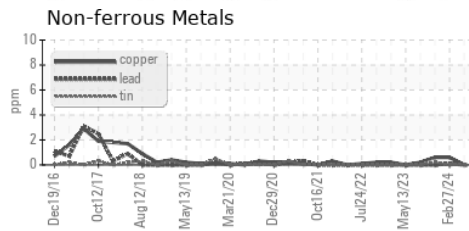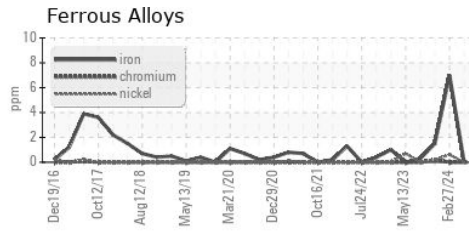

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USPM36448  
 Lab Number : 06199255  
 Unique Number : 11061378  
 Test Package : IND 2

Received : 04 Jun 2024  
 Tested : 09 Jun 2024  
 Diagnosed : 09 Jun 2024 - Doug Bogart

TYSON - DAKOTA CITY RENDERING

DAKOTA CITY, NE  
 US  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
 F: