




# OIL ANALYSIS REPORT

Sample Rating Trend

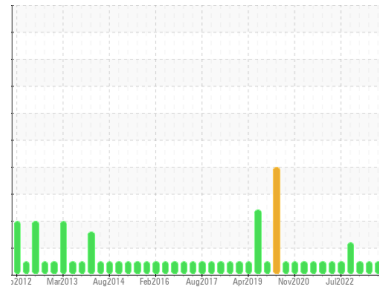

**NORMAL**



Area  
**SLAUGHTER**  
 Machine Id  
**FES TYSPASS 6 FES (S/N 2013406)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**USPI 1009-68 SC (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a trace of moisture present in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP0012583</b>	USP0003565	USP248729
Sample Date	Client Info	<b>29 May 2024</b>	21 Nov 2023	01 Aug 2023
Machine Age	hrs	Client Info	<b>18202</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>8	<b>0</b>	0
Chromium	ppm	ASTM D5185m	>2	<b>0</b>	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0
Aluminum	ppm	ASTM D5185m	>3	<b>0</b>	0
Lead	ppm	ASTM D5185m	>2	<b>0</b>	0
Copper	ppm	ASTM D5185m	>8	<b>0</b>	0
Tin	ppm	ASTM D5185m	>4	<b>0</b>	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	0
Barium	ppm	ASTM D5185m		<b>0</b>	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1
Magnesium	ppm	ASTM D5185m		<b>0</b>	0
Calcium	ppm	ASTM D5185m		<b>0</b>	1
Phosphorus	ppm	ASTM D5185m		<b>0</b>	0
Zinc	ppm	ASTM D5185m		<b>0</b>	0
Sulfur	ppm	ASTM D5185m	50	<b>0</b>	0

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>15	<b>1</b>	0
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	0
Water	%	ASTM D6304	>0.01	<b>0.013</b>	0.003
ppm Water	ppm	ASTM D6304	>100	<b>134</b>	32

## FLUID CLEANLINESS






method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>10000	<b>2547</b>	1330	3031
Particles >6µm	ASTM D7647	>2500	<b>453</b>	259	1015
Particles >14µm	ASTM D7647	>320	<b>26</b>	11	65
Particles >21µm	ASTM D7647	>80	<b>5</b>	3	10
Particles >38µm	ASTM D7647	>20	<b>0</b>	0	1
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>19/16/12</b>	18/15/11	19/17/13

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	<b>0.013</b>	0.01




# OIL ANALYSIS REPORT

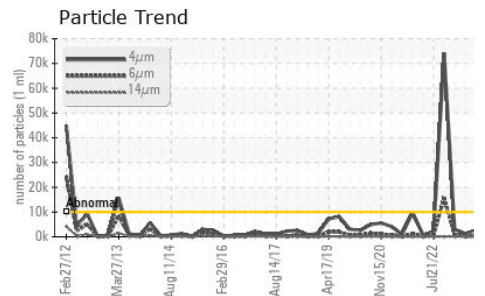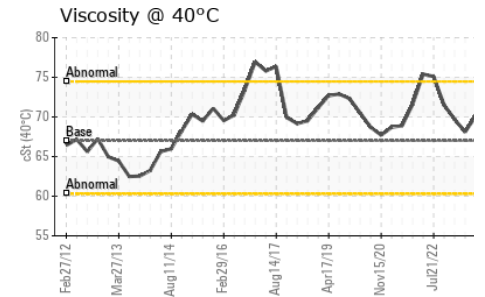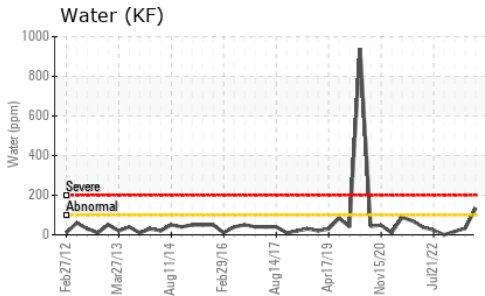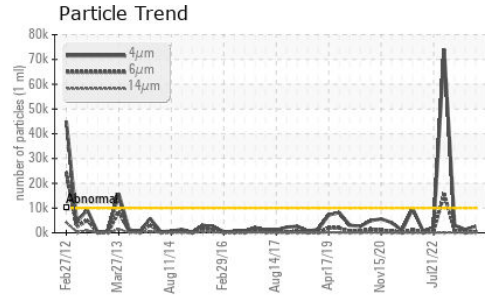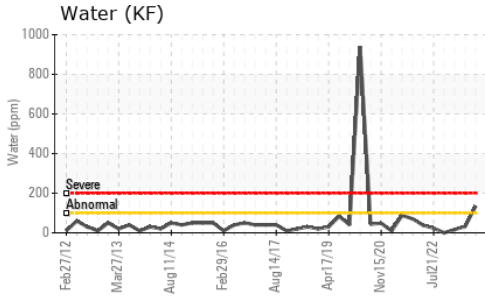






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.01	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	67	<b>70.1</b>	68.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

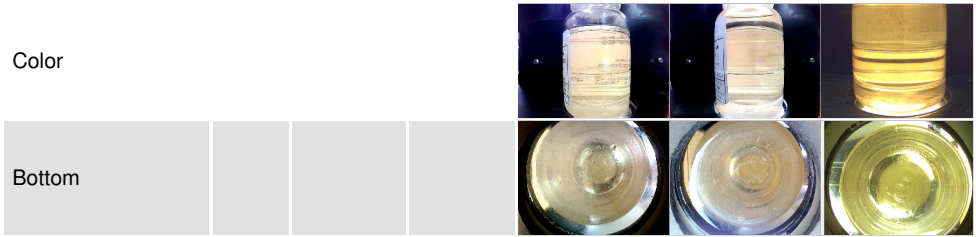

## GRAPHS

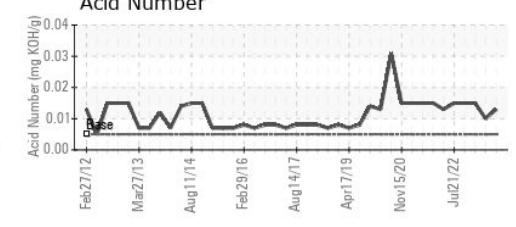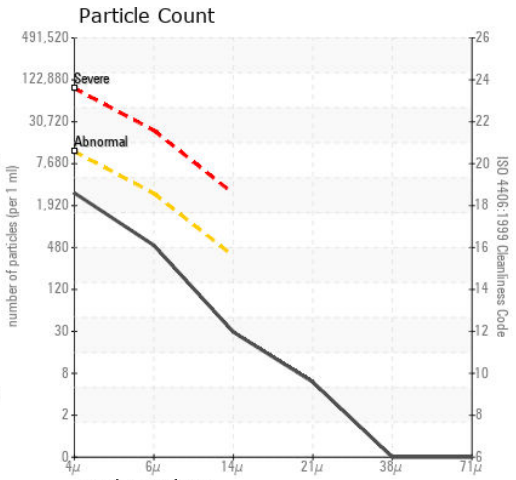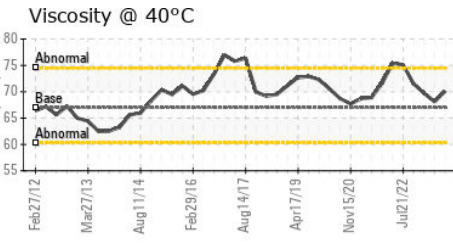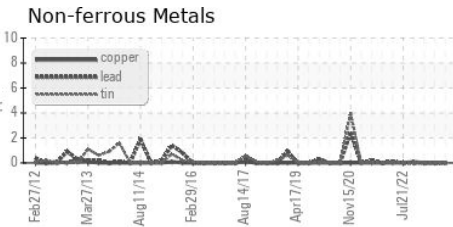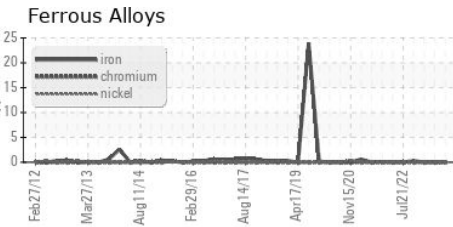

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USP0012583  
 Lab Number : 06199261  
 Unique Number : 11061384  
 Test Package : IND 2

Received : 04 Jun 2024  
 Tested : 06 Jun 2024  
 Diagnosed : 09 Jun 2024 - Doug Bogart

**TYSON - PASCO WALLULA -USP**  
 DODD RD  
 WALLULA, WA  
 US 99363  
 Contact: RICK DUVAL

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (402)423-6375  
 F: (402)423-6661