


OIL ANALYSIS REPORT

SLAUGHTER
Machine Id
FES TYSPASS 1 FES (S/N 2013624)

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

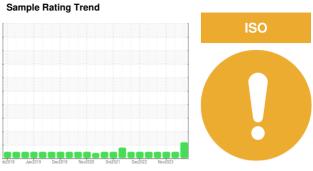

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Woor

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0012582	USP0006932	USP0003567
Sample Date		Client Info		24 May 2024	15 Feb 2024	21 Nov 2023
Machine Age	hrs	Client Info		19252	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ATTENTION	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	<1	0
Copper	ppm	ASTM D5185m	>8	0	<1	0
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		0	<1	0
Calcium	ppm	ASTM D5185m		0	1	1
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	3	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	0
Sodium	ppm	ASTM D5185m		1	<1	0
Potassium	ppm	ASTM D5185m	>20	2	0	0
Water	%	ASTM D6304	>0.01	0.001	0.002	0.003
ppm Water	ppm	ASTM D6304	>100	6	25	34
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	15722	955	1324
Particles >6µm		ASTM D7647	>2500	2879	341	399
Particles >14μm		ASTM D7647	>320	102	29	23
Particles >21µm		ASTM D7647	>80	15	5	3
Particles >38μm		ASTM D7647	>20	0	0	0
Particles >71μm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	2 1/19/14	17/16/12	18/16/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.01



OIL ANALYSIS REPORT







Certificate 12367

Sample No. Lab Number

Laboratory

: USP0012582 : 06199262 Unique Number : 11061385

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 04 Jun 2024

Tested : 06 Jun 2024 Diagnosed

: 09 Jun 2024 - Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (402)423-6661 Contact/Location: RICK DUVALL - TYSWAL

TYSON - PASCO WALLULA -USP

DODD RD

US 99363

WALLULA, WA

T: (402)423-6375

Contact: RICK DUVALL