




# OIL ANALYSIS REPORT

## Sample Rating Trend

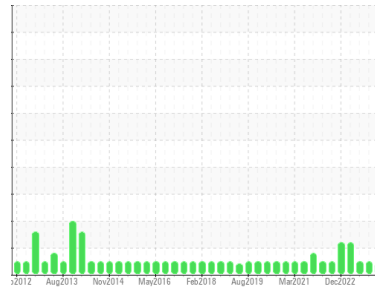

**VIS DEBRIS**



Area

**SLAUGHTER**

Machine Id

**FES TYSPASS 2 FES (S/N 2012350)**

Component

**Refrigeration Compressor**

Fluid

**USPI 1009-68 SC (--- GAL)**

### DIAGNOSIS

#### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

#### Wear

All component wear rates are normal.

#### Contamination

Moderate concentration of visible dirt/debris present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0012575</b>	USP0003570	USP248723
Sample Date	Client Info		<b>24 May 2024</b>	21 Nov 2023	01 Aug 2023
Machine Age	hrs	Client Info	<b>49369</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >8	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	<1	0
Calcium	ppm	ASTM D5185m	<b>0</b>	1	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 50	<b>0</b>	0	0

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m	<b>1</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1
Water	%	ASTM D6304 >0.01	<b>0.001</b>	0.005	0.004
ppm Water	ppm	ASTM D6304 >100	<b>12</b>	54	40.7

### FLUID CLEANLINESS




	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>---</b>	2304	1378
Particles >6µm	ASTM D7647	>2500	<b>---</b>	666	466
Particles >14µm	ASTM D7647	>320	<b>---</b>	39	38
Particles >21µm	ASTM D7647	>80	<b>---</b>	10	7
Particles >38µm	ASTM D7647	>20	<b>---</b>	1	0
Particles >71µm	ASTM D7647	>4	<b>---</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>---</b>	18/17/12	18/16/12

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	<b>0.014</b>	0.01	0.014




# OIL ANALYSIS REPORT

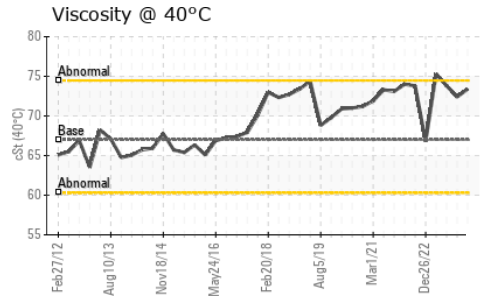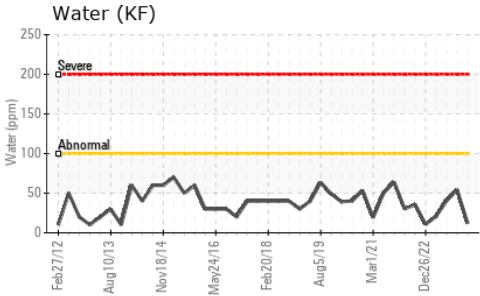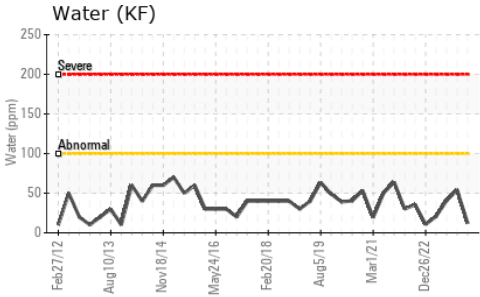





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 67	73.4	72.4	73.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

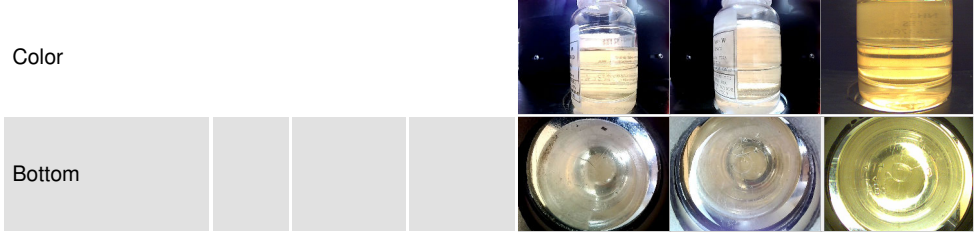

## GRAPHS

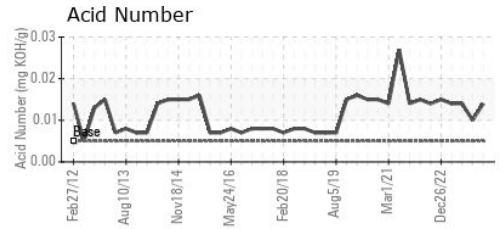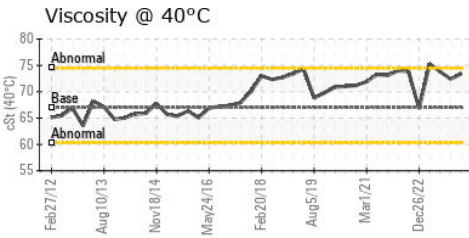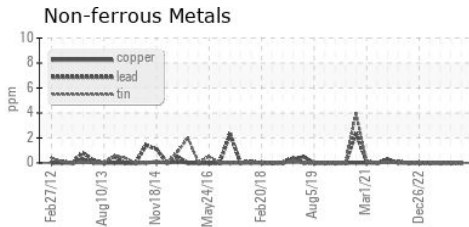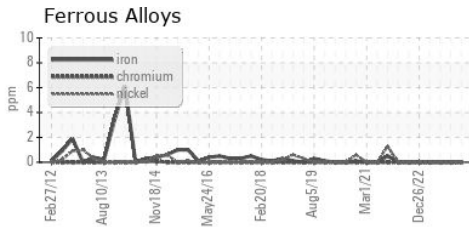

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0012575      **Received** : 04 Jun 2024  
**Lab Number** : 06199269      **Tested** : 11 Jun 2024  
**Unique Number** : 11061392      **Diagnosed** : 11 Jun 2024 - Doug Bogart  
**Test Package** : IND 2

**TYSON - PASCO WALLULA -USP**  
 DODD RD  
 WALLULA, WA  
 US 99363  
 Contact: RICK DUVAL

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (402)423-6375  
F: (402)423-6661