




# OIL ANALYSIS REPORT

Sample Rating Trend

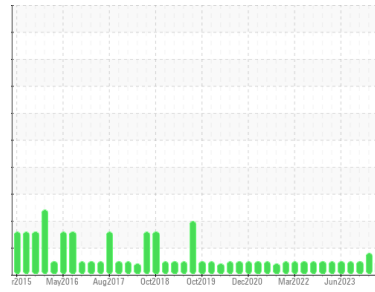

**NORMAL**



Machine Id  
**FES TYSNEW H-12 (S/N 50524)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**USPI ALT-68 SC (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0012594</b>	USP0007630	USP0003912
Sample Date	Client Info		<b>31 May 2024</b>	21 Feb 2024	05 Dec 2023
Machine Age	hrs	Client Info	<b>101419</b>	101344	101247
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	ATTENTION	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >8	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	<1
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 50	<b>0</b>	8	17

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>2</b>	2	2
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	1	<1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1
Water	%	ASTM D6304 >0.01	<b>0.007</b>	0.006	0.005
ppm Water	ppm	ASTM D6304 >100	<b>70</b>	63	52

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>2109</b>	17624	1963
Particles >6µm	ASTM D7647 >2500		<b>257</b>	3978	355
Particles >14µm	ASTM D7647 >320		<b>20</b>	106	9
Particles >21µm	ASTM D7647 >80		<b>10</b>	14	4
Particles >38µm	ASTM D7647 >20		<b>7</b>	0	0
Particles >71µm	ASTM D7647 >4		<b>2</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/18/15		<b>18/15/11</b>	21/19/14	18/16/10

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	<b>0.014</b>	0.014	0.015




# OIL ANALYSIS REPORT

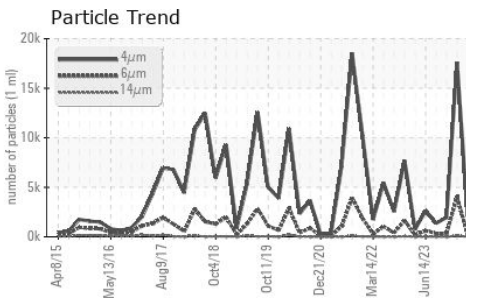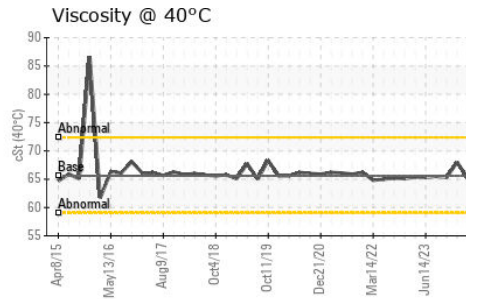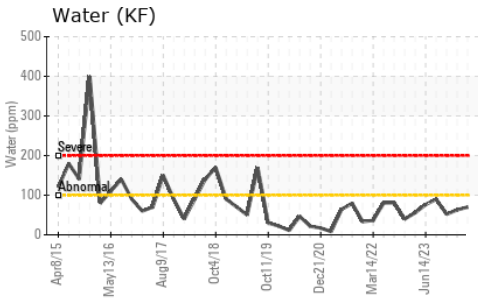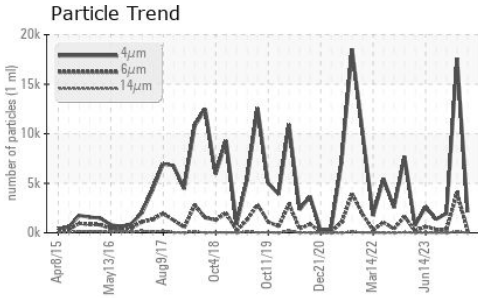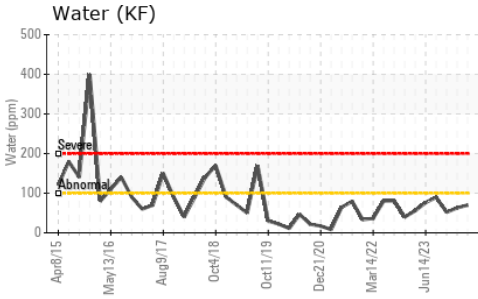






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	65.6	<b>65.2</b>	68.0	65.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

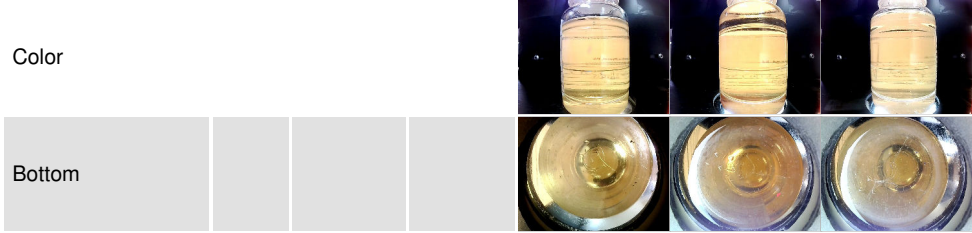

## GRAPHS

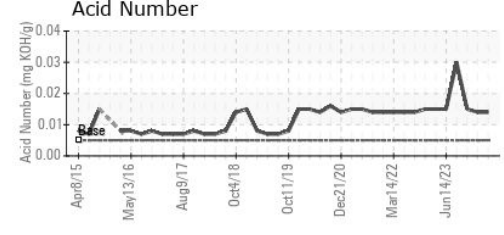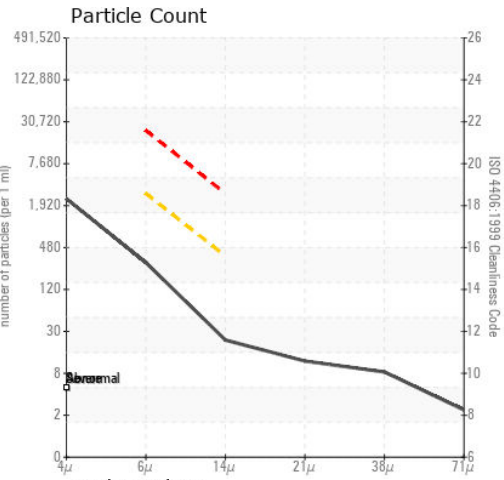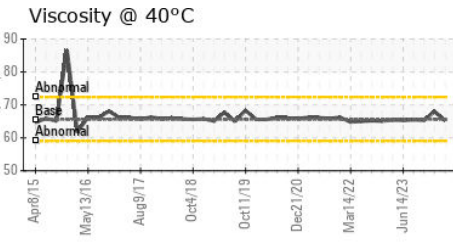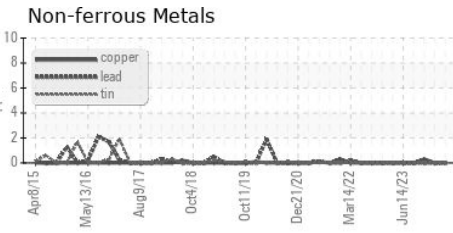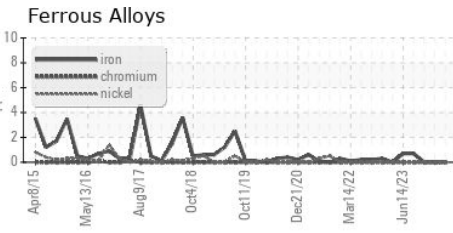

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0012594  
**Lab Number** : 06199278  
**Unique Number** : 11061401  
**Test Package** : IND 2  
**Received** : 04 Jun 2024  
**Tested** : 09 Jun 2024  
**Diagnosed** : 09 Jun 2024 - Doug Bogart

**TYSON - NEW HOLLAND - PLANT 1 - USP**  
 PLANT 1  
 NEW HOLLAND, PA  
 US 17557  
 Contact: ROGER GOOD  
 roger.good@tyson.com  
 T: (800)755-4572  
 F: (402)423-6661

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)