




OIL ANALYSIS REPORT

Sample Rating Trend

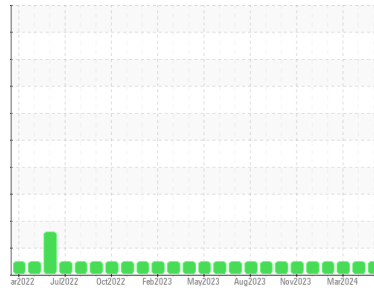

NORMAL



Area
{UNASSIGNED}

Machine Id
P-2301A GEAR

Component
Gearbox

Fluid
ROYAL PURPLE SYNFILM GT 150 (3 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | RP0043914 | RP0043913 | RP0043771 |
| Sample Date | Client Info | | | 30 May 2024 | 23 Apr 2024 | 22 Mar 2024 |
| Machine Age | hrs | Client Info | | 67726 | 66761 | 59680 |
| Oil Age | hrs | Client Info | | 10026 | 9661 | 1980 |
| Oil Changed | Client Info | | | Not Changed | Not Changed | Not Changed |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >200 | 0 | 2 | <1 |
| Chromium | ppm | ASTM D5185m | >15 | 0 | 0 | <1 |
| Nickel | ppm | ASTM D5185m | >15 | 0 | 0 | <1 |
| Titanium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Aluminum | ppm | ASTM D5185m | >25 | 0 | 0 | <1 |
| Lead | ppm | ASTM D5185m | >100 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >200 | <1 | 2 | 0 |
| Tin | ppm | ASTM D5185m | >25 | 0 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |




| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | <1 | 2 | <1 |
| Manganese | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m | | 105 | 96 | 104 |
| Calcium | ppm | ASTM D5185m | | 36 | 36 | 37 |
| Phosphorus | ppm | ASTM D5185m | | 55 | 34 | 35 |
| Zinc | ppm | ASTM D5185m | | 53 | 44 | 39 |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >50 | <1 | 1 | <1 |
| Sodium | ppm | ASTM D5185m | | 1 | 2 | <1 |
| Potassium | ppm | ASTM D5185m | >20 | 0 | 0 | <1 |
| Water | % | ASTM D6304 | >0.2 | 0.021 | 0.015 | 0.017 |
| ppm Water | ppm | ASTM D6304 | >2000 | 216 | 151 | 171 |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | 0.30 | 0.30 | 0.30 |


| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|---------|------------|--------------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.2 | NEG | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG | NEG |

OIL ANALYSIS REPORT


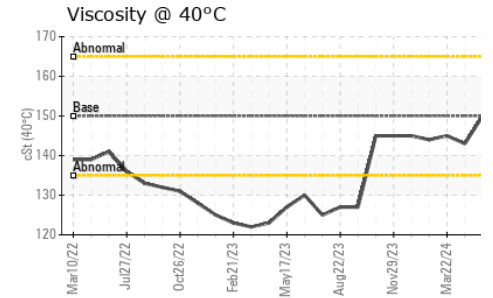
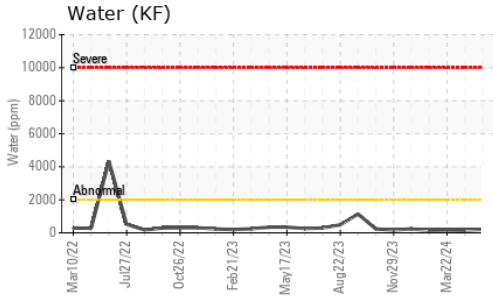
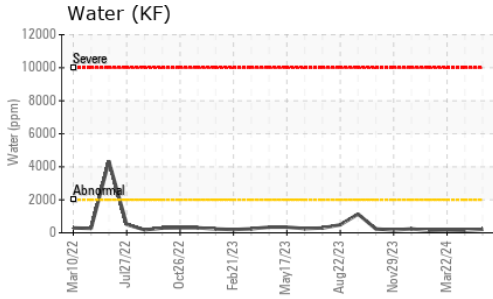


| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 150 | 143 | 145 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

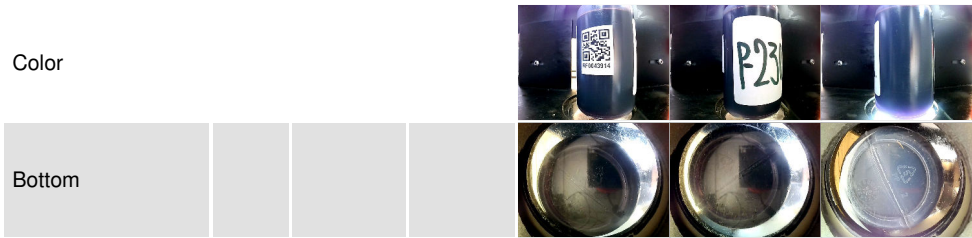

GRAPHS

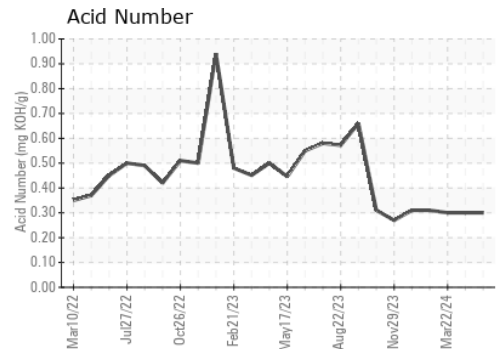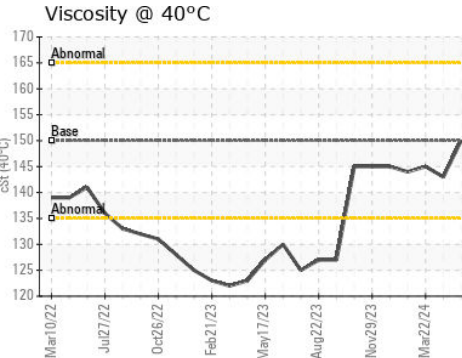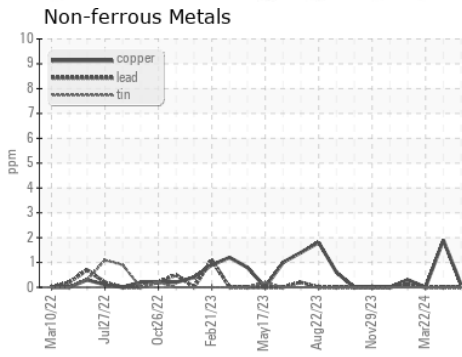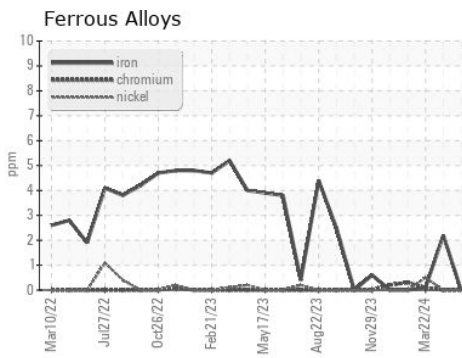

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0043914
Lab Number : 06199325
Unique Number : 11061448
Test Package : IND 2
Received : 04 Jun 2024
Tested : 06 Jun 2024
Diagnosed : 06 Jun 2024 - Don Baldrige

TEAM SUR S.A.S.

BOGOTA, CO

Contact: Team Sur
 jconde@teamsur.com
 T: (300)740-0654

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)