


OIL ANALYSIS REPORT

Area **\$-460** [9604] **KAESER 1072 - ENGINEERED PLASTICS**

Component Compressor



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI06199360		
Sample Date		Client Info		26 Apr 2024		
Machine Age	hrs	Client Info		30979		
Oil Age	hrs	Client Info		16116		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	36		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	8		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	22		
Calcium	ppm	ASTM D5185m	2	<1		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		48		
Sulfur	ppm	ASTM D5185m		16779		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		12		
Potassium	ppm	ASTM D5185m	>20	6		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.38		





OIL ANALYSIS REPORT

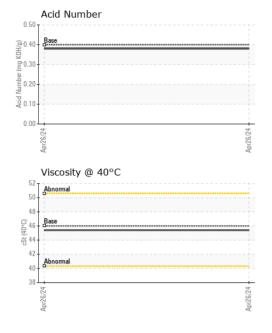













Certificate 12367

Laboratory Sample No.

Lab Number : 06199360 Unique Number : 11061483

Test Package : IND 2

: UDI06199360

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 04 Jun 2024 **Tested** : 05 Jun 2024 Diagnosed

: 05 Jun 2024 - Wes Davis

DELTA INDUSTRIES - DOWNERS GROVE 2201 CURTISS STREET DOWNERS GROVE, IL US 60515

Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931

Report Id: UCDELDOW [WUSCAR] 06199360 (Generated: 06/06/2024 08:14:04) Rev: 1