

# **OIL ANALYSIS REPORT**

## Area SULLUBE [1120355] ATLAS COPCO API232714 - GREAT PLAINS ABW LEAD

Component Compressor

#### DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

#### Wear


All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Sample Rating Trend




NORMAL

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06199370		
Sample Date		Client Info		22 May 2024		
Machine Age	hrs	Client Info		16910		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
CONTAMINATION	١	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	<1		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	1		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	500	3		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		1		
Calcium	ppm	ASTM D5185m		<1		
Phosphorus	ppm	ASTM D5185m		33		
Zinc	ppm	ASTM D5185m		39		
Sulfur	ppm	ASTM D5185m	150	87		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	1		
Sodium	ppm	ASTM D5185m		5		
Potassium	ppm	ASTM D5185m	>20	3		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.5	0.23		



# **OIL ANALYSIS REPORT**

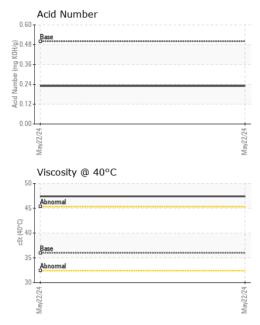

VISUAL		method			history1	history2	
White Metal	scalar	*Visual	NONE	NONE			
Yellow Metal	scalar	*Visual	NONE	NONE			
Precipitate	scalar	*Visual	NONE	NONE			
Silt	scalar	*Visual	NONE	NONE			
Debris	scalar	*Visual	NONE	LIGHT			
Sand/Dirt	scalar	*Visual	NONE	NONE			
Appearance	scalar	*Visual	NORML	NORML			
Odor	scalar	*Visual	NORML	NORML			
Emulsified Water	scalar	*Visual	>0.1	NEG			
Free Water	scalar	*Visual		NEG			
FLUID PROPERT	IES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	36	47.4			
SAMPLE IMAGES	\$	method	limit/base	current	history1	history2	
Color				a.	no image	no image	
Bottom					no image	no image	
http://www.nickel	5		May22/24				
Viscosity @ 40°C			K0H(d) 69:00	Acid Numb	er		
Abnormal Abnormal			0.60 0.03 0.36 0.25 0.00 0.02 0.00 0.02 0.00 0.00	May22/24		4 CC CreeW	
earCheck USA - 501 Madison Ave., Cary, NC 27513 CH06199370 <b>Received</b> : 04 Jun 2024 199370 <b>Tested</b> : 05 Jun 2024 061493 <b>Diagnosed</b> : 06 Jun 2024 - Don Baldridge D 2 tact Customer Service at 1-800-237-1369. Dutside of the ISO 17025 scope of accreditation.					AIR CAPITAL EQUIPMENT INC 806 E BOSTON ST WICHITA, KS US 6721 <sup>-7</sup> Contact: MIKAYLA STOUT mstout@aircapeq.con T: (316)522-111 <sup>-7</sup>		

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCAIRWIC [WUSCAR] 06199370 (Generated: 06/06/2024 17:17:48) Rev: 1

To discuss this sample report,

Certificate L2367

Laboratory Sample No. Lab Number Unique Number Test Package

Contact/Location: MIKAYLA STOUT - UCAIRWIC

F: