




OIL ANALYSIS REPORT

Sample Rating Trend

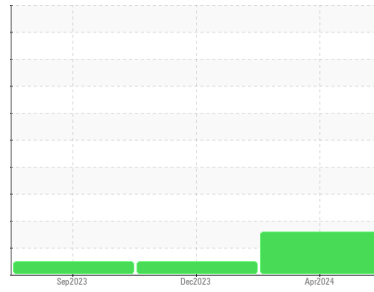

DEGRADATION



Area

KLUBER Z-46

Machine Id

SULLAIR 705.CZ6 - ASH GROVE CEMENT (S/N 200601310105)

Component

Compressor

DIAGNOSIS

Recommendation

We advise that you check for a possible overheat condition. The oil is near the end of its useful service life, recommend schedule an oil change. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The oil viscosity is higher than normal. The AN level is at the top-end of the recommended limit.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		UCH06199374	UCH06043324	UCH05990501
Sample Date	Client Info		23 Apr 2024	15 Dec 2023	15 Sep 2023
Machine Age	hrs	Client Info	29249	26227	24203
Oil Age	hrs	Client Info	0	9445	7426
Oil Changed	Client Info		N/A	Not Changd	Not Changd
Sample Status			ATTENTION	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0
Chromium	ppm	ASTM D5185m	>10	0	0
Nickel	ppm	ASTM D5185m		0	0
Titanium	ppm	ASTM D5185m		0	<1
Silver	ppm	ASTM D5185m		0	0
Aluminum	ppm	ASTM D5185m	>25	<1	0
Lead	ppm	ASTM D5185m	>25	0	0
Copper	ppm	ASTM D5185m	>50	<1	0
Tin	ppm	ASTM D5185m	>15	<1	0
Vanadium	ppm	ASTM D5185m		0	0
Cadmium	ppm	ASTM D5185m		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0
Barium	ppm	ASTM D5185m		25	0
Molybdenum	ppm	ASTM D5185m		0	0
Manganese	ppm	ASTM D5185m		<1	0
Magnesium	ppm	ASTM D5185m		<1	0
Calcium	ppm	ASTM D5185m		<1	<1
Phosphorus	ppm	ASTM D5185m		11	14
Zinc	ppm	ASTM D5185m		0	0
Sulfur	ppm	ASTM D5185m		43	19

CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	1
Sodium	ppm	ASTM D5185m		3	0
Potassium	ppm	ASTM D5185m	>20	3	0

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.76	1.17	1.094



OIL ANALYSIS REPORT

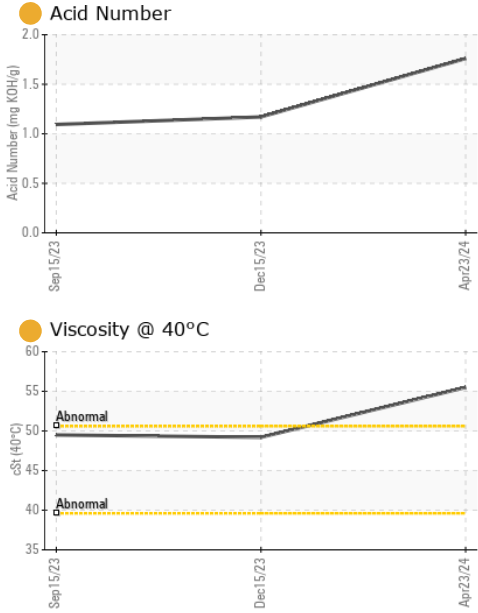





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	● 55.5	49.2	49.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					



GRAPHS

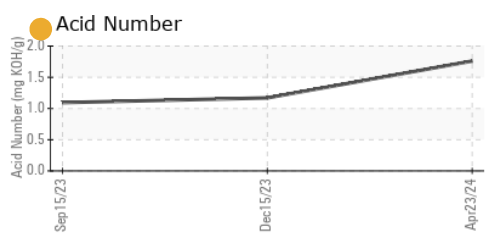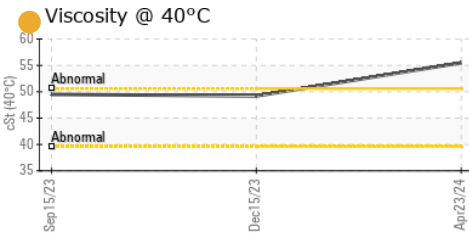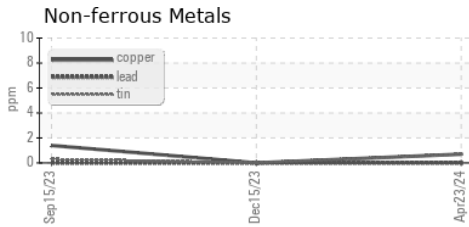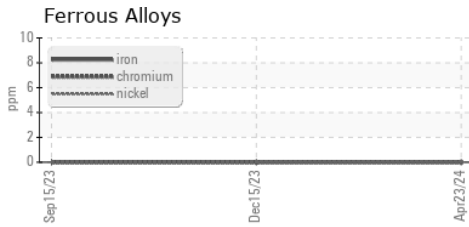

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06199374 **Received** : 04 Jun 2024
Lab Number : 06199374 **Tested** : 05 Jun 2024
Unique Number : 11061497 **Diagnosed** : 06 Jun 2024 - Don Baldrige
Test Package : IND 2

AIR CAPITAL EQUIPMENT INC
 806 E BOSTON ST
 WICHITA, KS
 US 67211
 Contact: MIKAYLA STOUT
 mstout@aircapeq.com
 T: (316)522-1111
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)