


### **OIL ANALYSIS REPORT**

# Area **S-460** [10013]

## KAESER 6909463 - GPA SPECIALTY SUBSTRATE SOLUTION (S/N 1393)

Component Compressor



Sample Rating Trend



#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI0000298	UCH05568225	UCH05207744
Sample Date		Client Info		24 May 2024	27 May 2022	08 Mar 2021
Machine Age	hrs	Client Info		12849	7403	3789
Oil Age	hrs	Client Info		5500	3613	3789
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	ABNORMAL	NORMAL
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	4	2
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	12	11	6
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				<1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	0	0	8
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		0	1	19
Zinc	ppm	ASTM D5185m		0	3	0
Sulfur	ppm	ASTM D5185m		19464	15990	16893
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	13
Sodium	ppm	ASTM D5185m		<1	<1	0
Potassium	ppm	ASTM D5185m	>20	0	0	0
FLUID DEGRADA	NOITA	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.39	0.34	0.353



### **OIL ANALYSIS REPORT**

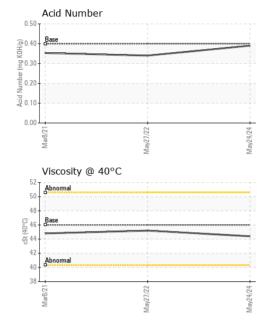

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.05	NEG	<b>△</b> 0.2%	NEG
Free Water	scalar	*Visual		NEG	<b>▲</b> 1.0	NEG
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.4	45.2	44.8
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						

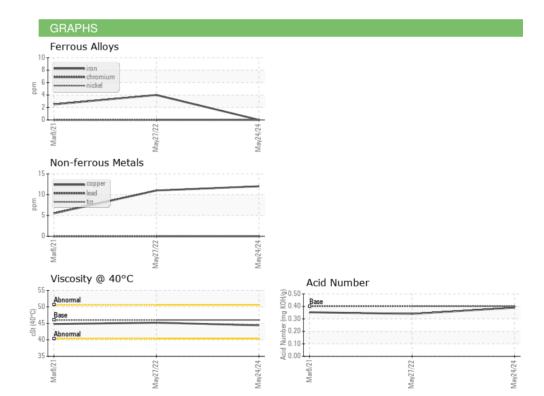





Certificate 12367

Laboratory Sample No. Lab Number : 06199406 Unique Number : 11061529

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UDI0000298 Received

: 04 Jun 2024 **Tested** : 05 Jun 2024 Diagnosed : 05 Jun 2024 - Wes Davis

2201 CURTISS STREET DOWNERS GROVE, IL US 60515

**DELTA INDUSTRIES - DOWNERS GROVE** 

Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931 Contact/Location: MICHAEL FERRIS - UCDELDOW

Report Id: UCDELDOW [WUSCAR] 06199406 (Generated: 06/06/2024 08:21:47) Rev: 1