




OIL ANALYSIS REPORT



Machine Id
Brent Run CAT 2 BRRM02BE
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)

Sample Rating Trend

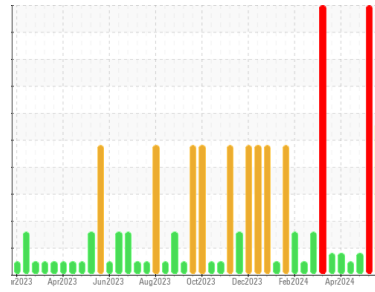

DIRT



DIAGNOSIS

▲ Recommendation

We recommend that you drain the oil and perform a filter service on this component if not already done. We recommend an early resample to monitor this condition.

▲ Wear

The tin level is abnormal. All other component wear rates are normal.

▲ Contamination

Elemental level of silicon (Si) above normal.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The oil is no longer serviceable due to the presence of contaminants.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0915814	WC0915812	WC0915809
Sample Date	Client Info		03 Jun 2024	29 May 2024	17 May 2024
Machine Age	hrs	Client Info	54187	54007	53789
Oil Age	hrs	Client Info	762	600	364
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			SEVERE	SEVERE	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method		NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>14	1	3	3
Chromium	ppm	ASTM D5185m	>3	0	<1	<1
Nickel	ppm	ASTM D5185m		0	<1	<1
Titanium	ppm	ASTM D5185m		0	<1	<1
Silver	ppm	ASTM D5185m		0	<1	<1
Aluminum	ppm	ASTM D5185m	>5	4	3	3
Lead	ppm	ASTM D5185m	>8	2	3	4
Copper	ppm	ASTM D5185m	>5	2	2	2
Tin	ppm	ASTM D5185m	>3	4	5	4
Vanadium	ppm	ASTM D5185m		0	<1	<1
Cadmium	ppm	ASTM D5185m		0	<1	<1

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		82	81	66
Barium	ppm	ASTM D5185m		<1	2	0
Molybdenum	ppm	ASTM D5185m		4	6	4
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		31	31	19
Calcium	ppm	ASTM D5185m		1817	1848	1778
Phosphorus	ppm	ASTM D5185m		427	444	371
Zinc	ppm	ASTM D5185m		521	531	430
Sulfur	ppm	ASTM D5185m		4417	4209	3760

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>180	231	232	158
Sodium	ppm	ASTM D5185m	>20	1	0	0
Potassium	ppm	ASTM D5185m	>20	1	2	3

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624		5.6	5.3	5.5
Sulfation	Abs/.1mm	*ASTM D7415		23.4	22.7	20.3


FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414		15.8	15.4	12.8
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	1.51	1.87	0.94
Base Number (BN)	mg KOH/g	ASTM D2896	5.4	3.5	3.47	3.70




OIL ANALYSIS REPORT

Non-ferrous Metals

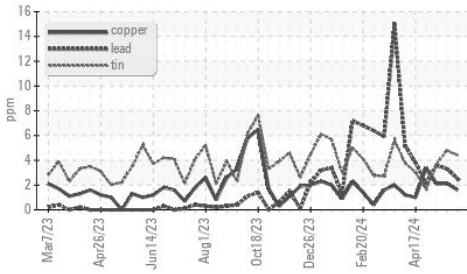

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG


FT-IR (Direct Trend)

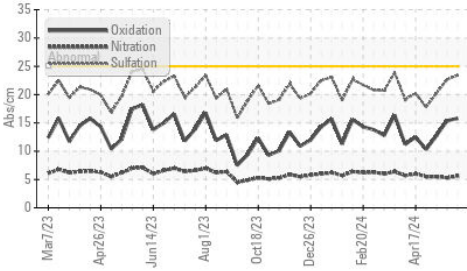


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	14.4	14.3

GRAPHS


Acid Number

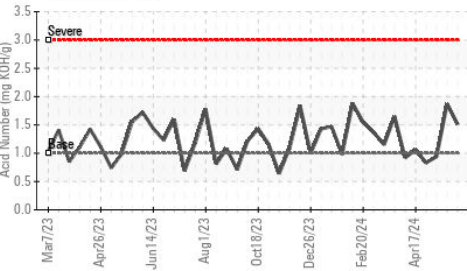


Acid Number

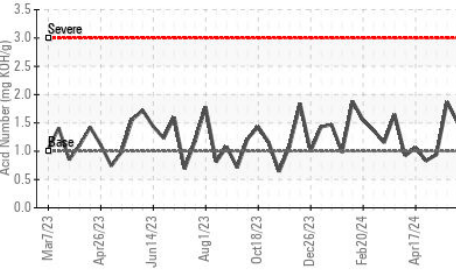


Base Number

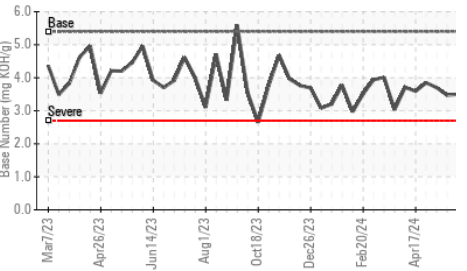


Iron (ppm)

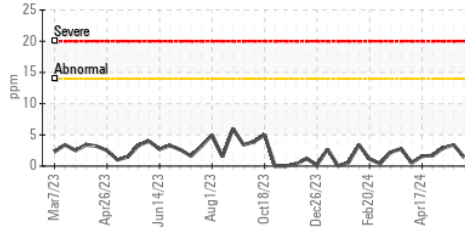


Aluminum (ppm)

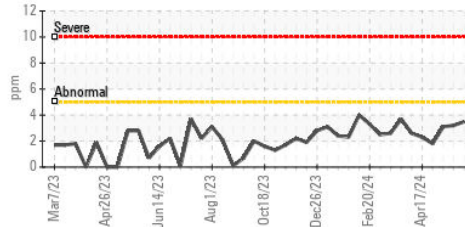


Copper (ppm)

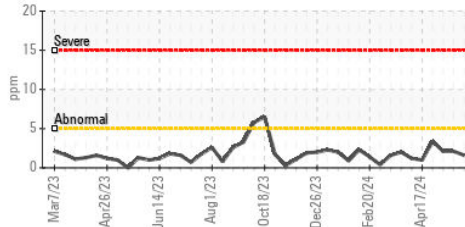


Viscosity @ 100°C

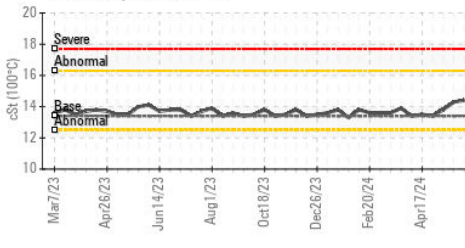


Lead (ppm)

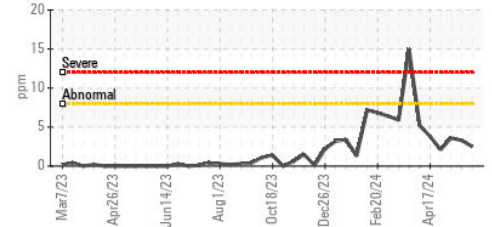


Chromium (ppm)

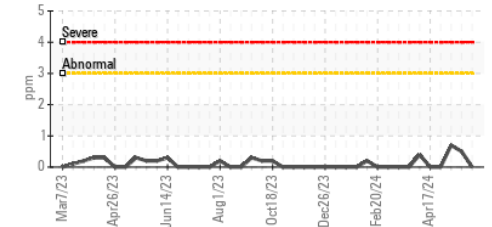

Silicon (ppm)

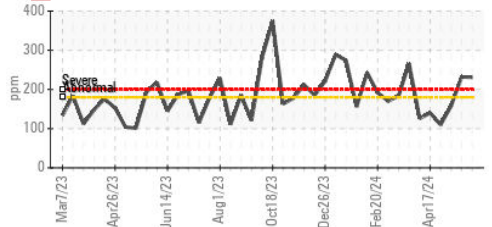

Base Number

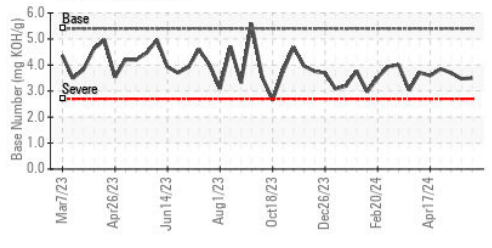

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0915814
 Lab Number : 06199816
 Unique Number : 11061939
 Test Package : MOB 2

Received : 05 Jun 2024
 Tested : 12 Jun 2024
 Diagnosed : 12 Jun 2024 - Doug Bogart

EDL NA Recips-Brent Run
 Brent Run Power Station, 8383 Vienna Road
 Montrose, MI
 US 48457-9141
 Contact: Rob Stewart
 Rob.Stewart@energydevelopments.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: