

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Action Newark CATERPILLAR 5660 Diesel Engine

Fluid DIESEL ENGINE OIL SAE 40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Area

Wear

All component wear rates are normal.

Contamination

Elevated aluminum (AI) and/or lead (Pb) and potassium (K) levels in your metals analysis are likely a result of solder flux release into the lubricant and is common on new equipment/components. There is no indication of any contamination in the oil.


Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

| 4E 40 (GAL) | | 0002023 | NOVZUZ-3 F8DZUZ-4 | Marzuz+ Marzuz+ Aprzuz+ | Mayzuz4 | |
|---|---------------------------------------|---|---|--|---|-------------------------------------|
| SAMPLE INFORM | IATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | WC0941188 | WC0912317 | WC0889528 |
| Sample Date | | Client Info | | 28 May 2024 | 25 Apr 2024 | 20 Mar 2024 |
| Nachine Age | hrs | Client Info | | 8927 | 8761 | 0 |
| Dil Age | hrs | Client Info | | 0 | 0 | 0 |
| Dil Changed | | Client Info | | N/A | N/A | N/A |
| Sample Status | | | | NORMAL | ABNORMAL | NORMAL |
| CONTAMINATION | N | method | limit/base | current | history1 | history2 |
| uel | | WC Method | >5 | <1.0 | <1.0 | <1.0 |
| Vater | | WC Method | >0.2 | NEG | NEG | NEG |
| Glycol | | WC Method | | NEG | NEG | NEG |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| ron | ppm | ASTM D5185m | >100 | 16 | 25 | 19 |
| Chromium | ppm | ASTM D5185m | >20 | 2 | 3 | 2 |
| Nickel | ppm | ASTM D5185m | >2 | 0 | 0 | <1 |
| Fitanium | ppm | ASTM D5185m | >2 | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | >2 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >25 | 9 | <u> </u> | 18 |
| ead | ppm | ASTM D5185m | >40 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >330 | 6 | 6 | 1 |
| īn | ppm | ASTM D5185m | >15 | 0 | <1 | 0 |
| /anadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | 250 | 4 | 10 | 12 |
| Barium | ppm | ASTM D5185m | 10 | 0 | <1 | 0 |
| Nolybdenum | ppm | ASTM D5185m | 100 | 51 | 56 | 50 |
| Manganese | ppm | ASTM D5185m | | <1 | 2 | <1 |
| Magnesium | ppm | ASTM D5185m | 450 | 801 | 845 | 803 |
| Calcium | ppm | ASTM D5185m | 3000 | 1076 | 1162 | 1198 |
| Phosphorus | ppm | ASTM D5185m | 1150 | 957 | 1034 | 920 |
| Zinc | ppm | ASTM D5185m | 1350 | 1166 | 1213 | 1183 |
| Sulfur | ppm | ASTM D5185m | 4250 | 3534 | 3583 | 3722 |
| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 6 | 8 | 4 |
| | ppin | ACTIVI DO TOOTTI | 20 | 0 | 0 | |
| Sodium | ppm | ASTM D5185m | >216 | 4 | <1 | <1 |
| | | | | | | <1 0 |
| | ppm | ASTM D5185m | >216 | 4 13 | <1 | |
| Potassium INFRA-RED | ppm | ASTM D5185m ASTM D5185m | >216 >20 | 4 13 | <1 0 | 0 |
| Potassium INFRA-RED Soot % | ppm ppm | ASTM D5185m ASTM D5185m method | >216 >20 limit/base | 4 13 current | <1 0 history1 | 0 history2 |
| Potassium INFRA-RED Soot % Nitration | ppm ppm % | ASTM D5185m ASTM D5185m method *ASTM D7844 | >216 >20 limit/base >3 | 4 13 current 0.4 | <1 0 history1 0.2 | 0 history2 0.1 |
| Potassium INFRA-RED Soot % Nitration | ppm ppm % Abs/cm Abs/.1mm | ASTM D5185m ASTM D5185m Method *ASTM D7844 *ASTM D7624 | >216 >20 limit/base >3 >20 | 4 13 current 0.4 7.3 | <1 0 history1 0.2 5.7 | 0 history2 0.1 4.9 |
| Soot % Nitration Sulfation | ppm ppm % Abs/cm Abs/.1mm | ASTM D5185m ASTM D5185m *ASTM D7844 *ASTM D7844 *ASTM D7624 | >216 >20 limit/base >3 >20 >30 | 4 13 current 0.4 7.3 19.2 | <1 0 history1 0.2 5.7 17.6 | 0 history2 0.1 4.9 16.8 |



OIL ANALYSIS REPORT





250

200

150

100

50

0

150

100

50

0

400

300

la 200

100

Π

18

10 -St (100°C)


10

Laboratory

Sample No.

ppm

ppm

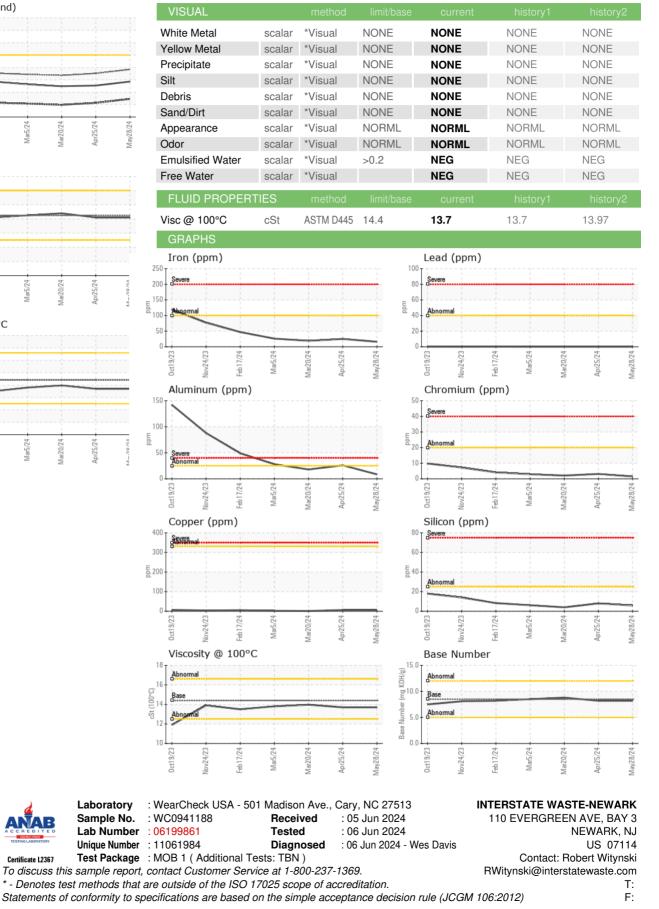

Certificate 12367

Contact/Location: Robert Witynski - INT110NEW