


OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

ATLAS COPCO API667026 - JBS-PIPESTONE

Component Compressor

COMPRESSOR OIL (PAO) ISO 46 (5 GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		DFP0000016		
Sample Date		Client Info		30 May 2024		
Machine Age	hrs	Client Info		8393		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	0		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	5		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	0		
Barium	ppm	ASTM D5185m	1	<1		
Molybdenum	ppm	ASTM D5185m	1	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	1	0		
Calcium	ppm	ASTM D5185m	1	2		
Phosphorus	ppm	ASTM D5185m	800	444		
Zinc	ppm	ASTM D5185m	20	9		
Sulfur	ppm	ASTM D5185m	37	52		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	1		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>0.1	0.002		
ppm Water	ppm	ASTM D6304	>1000	22		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	4893		
Particles >6µm		ASTM D7647	>2500	1011		
Particles >14μm		ASTM D7647	>320	42		
Particles >21µm		ASTM D7647	>80	9		
Particles >38μm		ASTM D7647	>20	1		
Particles >71μm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	19/17/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.24	0.18		

Contact/Location: KEN HURST - DFPSIO



OIL ANALYSIS REPORT

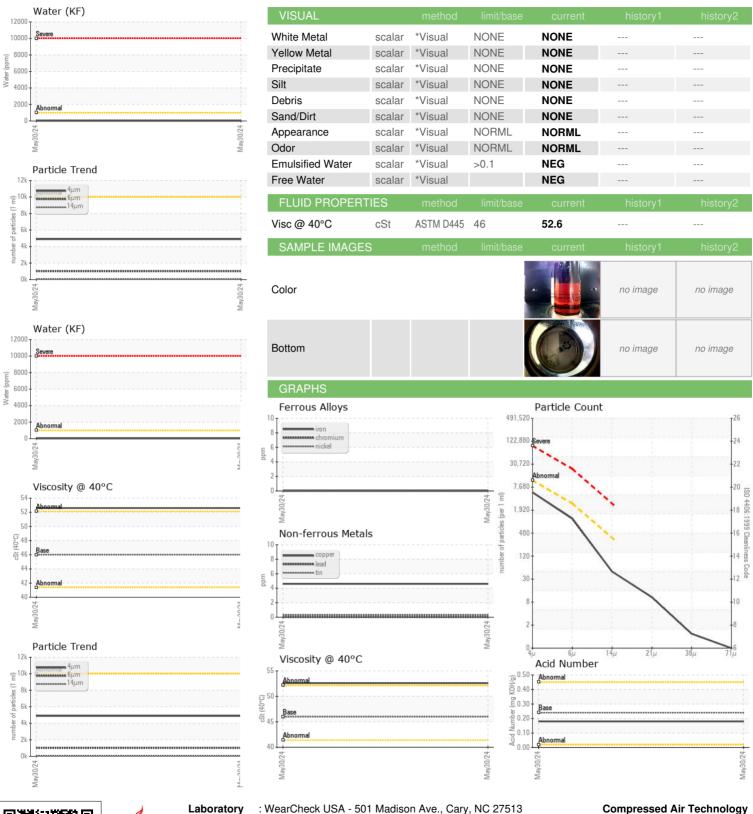





Certificate 12367

Laboratory

Sample No.

: DFP0000016 Lab Number : 06200141 Unique Number : 11062264

Received : 05 Jun 2024 **Tested** Diagnosed Test Package : PLANT (Additional Tests: KF)

: 06 Jun 2024 : 07 Jun 2024 - Don Baldridge 1801 E. 39th Street North Sioux Falls,

US 57104

Contact: KEN HURST khurst@dfpcompressedairtechnology.com

To discuss this sample report, contact Customer Service at 1-833-307-5970. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (605)332-0988 Contact/Location: KEN HURST - DFPSIO