




# OIL ANALYSIS REPORT

Sample Rating Trend

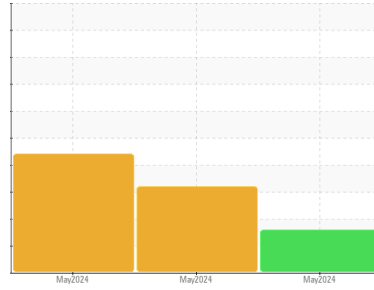

WEAR



Area

**SSK**  
Machine Id

**TK1 HOMO 1 WEST (S/N J3-20.122)**

Component

**Refrigeration Compressor**

Fluid

**LUBRIPLATE SFGO ULTRA 100 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

Resample at the next service interval to monitor.

### ▲ Wear

The iron level is abnormal.

### ● Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP247298</b>	USP0011865	USP0011867
Sample Date	Client Info		<b>25 May 2024</b>	09 May 2024	08 May 2024
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	▲ <b>62</b>	▲ 49	▲ 60
Chromium	ppm	ASTM D5185m >2	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Silver	ppm	ASTM D5185m >2	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m >3	<b>&lt;1</b>	2	2
Lead	ppm	ASTM D5185m >2	<b>&lt;1</b>	1	2
Copper	ppm	ASTM D5185m >8	<b>1</b>	2	2
Tin	ppm	ASTM D5185m >4	<b>2</b>	2	2
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	<1	<1
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Calcium	ppm	ASTM D5185m	<b>1</b>	<1	<1
Phosphorus	ppm	ASTM D5185m	<b>682</b>	711	707
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>1921</b>	1949	1968

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>2</b>	2	2
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	3
Potassium	ppm	ASTM D5185m >20	<b>1</b>	1	2
Water	%	ASTM D6304 >0.01	<b>0.002</b>	▲ 0.011	▲ 0.027
ppm Water	ppm	ASTM D6304 >100	<b>21</b>	▲ 112	▲ 272

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	● <b>13855</b>	● 12153	▲ 157387
Particles >6µm	ASTM D7647	>2500	<b>1736</b>	1957	▲ 89577
Particles >14µm	ASTM D7647	>640	<b>20</b>	32	▲ 2467
Particles >21µm	ASTM D7647	>160	<b>6</b>	5	▲ 181
Particles >38µm	ASTM D7647	>40	<b>2</b>	0	1
Particles >71µm	ASTM D7647	>10	<b>2</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/16	● <b>21/18/11</b>	● 21/18/12	▲ 24/24/18

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.20</b>	0.19	0.20




# OIL ANALYSIS REPORT

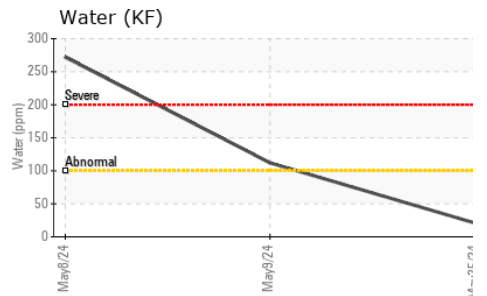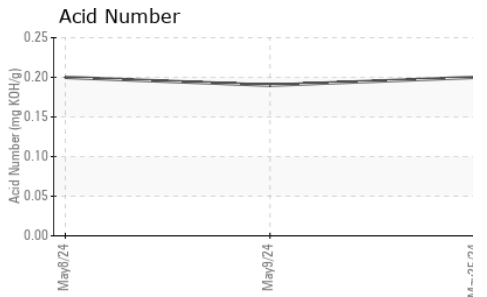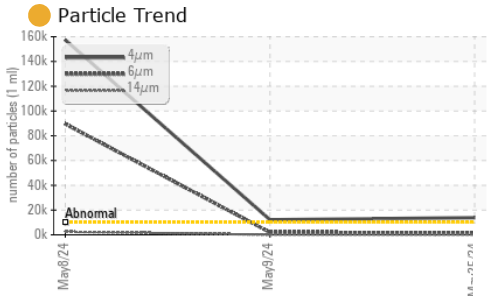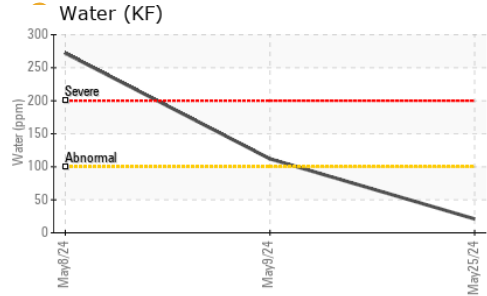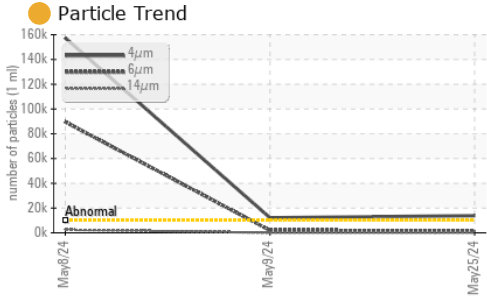





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 98	102	93.9	93.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

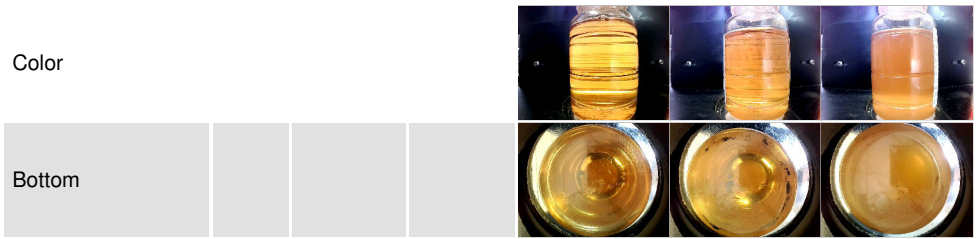

## GRAPHS

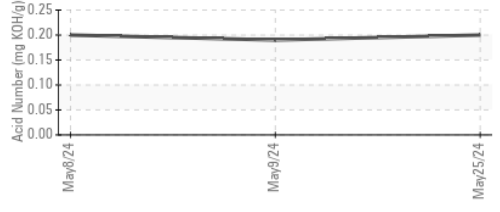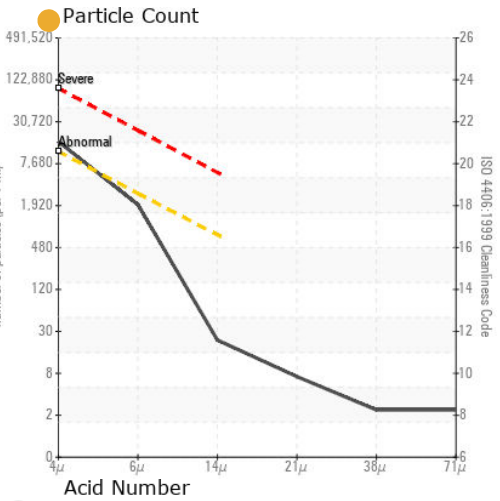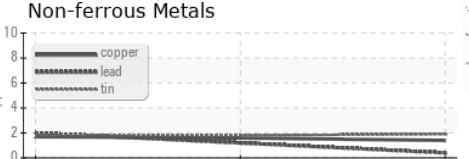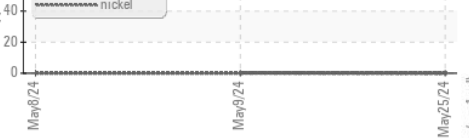

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP247298  
**Lab Number** : 06200142  
**Unique Number** : 11062265  
**Test Package** : IND 2

**KraftHeinz - Champaign - Plant 8318**  
 702 N MATTHIS AVE, DOOR 22 EAST STOREROOM  
 CHAMPAIGN, IL  
 US 61821  
 Contact: Nathan Shankles  
 Nathan.Shankles@kraftheinz.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)