




# OIL ANALYSIS REPORT

Sample Rating Trend

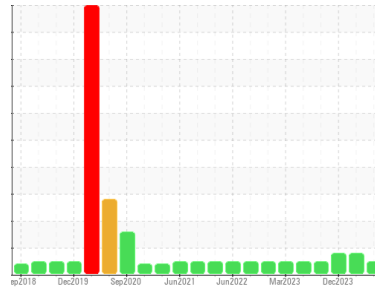

**NORMAL**



Machine Id  
**INGERSOLL RAND 3 I/R (S/N CK3357U00145)**  
 Component  
**Compressor**  
 Fluid  
**USPI MAX FG AIR 46 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>USPM36480</b>	USPM30369	USPM31805
Sample Date	Client Info			<b>04 Jun 2024</b>	10 Mar 2024	06 Dec 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m	0	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	0	<b>0</b>	16	0






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	0
Sodium	ppm	ASTM D5185m		<b>3</b>	2	2
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	<1
Water	%	ASTM D6304	>0.1	<b>0.019</b>	0.009	0.010
ppm Water	ppm	ASTM D6304	>1000	<b>193</b>	94	106

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>1849</b>	---	---
Particles >6µm		ASTM D7647	>2500	<b>288</b>	---	---
Particles >14µm		ASTM D7647	>320	<b>8</b>	---	---
Particles >21µm		ASTM D7647	>80	<b>2</b>	---	---
Particles >38µm		ASTM D7647	>20	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>4	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>18/15/10</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.16	<b>0.14</b>	0.06	0.091



# OIL ANALYSIS REPORT

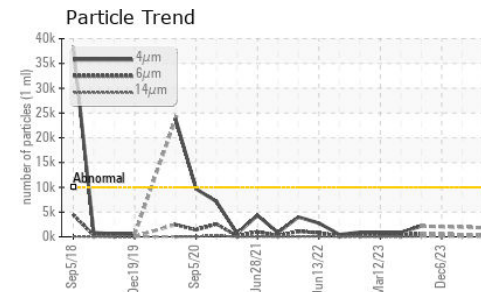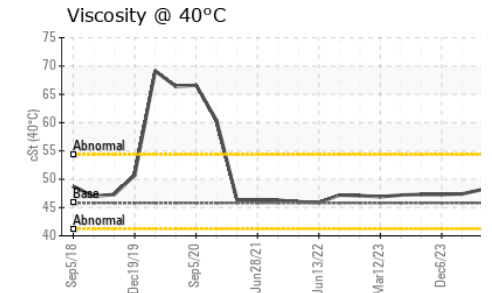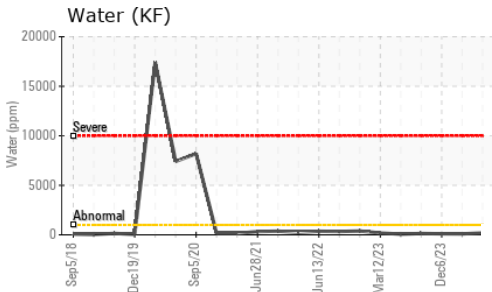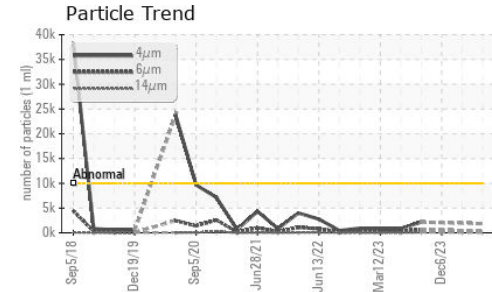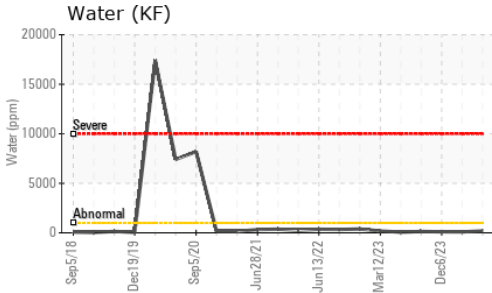

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	▲ MODER	▲ MODER
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.8	48.2	47.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------






Color



Bottom



## GRAPHS

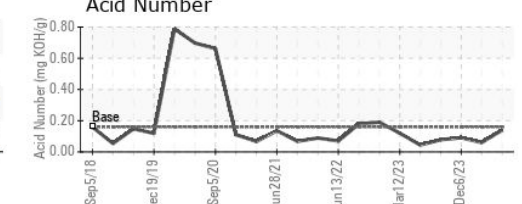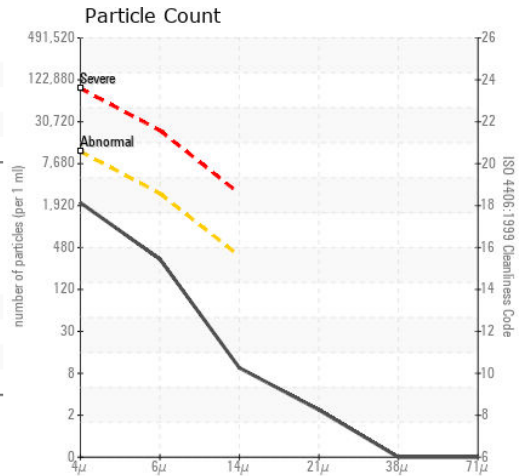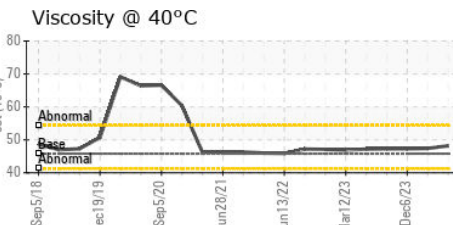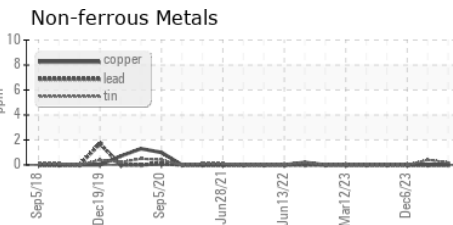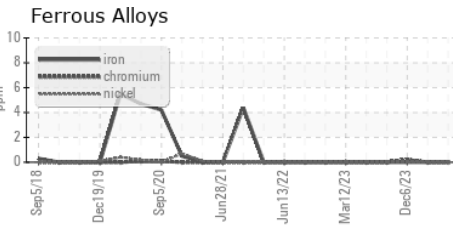

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USPM36480  
 Lab Number : 06200145  
 Unique Number : 11062268  
 Test Package : IND 2

SMITHFIELD FOODS-MIDDLESBORO

Received : 05 Jun 2024  
 Tested : 06 Jun 2024  
 Diagnosed : 07 Jun 2024 - Doug Bogart

MIDDLESBORO, KY  
 US

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
 F: