




# OIL ANALYSIS REPORT

Sample Rating Trend

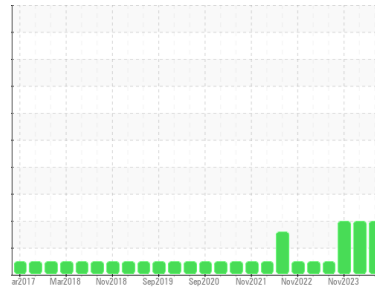

ISO



Machine Id  
**VP-7 (S/N C-4190)**  
 Component  
**Pump**  
 Fluid  
**USPI VAC 100 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM37510</b>	USPM30113	USPM31233
Sample Date	Client Info		<b>04 Jun 2024</b>	22 Feb 2024	07 Nov 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ATTENTION</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	<b>0</b>	8	7
Chromium	ppm	ASTM D5185m >5	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m >5	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m >7	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >12	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >30	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m >9	<b>&lt;1</b>	1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m 1800	<b>1024</b>	995	1165
Zinc	ppm	ASTM D5185m 0	<b>0</b>	3	<1
Sulfur	ppm	ASTM D5185m 0	<b>3</b>	0	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	<b>2</b>	3	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>1</b>	1	0
Water	%	ASTM D6304 >.1	<b>0.030</b>	0.052	0.024
ppm Water	ppm	ASTM D6304 >1000	<b>306</b>	528	246.5






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>9185</b>	14686	37778
Particles >6µm	ASTM D7647	>1300	<b>2266</b>	4139	9329
Particles >14µm	ASTM D7647	>160	<b>215</b>	419	394
Particles >21µm	ASTM D7647	>40	<b>60</b>	113	59
Particles >38µm	ASTM D7647	>10	<b>6</b>	3	1
Particles >71µm	ASTM D7647	>3	<b>2</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>20/18/15</b>	21/19/16	22/20/16

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	<b>0.20</b>	0.26	0.25

# OIL ANALYSIS REPORT

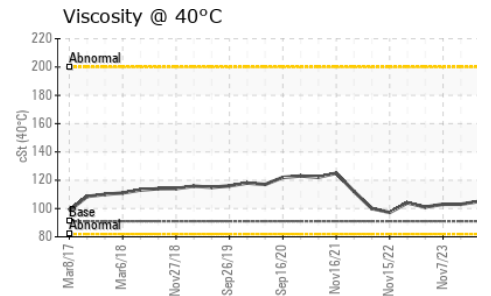
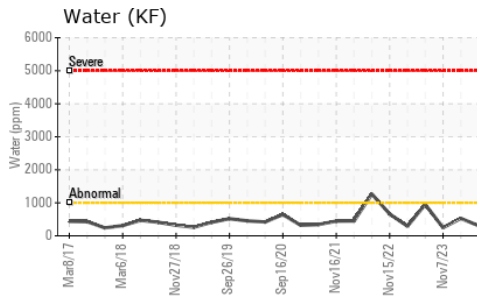
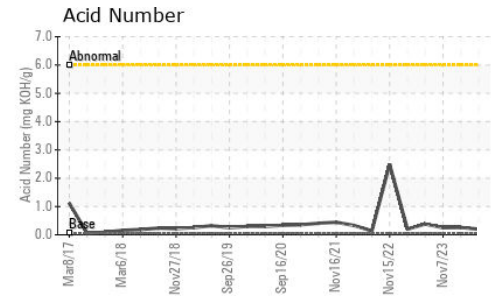
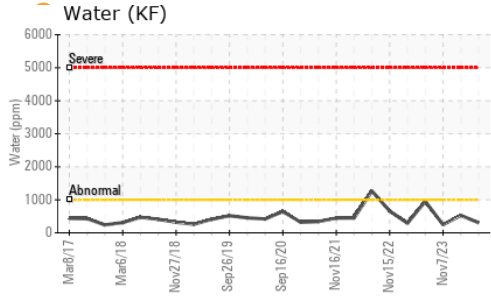
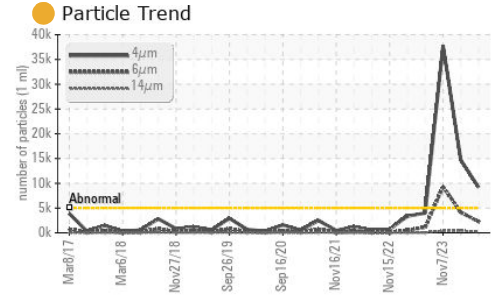


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	105	103	103

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

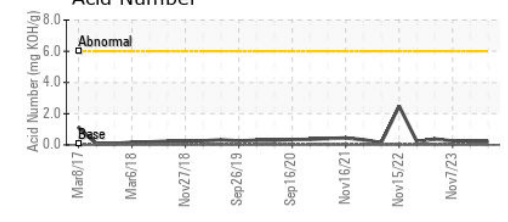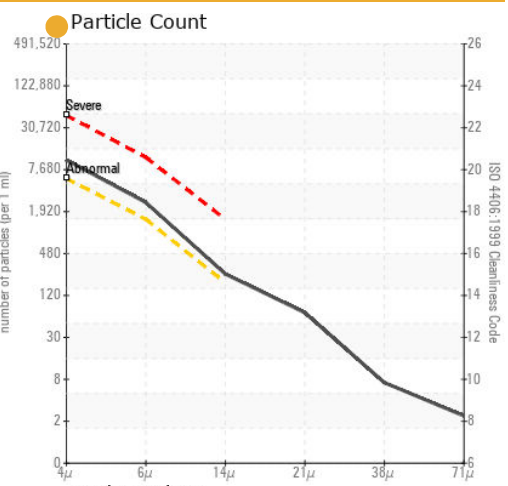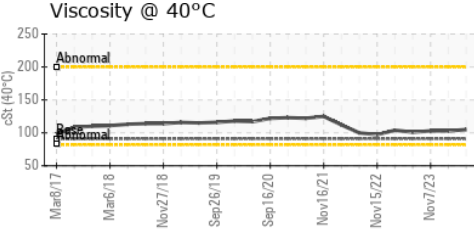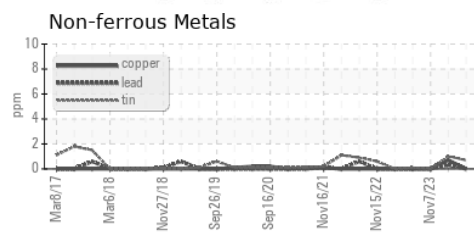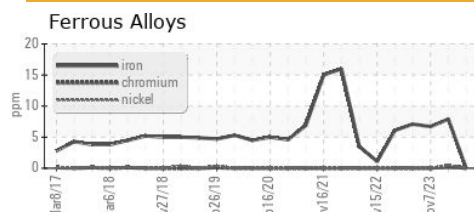

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM37510      **Received** : 05 Jun 2024  
**Lab Number** : 06200163      **Tested** : 06 Jun 2024  
**Unique Number** : 11062286      **Diagnosed** : 07 Jun 2024 - Doug Bogart  
**Test Package** : IND 2

**JBS FOODS**  
 BROOKS, AB  
 CA T1R 1C6  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)