


# **OIL ANALYSIS REPORT**

Sample Rating Trend

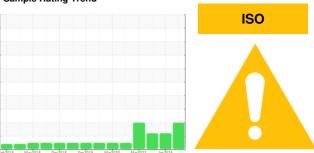

Machine Id

# **PL1 EAST CV LOWER (S/N 5586787)**

Component **Pump** 

**USPI VAC 100 (--- GAL)** 

### **DIAGNOSIS**

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	AATIONI	ام مطاحه مص	1::-		la la tauru d	history.O
	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM36475	USPM30746	USPM26884
Sample Date		Client Info		04 Jun 2024	13 Jan 2024	22 Mar 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	<1	0	3
Chromium	ppm	ASTM D5185m	>5	0	0	0
Nickel	ppm	ASTM D5185m	>5	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>7	0	0	<1
_ead	ppm	ASTM D5185m	>12	0	0	0
Copper	ppm	ASTM D5185m	>30	0	<1	0
Tin	ppm	ASTM D5185m	>9	0	<1	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	0	<1	<1	0
Calcium	ppm	ASTM D5185m	0	0	2	0
Phosphorus	ppm	ASTM D5185m	1800	799	867	956
Zinc	ppm	ASTM D5185m	0	4	3	3
Sulfur	ppm	ASTM D5185m	0	84	12	0
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	9	11	8
Sodium	ppm	ASTM D5185m		0	<1	0
Potassium	ppm	ASTM D5185m	>20	0	0	<1
Water	%	ASTM D6304	>.1	0.057	0.047	0.046
	ppm	ASTM D6304	>1000	576	471	461.2
opm Water						111
opm Water FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
FLUID CLEANLIN	IESS	method ASTM D7647	limit/base >5000	current  △ 61621	history1  A 61015	^ 76690
FLUID CLEANLIN Particles >4μm	IESS					
FLUID CLEANLIN Particles >4μm Particles >6μm	IESS	ASTM D7647	>5000	<u></u> 61621	▲ 61015	<b>▲</b> 76690
FLUID CLEANLIN Particles >4μm Particles >6μm Particles >14μm	IESS	ASTM D7647 ASTM D7647	>5000 >1300	▲ 61621 ▲ 10041	▲ 61015 ▲ 7101	△ 76690 △ 10553
Particles >4µm Particles >6µm Particles >14µm Particles >14µm Particles >14µm Particles >21µm Particles >38µm	IESS	ASTM D7647 ASTM D7647 ASTM D7647	>5000 >1300 >160	△ 61621 △ 10041 △ 213	▲ 61015 ▲ 7101 94	▲ 76690 ▲ 10553 129
FLUID CLEANLIN Particles >4μm Particles >6μm Particles >14μm Particles >21μm	IESS	ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>5000 >1300 >160 >40 >10	▲ 61621 ▲ 10041 ▲ 213 ▲ 44	▲ 61015 ▲ 7101 94 23	▲ 76690 ▲ 10553 129 30
Particles >4μm Particles >6μm Particles >14μm Particles >14μm Particles >21μm Particles >38μm	IESS	ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>5000 >1300 >160 >40 >10	▲ 61621 ▲ 10041 ▲ 213 ▲ 44 5	▲ 61015 ▲ 7101 94 23 2	↑ 76690 ↑ 10553 129 30 1

Contact/Location: ? ? - ARMSAIL



## **OIL ANALYSIS REPORT**





Viscosity @ 40°C

22 200

180

(+0°C) (+0°C) 140 120

100

80



Sample No.

Laboratory

: USPM36475 Lab Number : 06200181 Unique Number : 11062304

250

100

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 05 Jun 2024

Tested Diagnosed

: 06 Jun 2024 : 10 Jun 2024 - Doug Bogart

Jan 13/24

ARMOUR - ECKRICH (SMITHFIELD FOODS SMISAIILL) SAINT CHARLES, IL US

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Viscosity @ 40°C

Acid Number

00.8 (mg KOH/g) 00.9 4.00

0.00 G

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact:

T:

F: