




# OIL ANALYSIS REPORT

Sample Rating Trend

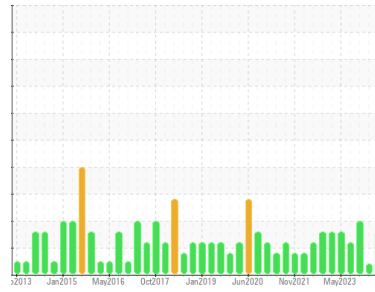

ISO



Machine Id  
**MYCOM TYSSPRCH-B4 (S/N BM-16862)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**USPI ALT-68 SC (10 GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0012529</b>	USP0007426	USP0003779
Sample Date	Client Info		<b>01 Jun 2024</b>	04 Mar 2024	21 Nov 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>4</b>	<1	5
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>2</b>	0	1
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >8	<b>2</b>	0	3
Tin	ppm	ASTM D5185m >4	<b>0</b>	<1	2
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 50	<b>0</b>	0	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>1</b>	1	1
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Water	%	ASTM D6304 >0.01	<b>0.001</b>	0.003	0.004
ppm Water	ppm	ASTM D6304 >100	<b>14</b>	39	44






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>▲ 233487</b>	---	▲ 194707
Particles >6µm	ASTM D7647	>2500	<b>▲ 116385</b>	---	▲ 95712
Particles >14µm	ASTM D7647	>320	<b>▲ 347</b>	---	▲ 1597
Particles >21µm	ASTM D7647	>80	<b>21</b>	---	▲ 150
Particles >38µm	ASTM D7647	>20	<b>0</b>	---	0
Particles >71µm	ASTM D7647	>4	<b>0</b>	---	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>▲ 25/24/16</b>	---	▲ 25/24/18

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	<b>0.013</b>	0.014	0.014


# OIL ANALYSIS REPORT

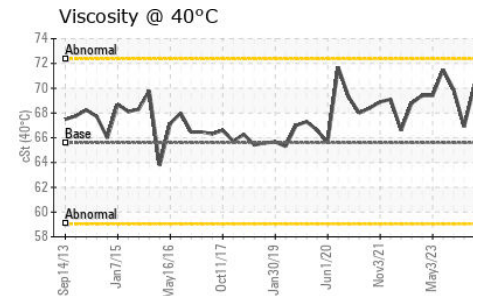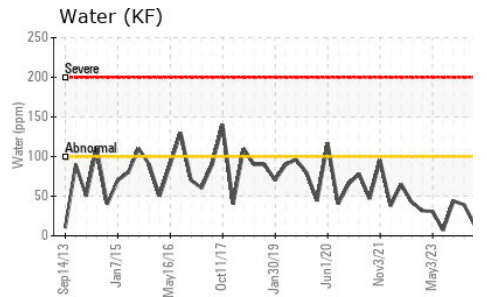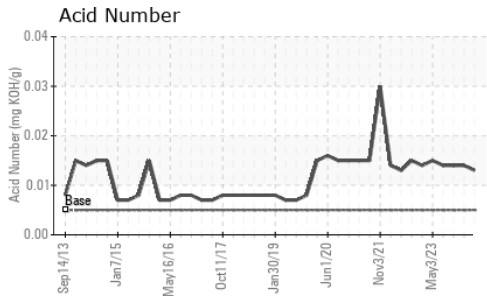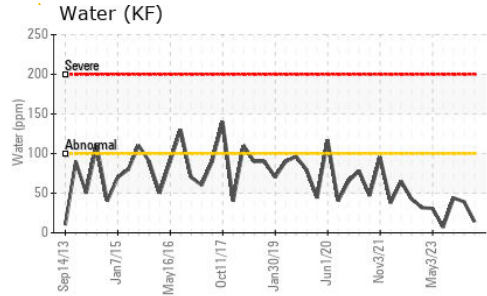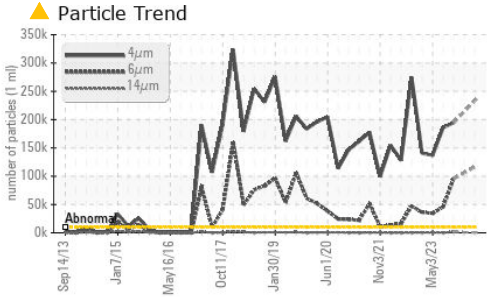






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	<b>▲ MODER</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	65.6	<b>70.3</b>	66.9	69.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

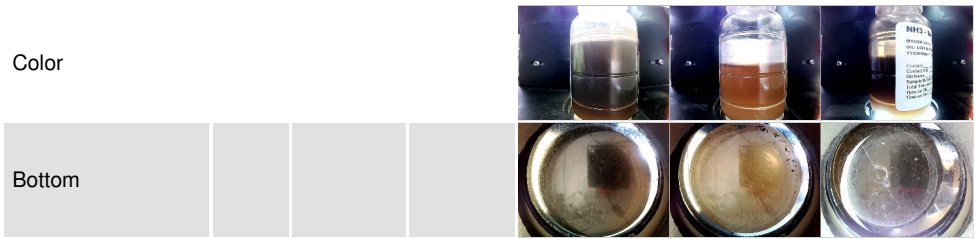

## GRAPHS

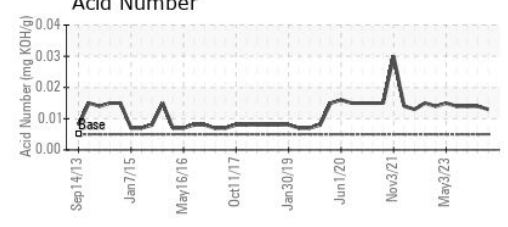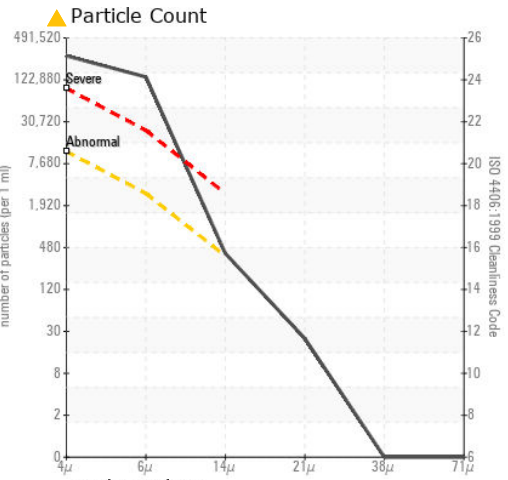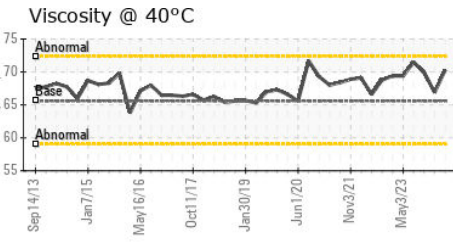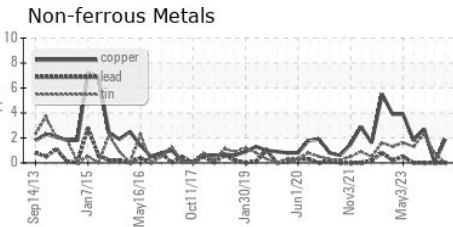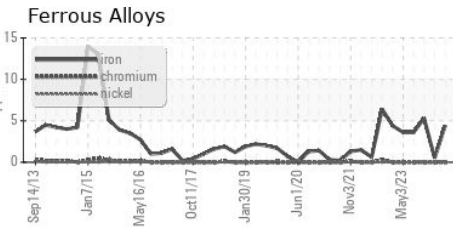

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0012529      **Received** : 05 Jun 2024  
**Lab Number** : **06200207**      **Tested** : 06 Jun 2024  
**Unique Number** : 11062330      **Diagnosed** : 10 Jun 2024 - Jonathan Hester  
**Test Package** : IND 2

**TYSON CH -SPRINGDALE-USP**  
 RANDALL WOBBER RD  
 SPRINGDALE, AR  
 US 72764  
 Contact: SERVICE

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)