




# OIL ANALYSIS REPORT

Sample Rating Trend

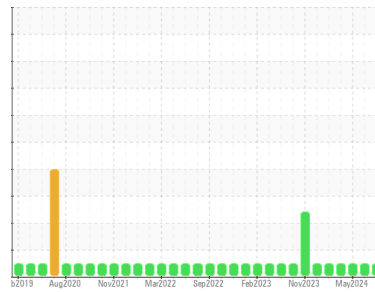

**NORMAL**



Machine Id  
**CTG-200**  
 Component  
**Reservoir Turbine**  
 Fluid  
**MOBIL SHC 824 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0043285</b>	RP0043286	RP0041527
Sample Date	Client Info		<b>04 Jun 2024</b>	13 May 2024	12 May 2024
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	<b>1</b>	0	0
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >2	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	2
Lead	ppm	ASTM D5185m	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >5	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m >5	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	<1	1
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	3	<1
Calcium	ppm	ASTM D5185m	<b>0</b>	<1	3
Phosphorus	ppm	ASTM D5185m	<b>1010</b>	1088	1712
Zinc	ppm	ASTM D5185m	<b>1</b>	0	1

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	1
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	2	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	1
Water	%	ASTM D6304 >0.03	<b>0.001</b>	0.001	0.002
ppm Water	ppm	ASTM D6304 >300	<b>7</b>	9	22






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>2500	<b>1454</b>	202	378
Particles >6µm	ASTM D7647	>640	<b>462</b>	48	69
Particles >14µm	ASTM D7647	>80	<b>50</b>	6	9
Particles >21µm	ASTM D7647	>20	<b>12</b>	1	5
Particles >38µm	ASTM D7647	>4	<b>0</b>	0	1
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	1
Oil Cleanliness	ISO 4406 (c)	>18/16/13	<b>18/16/13</b>	15/13/10	16/13/10

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.5	<b>0.18</b>	0.172	0.09


# OIL ANALYSIS REPORT

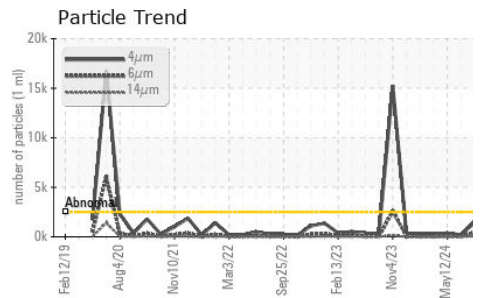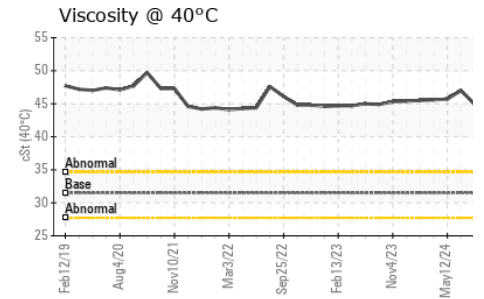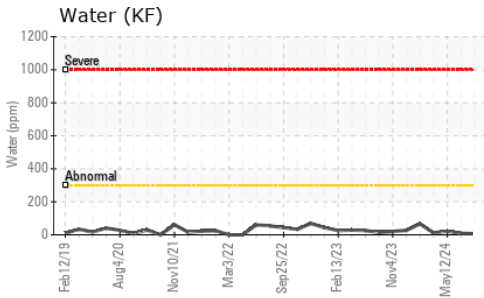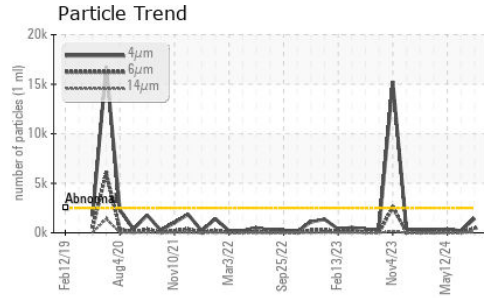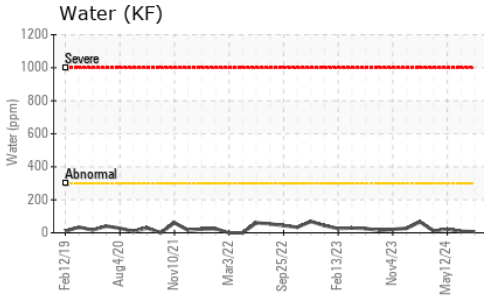

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.03	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	31.5	<b>44.9</b>	47.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

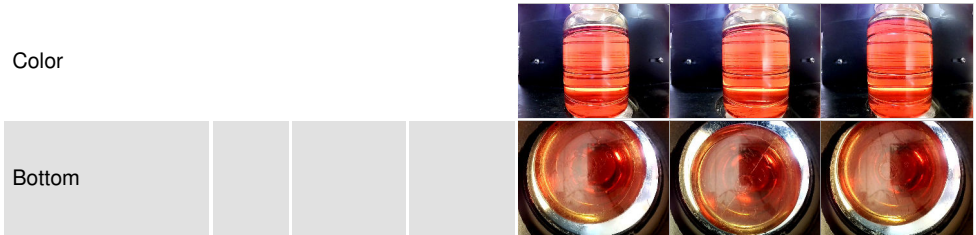


## GRAPHS


### Ferrous Alloys

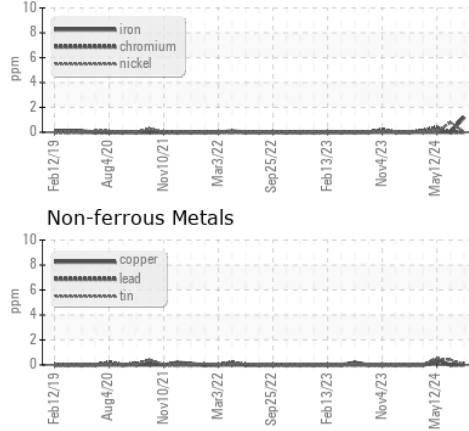


### Non-ferrous Metals

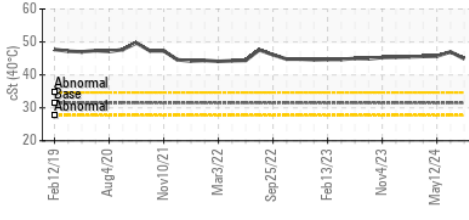


### Viscosity @ 40°C

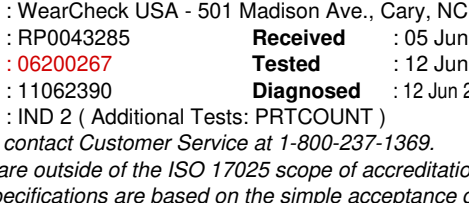

### Particle Count

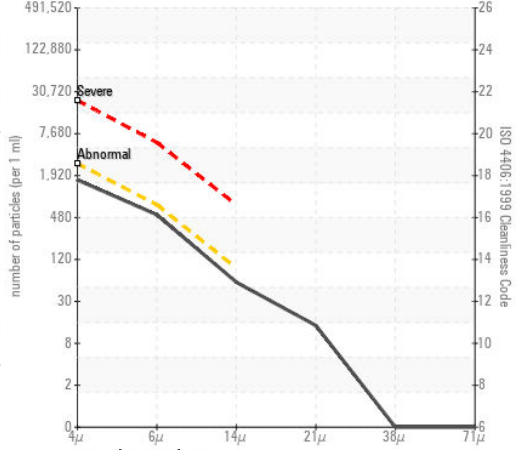

### Acid Number

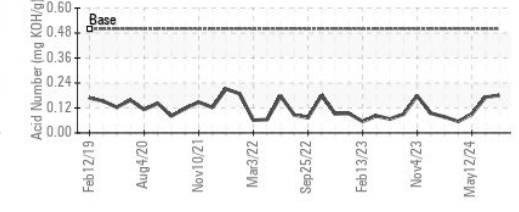

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0043285 **Received** : 05 Jun 2024  
**Lab Number** : **06200267** **Tested** : 12 Jun 2024  
**Unique Number** : 11062390 **Diagnosed** : 12 Jun 2024 - Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: PRTCOUNT )

**ENGIE-MATEP**  
 474 BROOKLINE AVE  
 BOSTON, MA  
 US 02215  
 Contact: ROBERT ST SAUVEUR  
 robert.stsauveur@engie.com  
 T: (401)651-9381  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)