

Area


ULTRA COOLANT

Machine Id

INGERSOLL RAND CBV469468 - NATOLI ENG

Component

Compressor

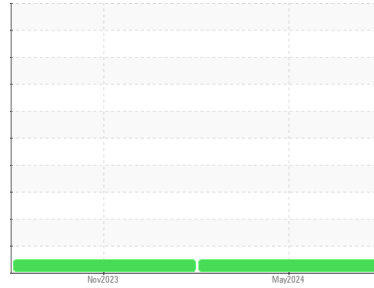

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info	JHF0000337	UCH06021668	---
Sample Date	Client Info	13 May 2024	21 Nov 2023	---
Machine Age	hrs	Client Info	21773	21492
Oil Age	hrs	Client Info	279	2260
Oil Changed	Client Info	Not Changed	Not Changed	---
Sample Status		NORMAL	NORMAL	---

CONTAMINATION method limit/base current history1 history2

Water	WC Method	>0.1	NEG	NEG	---
-------	-----------	------	------------	-----	-----

WEAR METALS method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	0	0	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	0	<1	---
Lead	ppm	ASTM D5185m	>25	0	0	---
Copper	ppm	ASTM D5185m	>50	0	<1	---
Tin	ppm	ASTM D5185m	>15	0	1	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES method limit/base current history1 history2

Boron	ppm	ASTM D5185m	0	0	0	---
Barium	ppm	ASTM D5185m	500	635	653	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m	0	<1	2	---
Calcium	ppm	ASTM D5185m	0	1	5	---
Phosphorus	ppm	ASTM D5185m	20	3	1	---
Zinc	ppm	ASTM D5185m	0	20	12	---
Sulfur	ppm	ASTM D5185m	200	398	367	---



CONTAMINANTS method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	2	5	---
Sodium	ppm	ASTM D5185m		25	35	---
Potassium	ppm	ASTM D5185m	>20	<1	2	---

FLUID DEGRADATION method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045		0.153	0.168	---
------------------	----------	------------	--	--------------	-------	-----

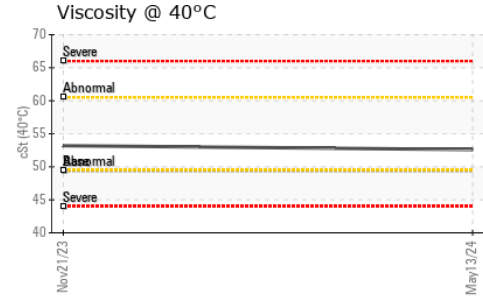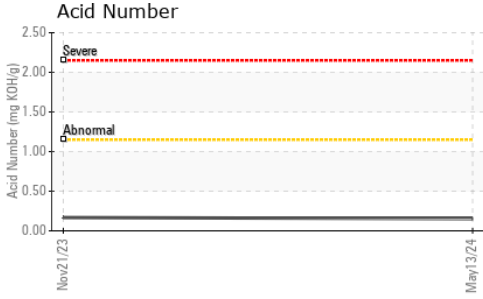

OIL ANALYSIS REPORT







VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	49.4	52.6	53.2	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color					no image
Bottom					no image

GRAPHS

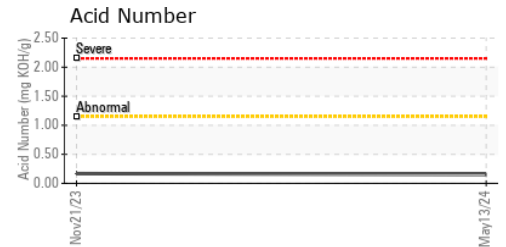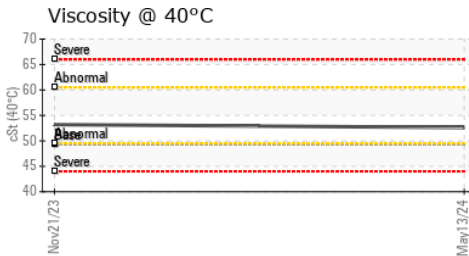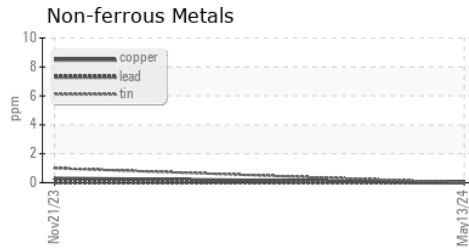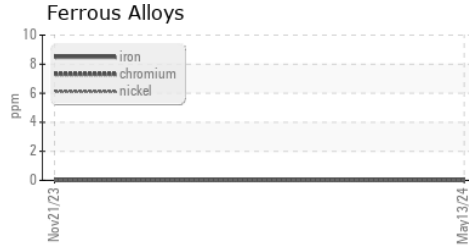

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : JHF0000337
Lab Number : **06200279**
Unique Number : 11062402
Test Package : IND 2

Received : 05 Jun 2024
Tested : 06 Jun 2024
Diagnosed : 06 Jun 2024 - Wes Davis

JOHN HENRY FOSTER COMPANY
 4700 LEBOURGET STREET
 SAINT LOUIS, MO
 US 63134
 Contact: RACHEL VON HATTEN
 rvonhatten@jhf.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (314)593-1267

F: (314)874-0965