


# OIL ANALYSIS REPORT

Area  
**ROTO Z [#6]**  
 Machine Id  
**ATLAS COPCO AIF099243 - GM WENTZVILLE/JONES-LANG-LASALLE**  
 Component  
**Compressor**

Sample Rating Trend

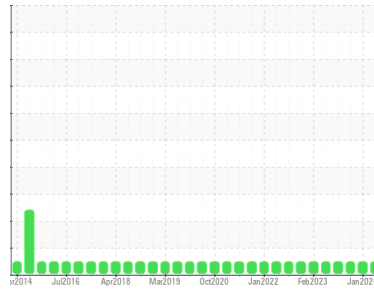

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2    |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info |             | <b>JHF0000130</b>  | UCH06065765 | UCH06051037 |
| Sample Date   | Client Info |             | <b>29 May 2024</b> | 17 Jan 2024 | 15 Nov 2023 |
| Machine Age   | hrs         | Client Info | <b>10617</b>       | 9986        | 9788        |
| Oil Age       | hrs         | Client Info | <b>3404</b>        | 0           | 0           |
| Oil Changed   | Client Info |             | <b>N/A</b>         | Not Changd  | Not Changd  |
| Sample Status |             |             | <b>NORMAL</b>      | NORMAL      | NORMAL      |

## CONTAMINATION

|       | method    | limit/base | current    | history1 | history2 |
|-------|-----------|------------|------------|----------|----------|
| Water | WC Method | >0.1       | <b>NEG</b> | NEG      | NEG      |

## WEAR METALS

|          | method | limit/base      | current  | history1 | history2 |
|----------|--------|-----------------|----------|----------|----------|
| Iron     | ppm    | ASTM D5185m >50 | <b>0</b> | 0        | 0        |
| Chromium | ppm    | ASTM D5185m >5  | <b>0</b> | 0        | 0        |
| Nickel   | ppm    | ASTM D5185m     | <b>0</b> | 0        | 0        |
| Titanium | ppm    | ASTM D5185m     | <b>0</b> | 0        | <1       |
| Silver   | ppm    | ASTM D5185m     | <b>0</b> | 0        | 0        |
| Aluminum | ppm    | ASTM D5185m >15 | <b>0</b> | 0        | 0        |
| Lead     | ppm    | ASTM D5185m >65 | <b>0</b> | 0        | 0        |
| Copper   | ppm    | ASTM D5185m >65 | <b>0</b> | <1       | <1       |
| Tin      | ppm    | ASTM D5185m >10 | <b>0</b> | 0        | <1       |
| Vanadium | ppm    | ASTM D5185m     | <b>0</b> | <1       | <1       |
| Cadmium  | ppm    | ASTM D5185m     | <b>0</b> | 0        | 0        |

## ADDITIVES

|            | method | limit/base  | current      | history1 | history2 |
|------------|--------|-------------|--------------|----------|----------|
| Boron      | ppm    | ASTM D5185m | <b>0</b>     | 0        | 0        |
| Barium     | ppm    | ASTM D5185m | <b>1</b>     | 23       | 2        |
| Molybdenum | ppm    | ASTM D5185m | <b>0</b>     | 0        | 0        |
| Manganese  | ppm    | ASTM D5185m | <b>0</b>     | 0        | <1       |
| Magnesium  | ppm    | ASTM D5185m | <b>&lt;1</b> | 0        | 0        |
| Calcium    | ppm    | ASTM D5185m | <b>0</b>     | 0        | 0        |
| Phosphorus | ppm    | ASTM D5185m | <b>463</b>   | 487      | 480      |
| Zinc       | ppm    | ASTM D5185m | <b>2</b>     | 0        | 0        |
| Sulfur     | ppm    | ASTM D5185m | <b>741</b>   | 687      | 640      |


## CONTAMINANTS

|           | method | limit/base      | current      | history1 | history2 |
|-----------|--------|-----------------|--------------|----------|----------|
| Silicon   | ppm    | ASTM D5185m >35 | <b>&lt;1</b> | 0        | 0        |
| Sodium    | ppm    | ASTM D5185m     | <b>0</b>     | 0        | 1        |
| Potassium | ppm    | ASTM D5185m >20 | <b>0</b>     | 0        | 0        |

## FLUID DEGRADATION

|                  | method   | limit/base | current     | history1 | history2 |
|------------------|----------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | <b>0.27</b> | 0.24     | 0.24     |


# OIL ANALYSIS REPORT

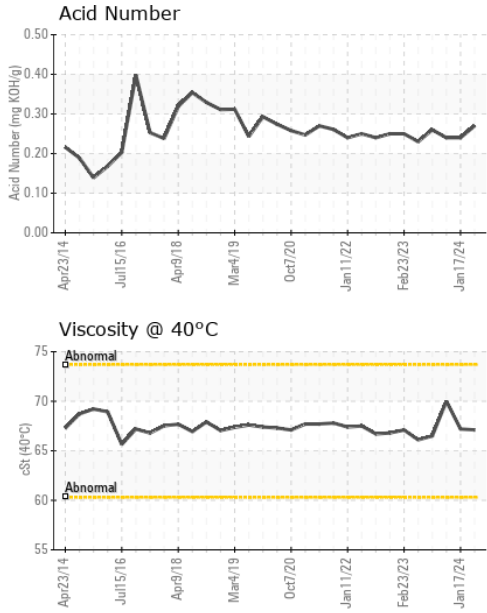





| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.1    | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |

| FLUID PROPERTIES | method | limit/base | current     | history1 | history2 |
|------------------|--------|------------|-------------|----------|----------|
| Visc @ 40°C      | cSt    | ASTM D445  | <b>67.1</b> | 67.2     | 70.0     |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

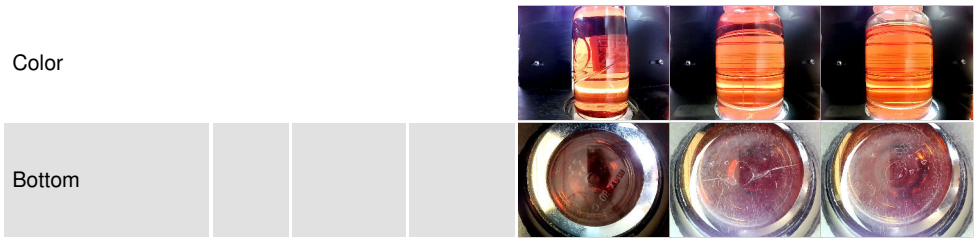

## GRAPHS

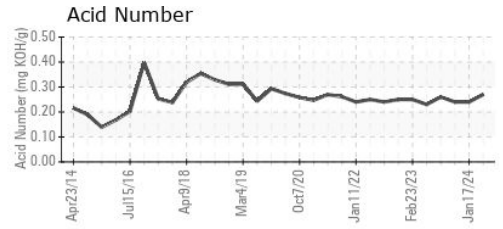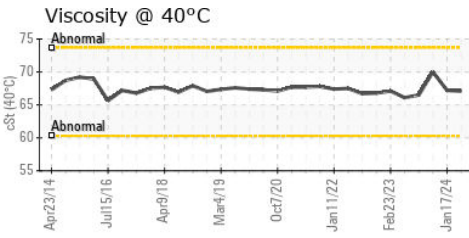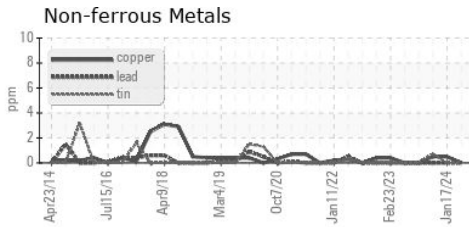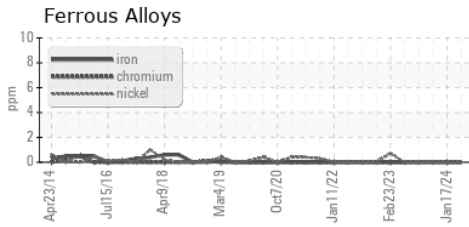

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : JHF0000130  
**Lab Number** : **06200297**  
**Unique Number** : 11062420  
**Test Package** : IND 2  
**Received** : 05 Jun 2024  
**Tested** : 06 Jun 2024  
**Diagnosed** : 06 Jun 2024 - Wes Davis

**JOHN HENRY FOSTER COMPANY**  
 4700 LEBOURGET STREET  
 SAINT LOUIS, MO  
 US 63134  
 Contact: RACHEL VON HATTEN  
 rvonhatten@jhfc.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)