


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

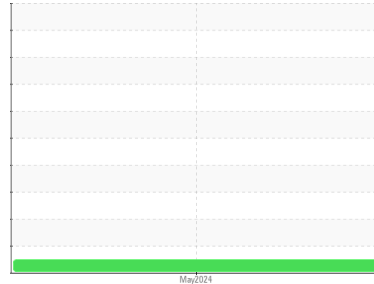

Area

**NOT GIVEN**

Machine Id

**INGERSOLL RAND CBV112143 - MID AM BUILDING SUPPLY (S/N CBF112143)**

Component

**Rotary Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) COMPRESSOR OIL (PAG) ISO 46. Please confirm.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>JHF0000343</b>	---	---
Sample Date	Client Info		<b>20 May 2024</b>	---	---
Machine Age	hrs	Client Info	<b>28652</b>	---	---
Oil Age	hrs	Client Info	<b>5342</b>	---	---
Oil Changed	Client Info		<b>Not Changed</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.8	<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >70	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >4	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m >3	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 2	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 525	<b>693</b>	---	---
Molybdenum	ppm	ASTM D5185m 10	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m 5	<b>1</b>	---	---
Calcium	ppm	ASTM D5185m 10	<b>3</b>	---	---
Phosphorus	ppm	ASTM D5185m 250	<b>3</b>	---	---
Zinc	ppm	ASTM D5185m 100	<b>14</b>	---	---
Sulfur	ppm	ASTM D5185m 400	<b>396</b>	---	---


## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >45	<b>3</b>	---	---
Sodium	ppm	ASTM D5185m	<b>28</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>1</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.168</b>	---	---

# OIL ANALYSIS REPORT

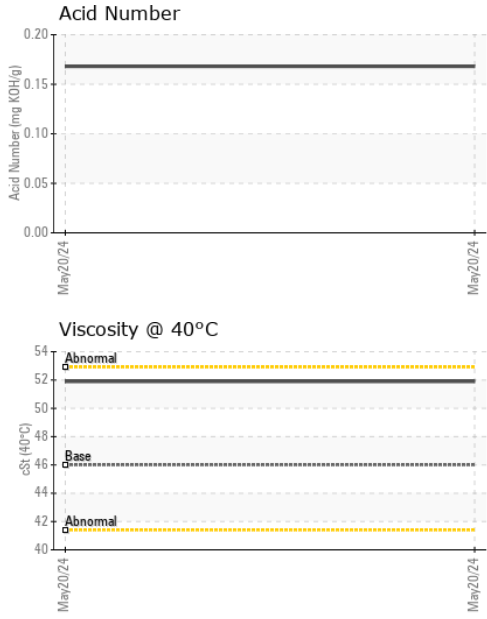





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.8	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	<b>51.9</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

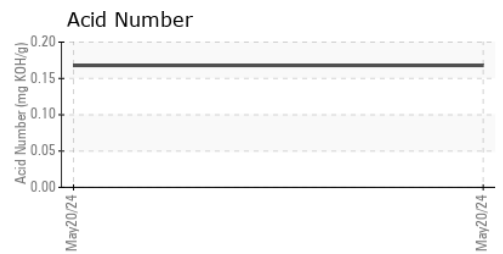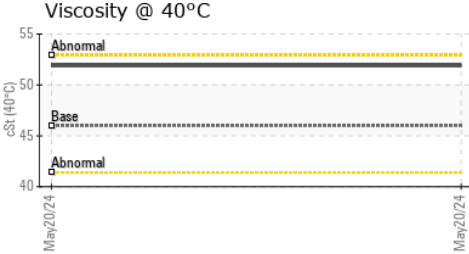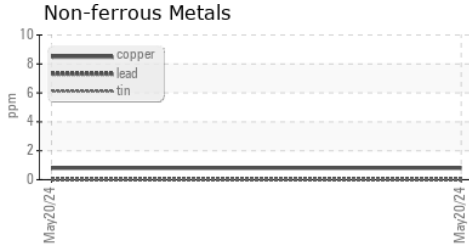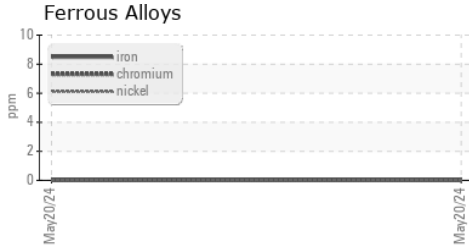

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : JHF0000343  
**Lab Number** : **06200302**  
**Unique Number** : 11062425  
**Test Package** : IND 2

**Received** : 05 Jun 2024  
**Tested** : 06 Jun 2024  
**Diagnosed** : 06 Jun 2024 - Wes Davis

**JOHN HENRY FOSTER COMPANY**  
 4700 LEBOURGET STREET  
 SAINT LOUIS, MO  
 US 63134  
 Contact: RACHEL VON HATTEN  
 rvonhatten@jhf.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (314)593-1267  
 F: (314)874-0965