




OIL ANALYSIS REPORT

Sample Rating Trend

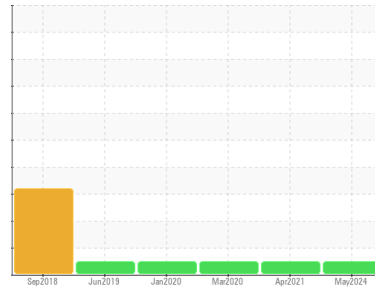

NORMAL



Area

DURATECH HI

Machine Id

003-119551 - CATERPILLAR DECATUR

Component

Compressor

DIAGNOSIS

Recommendation

We suspect abnormal contamination may be due to sampling method. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

High concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		UCH06200308	UCH05264515	UCH04948107
Sample Date	Client Info		14 May 2024	28 Apr 2021	24 Mar 2020
Machine Age	hrs	Client Info	62142	466552	42904
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		Changed	N/A	Not Chngd
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	5	<1
Chromium	ppm	ASTM D5185m	>10	0	0
Nickel	ppm	ASTM D5185m		0	<1
Titanium	ppm	ASTM D5185m		0	0
Silver	ppm	ASTM D5185m		0	0
Aluminum	ppm	ASTM D5185m	>25	1	0
Lead	ppm	ASTM D5185m	>25	0	0
Copper	ppm	ASTM D5185m	>50	0	<1
Tin	ppm	ASTM D5185m	>15	0	0
Antimony	ppm	ASTM D5185m		---	0
Vanadium	ppm	ASTM D5185m		0	0
Cadmium	ppm	ASTM D5185m		0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	2
Barium	ppm	ASTM D5185m		<1	84
Molybdenum	ppm	ASTM D5185m		0	0
Manganese	ppm	ASTM D5185m		0	<1
Magnesium	ppm	ASTM D5185m		<1	<1
Calcium	ppm	ASTM D5185m		0	<1
Phosphorus	ppm	ASTM D5185m		320	164
Zinc	ppm	ASTM D5185m		8	0
Sulfur	ppm	ASTM D5185m		1185	124

CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	5	2
Sodium	ppm	ASTM D5185m		1	17
Potassium	ppm	ASTM D5185m	>20	0	1

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.62	0.654




OIL ANALYSIS REPORT

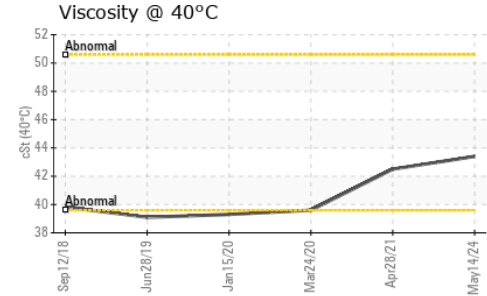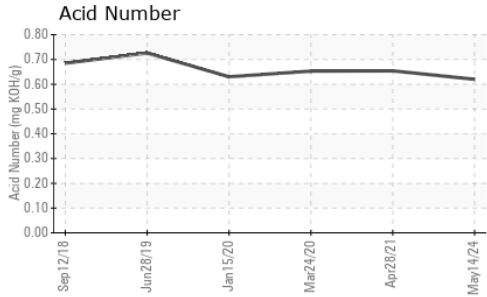





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	HEAVY	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	43.4	42.5	39.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

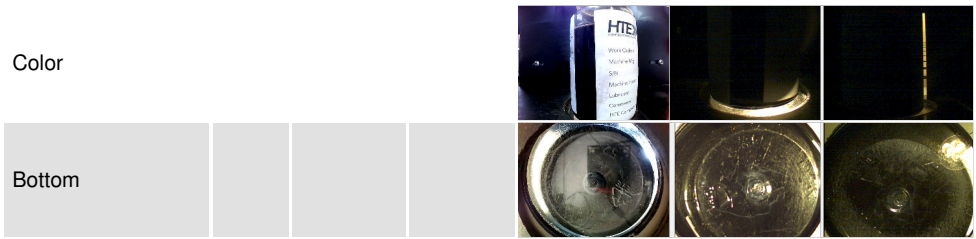

GRAPHS

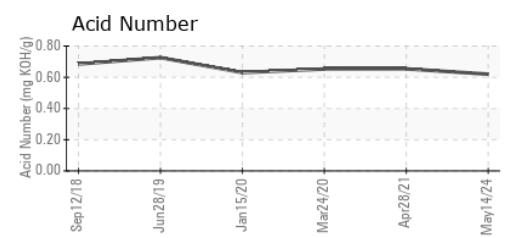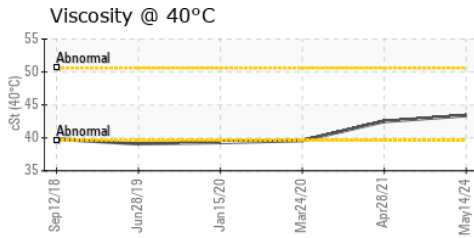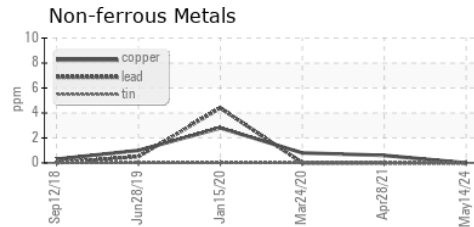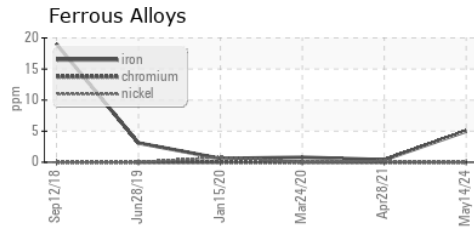

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06200308 **Received** : 05 Jun 2024
Lab Number : **06200308** **Tested** : 06 Jun 2024
Unique Number : 11062431 **Diagnosed** : 10 Jun 2024 - Jonathan Hester
Test Package : IND 2

HTE TECHNOLOGIES
 2021 CONGRESSIONAL DR
 ST LOUIS, MO
 US 63146
 Contact: JOSH DYRLAND
 josh.dyrland@htetech.com
 T: (314)731-4444
 F: (314)731-4424

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)