




# OIL ANALYSIS REPORT

## Sample Rating Trend

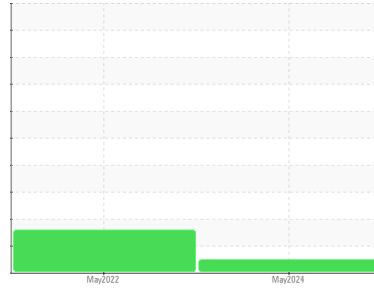

**NORMAL**



Machine Id  
**KAESER 7134530**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA018622</b>	KCP44781	---
Sample Date	Client Info		<b>31 May 2024</b>	23 May 2022	---
Machine Age	hrs	Client Info	<b>12850</b>	7301	---
Oil Age	hrs	Client Info	<b>0</b>	5000	---
Oil Changed	Client Info		<b>Changed</b>	Changed	---
Sample Status			<b>NORMAL</b>	ABNORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	3	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	8	---
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	<1	---
Barium	ppm	ASTM D5185m 90	<b>8</b>	0	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m 100	<b>77</b>	43	---
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m 0	<b>0</b>	8	---
Zinc	ppm	ASTM D5185m 0	<b>6</b>	16	---
Sulfur	ppm	ASTM D5185m 23500	<b>24338</b>	17127	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>2</b>	2	---
Sodium	ppm	ASTM D5185m	<b>21</b>	10	---
Potassium	ppm	ASTM D5185m >20	<b>4</b>	0	---
Water	%	ASTM D6304 >0.05	<b>0.022</b>	0.033	---
ppm Water	ppm	ASTM D6304 >500	<b>225</b>	331.7	---






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>2621</b>	24053	---
Particles >6µm	ASTM D7647	>1300	<b>978</b>	▲ 5572	---
Particles >14µm	ASTM D7647	>80	<b>69</b>	▲ 404	---
Particles >21µm	ASTM D7647	>20	<b>15</b>	▲ 69	---
Particles >38µm	ASTM D7647	>4	<b>1</b>	3	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>19/17/13</b>	▲ 22/20/16	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.40</b>	0.45	---


# OIL ANALYSIS REPORT

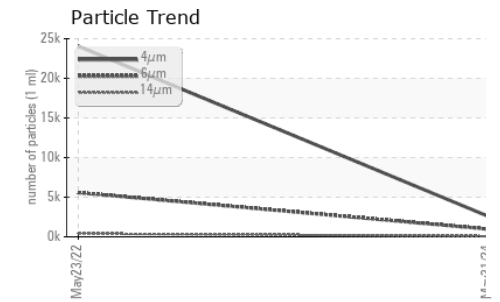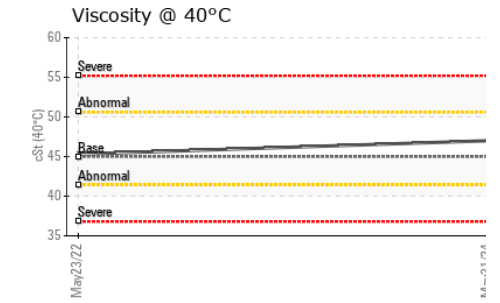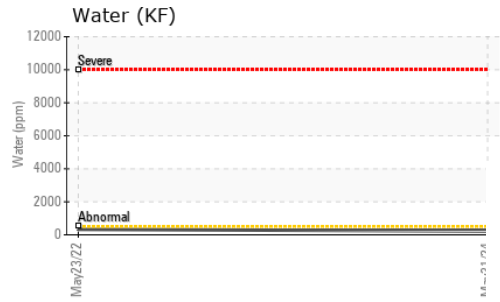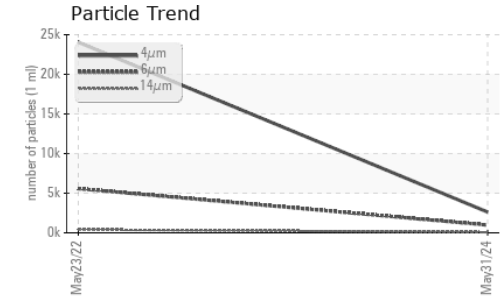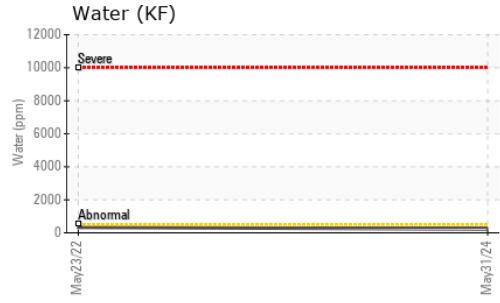






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.0	45.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

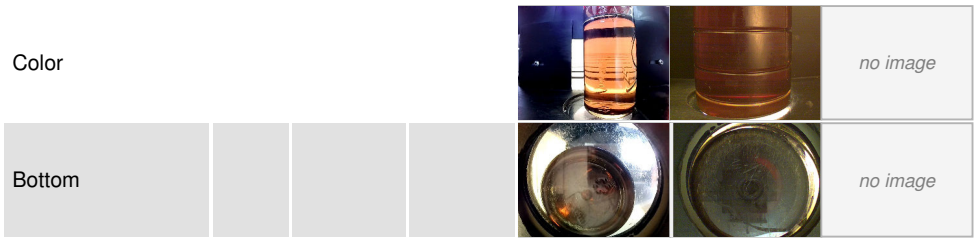

## GRAPHS

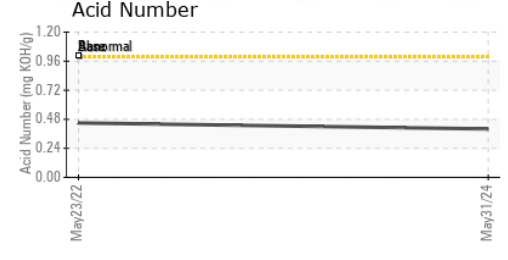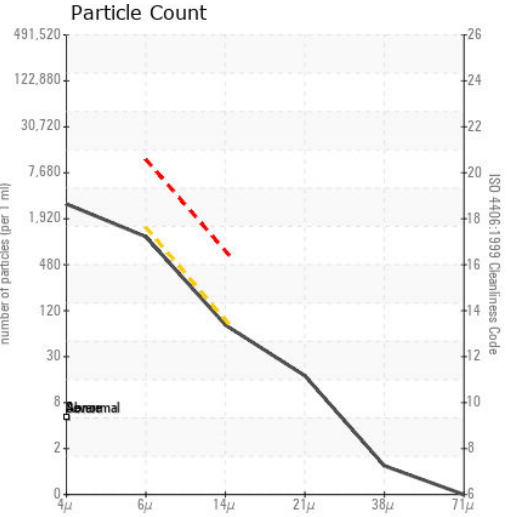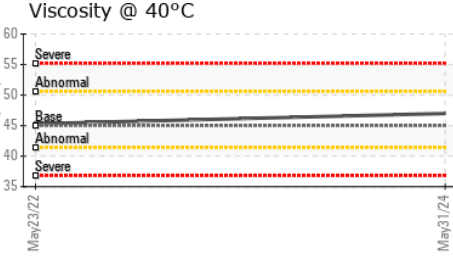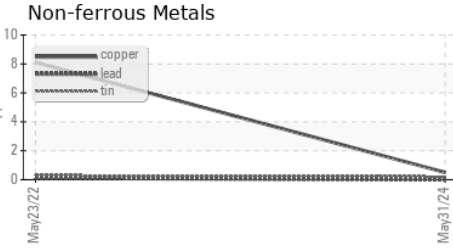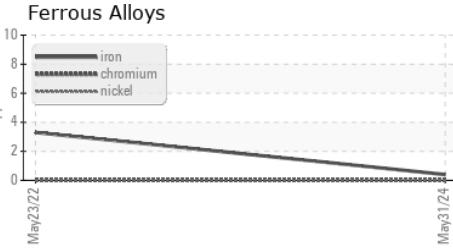

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA018622  
**Lab Number** : 06200770  
**Unique Number** : 11062893  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )  
**Received** : 05 Jun 2024  
**Tested** : 07 Jun 2024  
**Diagnosed** : 07 Jun 2024 - Don Baldrige

**MINGHUA MEXICO CO**  
 41490 BOYCE RD  
 FREMONT, CA  
 US 94538

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)  
 Contact: TREY WHITWORTH  
 TREY.WHITWORTH@MINGHUAGLOBAL.COM  
 T:  
 F: